

EAST FORD STREET

SOUTH 14th STREET

EAST ASH STREET

SOUTH 13th STREET



① SAFETY REFERENCE SITE PLAN  
1" = 50'-0"

### SITE PLAN LEGEND

- W - W - DOMESTIC WATER LINE
- UE - UE - UNDERGROUND ELECTRICAL LINE
- SAN - SAN - SANITARY SEWER LINE
- OE - OE - OVERHEAD UTILITY LINE
- G - G - GAS LINE
- X - X - 4 FOOT HIGH CHAIN LINK FENCE

### LIFE SAFETY - SITE PLAN

Project number	19-985
Date	12/11/19
Drawn by	SBS
Checked by	SBS
Scale As indicated	





### HERRIN CUSD#4

### MIDDLE SCHOOL










817 SOUTH PARK AVENUE  
HERRIN, ILLINOIS 62946  
phone: 618-942-6018 fax: 618-942-6819  
email: general@architecturiques.com

# LIFE SAFETY PLAN KEY
















## AREAS


-  SPRINKLED AREA
-  HAZARDOUS AREA
-  AREA PROTECTED BY FIRE DETECTION SYSTEM
-  EXIT STAIR

## BARRIERS

-  1 HOUR FIRE RATED BARRIER
-  2 HOUR FIRE RATED BARRIER
-  3 HOUR RATED FIRE BARRIER
-  NON-RATED SMOKE LIMITING BARRIER (CORRIDOR WALL)
-  NON-RATED SMOKE BARRIER
-  COMBINATION 1/2 HOUR RATED FIRE BARRIER & SMOKE BARRIER
-  COMBINATION 1 HOUR RATED FIRE BARRIER & SMOKE BARRIER
-  COMBINATION 2 HOUR RATED FIRE BARRIER & SMOKE BARRIER
-  COMBINATION 3 HOUR RATED FIRE BARRIER & SMOKE BARRIER

## SYMBOLS

-  PATH OF MEANS OF EGRESS
-  EXIT DISCHARGE
-  EXIT SIGN
-  FIRE EXTINGUISHER
-  PULL STATION
-  DETECTOR
-  ALARM/STROBE
-  FIRE ALARM HORN
-  EMERGENCY LIGHT
-  FIRE ALARM CONTROL PANEL
-  FIRE ALARM ANNUNCIATOR PANEL
-  ELECTRICAL PANEL
-  SPRINKLER SHUTOFF VALVE
-  KITCHEN HOOD SUPPRESSION SYSTEM
-  KITCHEN SYSTEM PULL STATION

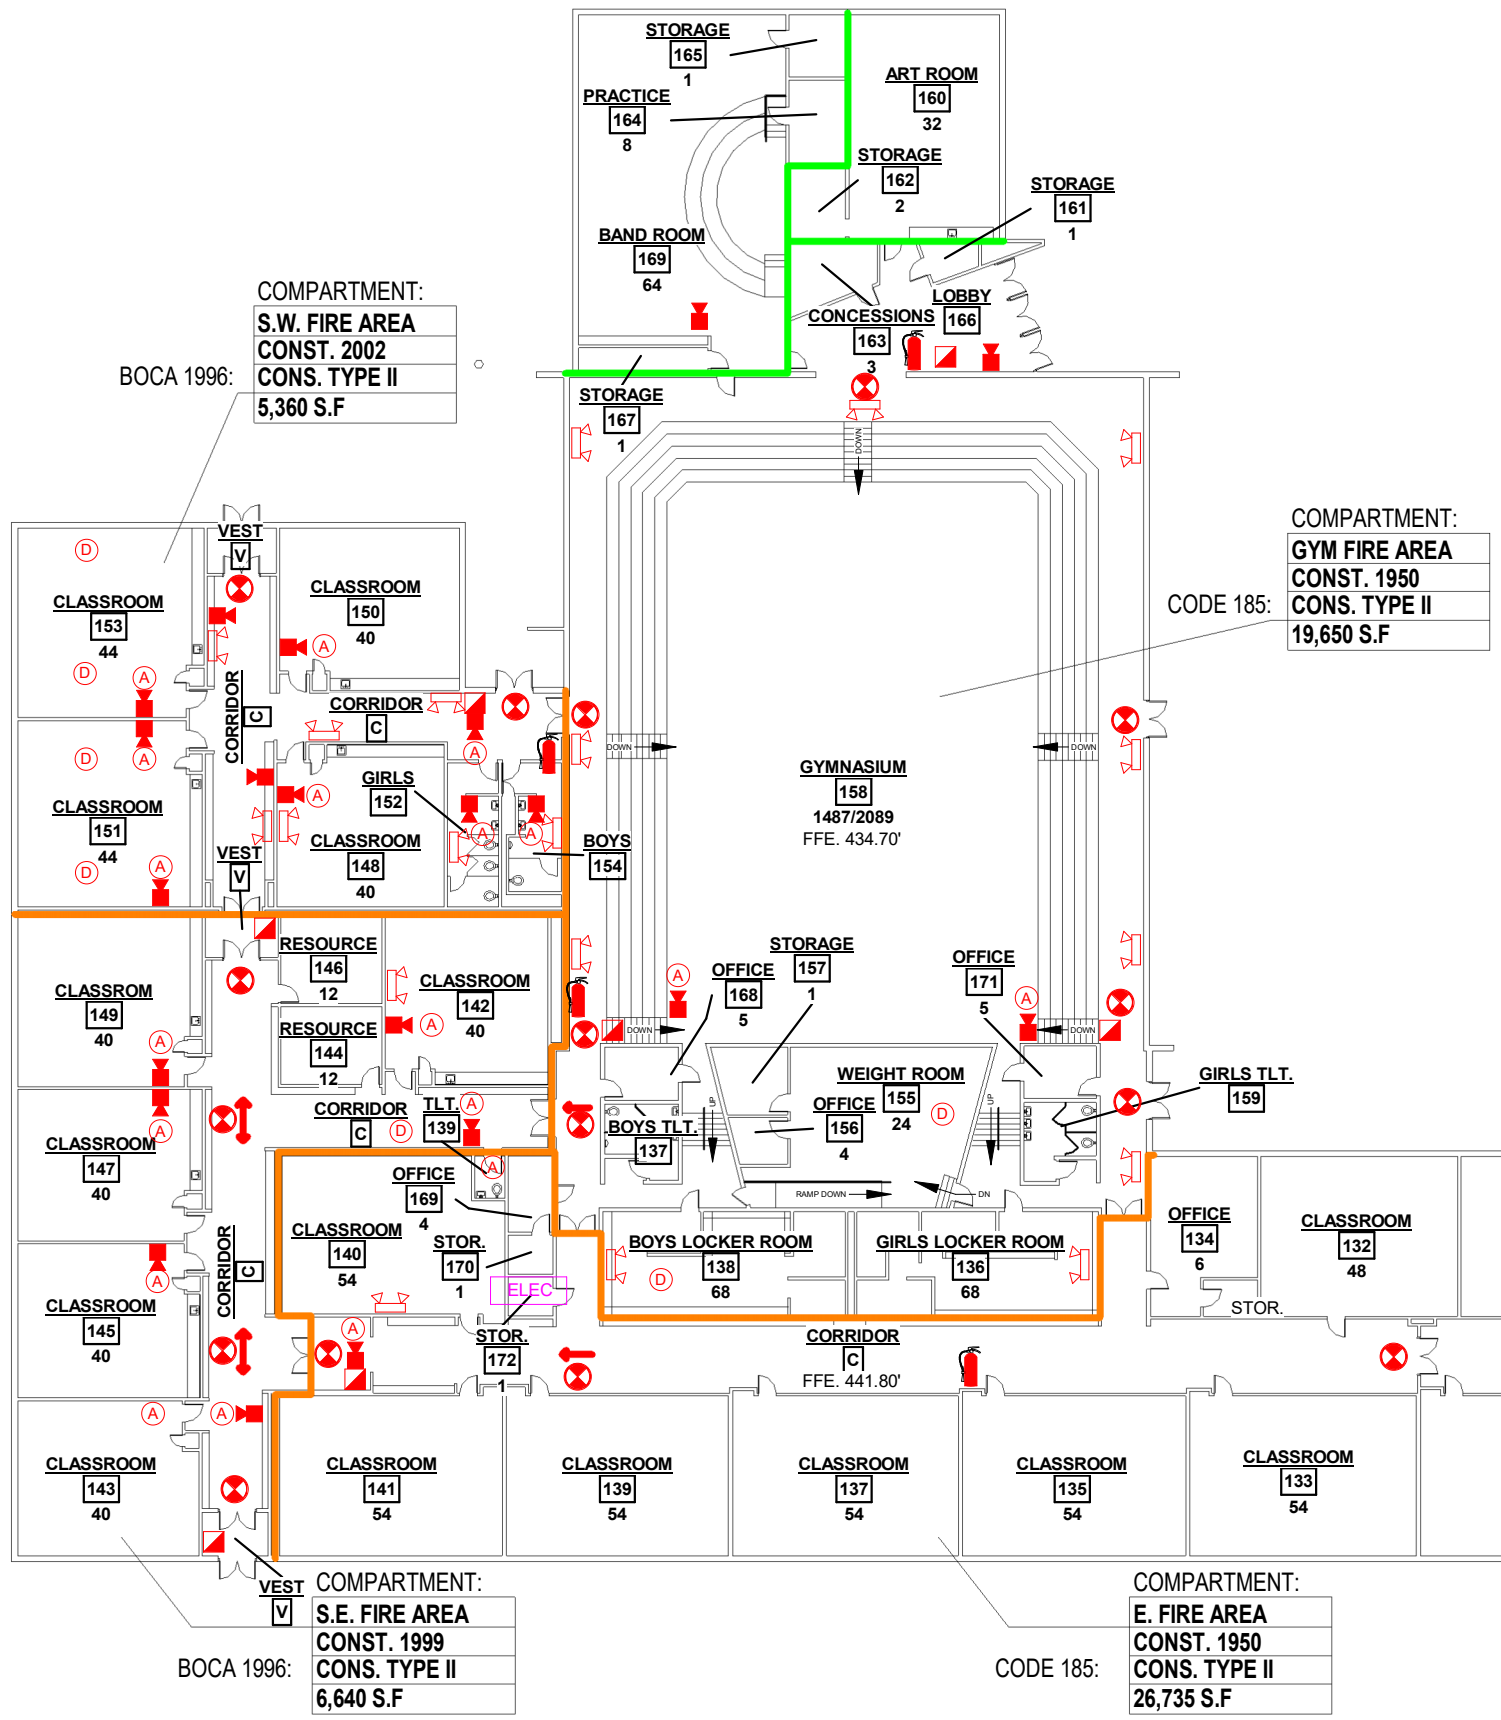

LIFE SAFETY - FLOOR PLAN AREA 1

Project number 19-985  
 Date 12/11/19  
 Drawn by SBS  
 Checked by SBS


LSP - 1.1

Scale As indicated

HERRIN CUSD#4





MIDDLE SCHOOL

ARCHITECTURALS  
 LIMITED  
 817 SOUTH PARK AVENUE  
 HERRIN, ILLINOIS 62946  
 phone: 618-942-6918 fax: 618-942-6919  
 email: general@architecturals.com










 **1** SAFETY REF. FLOOR PLAN - AREA 1  
 1/32" = 1'-0"

# LIFE SAFETY PLAN KEY
















## AREAS


-  SPRINKLED AREA
-  HAZARDOUS AREA
-  AREA PROTECTED BY FIRE DETECTION SYSTEM
-  EXIT STAIR

## BARRIERS

-  1 HOUR FIRE RATED BARRIER
-  2 HOUR FIRE RATED BARRIER
-  3 HOUR RATED FIRE BARRIER
-  NON-RATED SMOKE LIMITING BARRIER (CORRIDOR WALL)
-  NON-RATED SMOKE BARRIER
-  COMBINATION 1/2 HOUR RATED FIRE BARRIER & SMOKE BARRIER
-  COMBINATION 1 HOUR RATED FIRE BARRIER & SMOKE BARRIER
-  COMBINATION 2 HOUR RATED FIRE BARRIER & SMOKE BARRIER
-  COMBINATION 3 HOUR RATED FIRE BARRIER & SMOKE BARRIER


## SYMBOLS

-  PATH OF MEANS OF EGRESS
-  EXIT DISCHARGE
-  EXIT SIGN
-  FIRE EXTINGUISHER
-  PULL STATION
-  DETECTOR
-  ALARM/STROBE
-  FIRE ALARM HORN
-  EMERGENCY LIGHT
-  FIRE ALARM CONTROL PANEL
-  FIRE ALARM ANNUNCIATOR PANEL
-  ELECTRICAL PANEL
-  SPRINKLER SHUTOFF VALVE
-  KITCHEN HOOD SUPPRESSION SYSTEM
-  KITCHEN SYSTEM PULL STATION

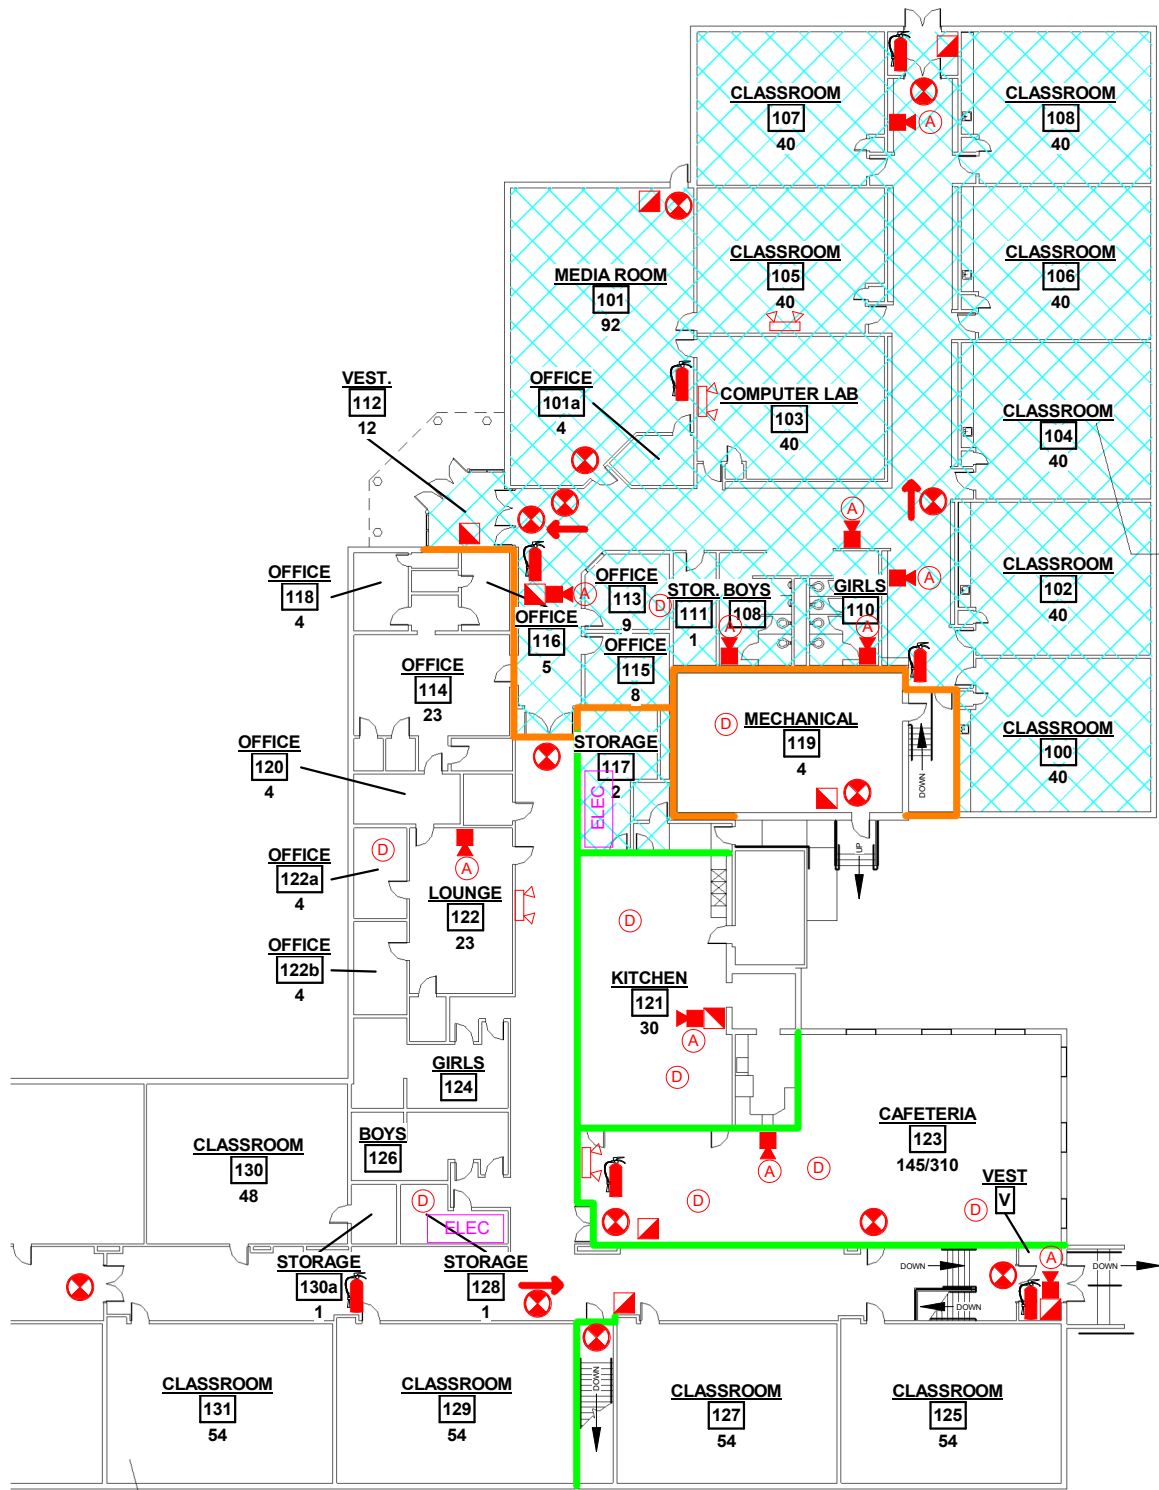

BOCA 1996:  
 COMPARTMENT:  
**E. FIRE AREA**  
**CONST. 1995**  
**CONS. TYPE II**  
**12,164 S.F**

CODE 185:  
 COMPARTMENT:  
**E. FIRE AREA**  
**CONST. 1950**  
**CONS. TYPE II**  
**26,735 S.F**

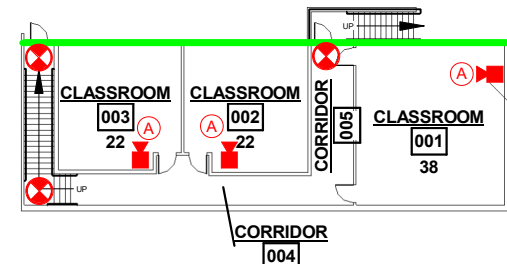

CODE 185:  
 COMPARTMENT:  
**BASEMENT FIRE AREA**  
**CONST. 1950**  
**CONS. TYPE II**  
**2,130 S.F**

① SAFETY REF. FLOOR PLAN -AREA 2  
 1/32" = 1'-0"

LIFE SAFETY - FLOOR PLAN AREA 2

HERRIN CUSD#4

<b>LSP - 1.2</b>		Scale As indicated
Project number	19-985	Author
Date	12/11/19	
Drawn by	Checker	