



Lead Testing in School Drinking Water



Location:

Silver Creek Central School District
Silver Creek, New York 14136

Prepared for:

Silver Creek Central School District
1 Dickinson Street
P.O. Box 270
Silver Creek, New York 14136

LaBella Project No. 2201357

November 2020

Table of Contents

| | Page No. |
|---|----------|
| I. Background | 1 |
| II. Project Description | 1 |
| III. Sampling Procedures and Summary of Results | 1 |
| IV. Response and Recommendations | 3 |
| V. Reporting and Record Keeping | 4 |
| | |
| Appendix A – Laboratory Analytical Reports | |
| Appendix B – Sample Location Drawings | |
| Appendix C – Licenses and Certifications | |



I. BACKGROUND

Under Subpart 67-4 of the New York Codes, Rules and Regulations, Title X, “all school districts and boards of cooperative educational services are required to test potable water for lead contamination, and to develop and implement a lead remediation plan, where applicable.”

The Subpart 67-4 testing requirement was first promulgated under emergency legislation in 2016, and was subsequently signed into permanent law. The regulation requires that testing be performed again in 2020, and every five years thereafter.

Lead is a toxic metal that can be harmful to human health when ingested. Young children, especially those 6 years and younger, are at particular risk for lead exposure because they have frequent hand-to-mouth activity and absorb lead more easily than do adults. Children’s nervous systems are still undergoing development and thus are more susceptible to the effects of toxicants. Therefore, emphasis may be placed on assessment of lead exposure in schools and early childhood education facilities, where concentrations of a vulnerable population are regularly congregated.

Lead can be introduced into potable water by being present in the source water or, more commonly, by interaction of the water with fixtures and plumbing materials containing lead. Common sources of lead in potable water include solder, fluxes, pipes and pipe fittings, fixtures, and sediments. It is possible that different water outlets in a given building could have dissimilar concentrations of lead. It is also possible that, due to temporal fluctuations in water chemistry and physical conditions that may affect the integrity of the plumbing and the water being conveyed, the result obtained from a test at a given time may differ from the result obtained from a test at another time, even if the sampling procedures are identical.

II. PROJECT DESCRIPTION

In accordance with sections 1370-a and 1110, Subpart 67-4 of Title 10 (Health) of the Official Compilation of Codes, Rules and Regulations of the State of New York and US EPA Guidelines LaBella Associates performed sampling of potable water for lead contaminants for the Silver Creek Central School District. Sampling was conducted on April 3, 2020 at the following buildings:

Silver Creek Central School District and Bus Garage
1 Dickinson Street, Silver Creek, New York 14136

III. SAMPLING PROCEDURES AND SUMMARY OF RESULTS

Prior sampling reports were reviewed to develop an understanding of the previously sampled outlets. Although the sampling was conducted at client defined locations, LaBella Associates worked closely with the district to determine and identify potable outlets required for testing. These outlets typically included bottle fillers, kitchen sinks, classroom sinks, bubblers, and other misc. office sinks. Outlets categorically excluded from testing may include laboratory sinks, showers, janitor’s sinks and mechanical room outlets. Typically, excluded outlets will be capable of being isolated by custodial staff, and will be accompanied by warning signs to prohibit consumption.



On the morning of October 24, 2020 LaBella staff conducted sampling of target outlets prior to facilities opening and before any water was used. The water conditions were reported to be representative of normal consumption patterns with building occupancy controlled during stagnation and sampling periods. It should be noted sampling occurred during the novel coronavirus (COVID-19) restrictions in which student/teacher populations and water usage were in somewhat of a state of irregularity.

After review of the state guidance sent out from the New York State Department of Health on October 13, 2020 extending the sampling deadline, and after discussion with LaBella representatives, the district decided to move forward with sampling of appointed fixtures during the month of October.

In accordance with Subpart 67-4 requirements sampling was limited to “first-draw” samples. A volume of the first 250 mL of water from each cold water outlet in the inventory. The samples were then promptly packaged and shipped to a NYS Department of Health Environmental Laboratory Approval Program (ELAP) accredited laboratory. Samples were analyzed utilizing EPA environmental analysis method 200.9 Rev 2.2 for lead in potable water. Results of the laboratory analyses, field testing and the visual on-site inspection were compiled and summarized.

| Area/Building | Total Number of Outlets | Total number of outlets at or below EPA action level (15ppb) | Total number of outlets above EPA action level (15ppb) |
|-------------------|-------------------------|--|--|
| High School | 70 | 54 | 16 |
| Middle School | 43 | 39 | 4 |
| Elementary School | 68 | 53 | 15 |
| Bus Garage | 5 | 5 | 0 |
| Total | 186 | 151 | 35 |

Based on laboratory analyses of the samples collected, the following outlets were determined to exceed the NYS Action level of 15 parts per billion (ppb) or equivalent 15 micrograms per liter ($\mu\text{g/L}$). However, the following table does not include all of the outlets sampled during this inspection; for a full list of outlets sampled see Appendix A immediately following this report.

| Sample Count | Sample Number | Sample Location | Outlet Type | Result ($\mu\text{g/L}$) |
|--------------|---------------|-----------------|-------------------|----------------------------|
| 1 | 1C-7 | H251C | Drinking Fountain | 1,750 |
| 2 | 1F-2 | E211 | Sink | 15.7 |
| 3 | 1F-10 | E205 | Sink | 17.8 |
| 4 | 1F-14 | E201 | Sink | 15.3 |
| 5 | 1F-15 | E200 | Sink | 15.9 |
| 6 | 1F-16 | E219 | Sink | 39.4 |
| 7 | 1F-21 | E217A | Sink | 15.3 |



| Sample Count | Sample Number | Sample Location | Outlet Type | Result (µg/L) |
|--------------|---------------|-----------------|-------------|---------------|
| 8 | 1F-23 | E216A | Sink | 17.1 |
| 9 | 1F-27 | E214A | Sink | 23.3 |
| 10 | 1F-36 | E109 | Sink | 18.4 |
| 11 | 1F-40 | E107 | Sink | 22.9 |
| 12 | 1F-43 | E105B | Sink | 16.4 |
| 13 | 1F-45 | E102B | Sink | 17.2 |
| 14 | 1F-47 | E101 | Sink | 17.7 |
| 15 | 1F-56 | E118 | Sink | 16.3 |
| 16 | 1F-77 | E125 | Sink | 17.2 |
| 17 | 1F-79 | H262 | Sink | 17.8 |
| 18 | 1F-88 | M306 | Sink | 23.7 |
| 19 | 1F-89 | M306 | Sink | 36.7 |
| 20 | 1F-90 | M308 | Sink | 17.5 |
| 21 | 1F-91 | M309 | Sink | 15.3 |
| 22 | 1F-92 | H208 | Sink | 22.4 |
| 23 | 1F-95 | H209 | Sink | 17.2 |
| 24 | 1F-113 | H171 | Sink | 197 |
| 25 | 1F-114 | H171 | Sink | 15.2 |
| 26 | 1F-115 | H172 | Sink | 17.2 |
| 27 | 1F-116 | H172 | Sink | 17.6 |
| 28 | 1F-149 | H219B | Sink | 39.9 |
| 29 | 1F-150 | H219B | Sink | 21.6 |
| 30 | 1F-152 | H219A | Sink | 17 |
| 31 | 1F-168 | H145 | Sink | 24.4 |
| 32 | 1F-170 | H145 | Sink | 24 |
| 33 | 1F-181 | H156 | Sink | 15.9 |
| 34 | 1F-183 | H156 | Sink | 65.7 |
| 35 | 1F-198 | H136 | Sink | 16.7 |

IV. Response and RECOMMENDATIONS

According to section Subpart 67-4.4 “Response” of the regulation, school districts shall prohibit the use of all outlets which exceed the 15 ppb action level. The outlet shall remain out of service until a lead remediation plan is implemented to reduce the level of lead and resampling indicates lead levels that at or below the action level. While the outlet is out of service the district must supply an appropriate amount of potable water for drinking or cooking to building occupants.



LaBella would provide the following recommendations for outlets in exceedance of the action level:

1. Follow up testing – This may include an additional first draw sample, or second draw sample to further investigate and evaluate the condition of the plumbing system upstream of the affected outlets. Sample results may provide some insight on trends, issues with certain portions of the plumbing system or links to specific outlets types and models.
2. Remedial Measures – The school district may elect to commence remediation of affected outlets with or without additional testing. Temporary remediation could include isolating outlets and providing alternate sources of potable drinking or cooking water. Permanent remediation could include replacing outlets, permanently isolating outlets, adding water filtration or renovations to the plumbing system.

V. Reporting and Record Keeping

In accordance with Subpart 67-4 the district shall:

- Report the test results to the local health department as soon as practicable, but no more than 1 business day after the school received the laboratory report; and
- Notify all staff and all persons in parental relation to children or students of the test results, in writing, as soon as practicable but no more than 10 business days after the school received the laboratory report.
- The school shall make available, on the school's website, the results of all lead testing performed and lead remediation plans implemented pursuant to this Subpart, as soon as practicable, but no more than 6 weeks after the school received the laboratory reports.
- As soon as practicable, but no more than 10 business days after the school received the laboratory reports, the school shall report data relating to test results to the Department, local health department, and State Education Department, through the Department's designated statewide electronic reporting system.
- The school shall retain all records of test results, lead remediation plans, determinations that a building is lead-free, and waiver requests, for ten years following the creation of such documentation. Copies of such documentation shall be immediately provided to the Department, local health department, or State Education Department, upon request.

Appendix A

Laboratory Analytical Results



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392580

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 11 rows of metal analysis data for Lead.

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392580

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 22 rows of lead analysis data.

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

| | |
|-----------------|--------|
| Order #: | 392580 |
|-----------------|--------|

Matrix Drinking Water
Received 11/02/20
Reported 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392580-023 | 1C-16 | H001 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/04/20 | JL |

392580-11/06/20 02:52 PM

Reviewed By: **Maggie Yokley**
Analyst

EPA Regulatory Limits

| Parameter | Reg. Limit | Unit |
|-----------|------------|------|
| Lead | 15.0 | µg/L |

State Certifications

| Method | Parameter | New York | Virginia |
|-------------------|-----------|----------------|-----------------|
| EPA 200.9 Rev 2.2 | Lead | ELAP Certified | VELAP Certified |

| State | Certificate Number |
|----------|--------------------|
| New York | ELAP 61370 |
| Virginia | VELAP 10779 |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



SCHNEIDER LABORATORIES GLOBAL, INC.

2512 West Cary Street, Richmond, Virginia 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475
www.slabin.com • info@slabin.com

R 23

392580

V:392\392580

thawks 11/2/2020 9:53:48 AM
UPS 1Z2E2899906931791

Submitting Co. LaBella Associates
State of Collection NY
300 Pearl Street Suite 130
Buffalo NY 14202
Project Name 2020 LIDW Silver Creek
Project Location Silver Creek CSD
Project Number 2201357
Collected By Julia Torres
Special Instructions: EPA 200.9 Rev 2.2 BDX 1

Turn Around Time **
Matrix: Air, Paint, Soil, Wipe, Bulk, Waste Water, Ground Water, Drinking Water, TSP / PM10
Tests/Analytes: Asbestos in Bulk, Metals Total, TCLP, Microbiology, Asbestos in Air, Gravimetric, Miscellaneous, Sub-Contract


Table with columns: Sample #, Date Sampled, Time Sampled, Sample Identification, Wipe Area, Time (Start/Stop), Flow Rate (Start/Stop), Total Air. Includes handwritten note: 'See attached spreadsheet' and '23 samples'.

For Aqueous and Solid samples ensure enough sample is sent for duplicate and spike analysis

1Type: A=Area, B=Blank, P=Personal, E=Excursion 2Beginning/End of Sample Period 3Liters/Minute 4Volume in Liters [time in min x flow in L/min]

Relinquished By: Julia Torres Signature: Julia Torres Date/Time 10/26/20

ALL SHADED FIELDS MUST BE FILLED TO AVOID DELAYS



Labella

Powered by partnership.

300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282
www.labellapp.com

| School | Location | Outlet Type | Time | Manufacturer | Model # | Notes |
|--------------------------------------|----------|-------------|------|--------------|---------|-------------|
| Silver Creek Central School District | | | | | | |
| 10/24/2020 | | | | | | |
| Sample # | Location | Outlet Type | Time | Manufacturer | Model # | Notes |
| 1F-143 | H279B | S | 753 | | | |
| 1F-142 | H279A | S | 755 | | | |
| 1E-2 | H271 | DF | 747 | | | BOTTLE FILL |
| 1F-139 | H270 | S | 737 | | | |
| 1F-140 | H270 | S | 738 | | | |
| 1F-141 | H271A | S | 739 | | | |
| 1F-137 | H270 | S | 740 | | | |
| 1F-138 | H270 | S | 740 | | | |
| 1F-136 | H267 | S | 735 | | | |
| 1S-1 | H265 | S | 732 | | | |
| 1E-1 | H265 | ICE | 730 | | | |
| 1F-148 | H270 | S | 737 | | | |
| 1F-147 | H271A | S | 738 | | | |
| 1F-146 | H248 | S | 745 | | | |
| 1F-145 | H235 | S | 746 | | | |
| 1C-13 | H245 | DF | 747 | | | |
| 1C-12 | H242 | DF | 748 | | | |
| 1C-11 | H232 | DF | 757 | | | |
| 1K-1 | H270 | KETTLE | 742 | | | |
| 1K-2 | H270 | KETTLE | 742 | | | |
| 1F-210 | | S | 745 | | | |



Labelle

Powered by partnership.

300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282
www.labellapc.com

| School | Silver Creek Central School District | | | | | | |
|----------|--------------------------------------|-------------|------|--------------|---------|-------|--|
| Date | 10/24/2020 | | | | | | |
| Sample # | Location | Outlet Type | Time | Manufacturer | Model # | Notes | |
| 1F-184 | H001 | DF | 7:23 | | | | |
| 1C-16 | H001 | S | 7:24 | | | | |



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392581

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 11 rows of lead analysis data for various sample IDs (392581-001 to 392581-011).

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392581

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains multiple rows for Lead analysis across various sample IDs (392581-012 to 392581-022).

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392581

Matrix Drinking Water
Received 11/02/20
Reported 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392581-023 | 1F-42 | E105 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 8.16 | 5.00 | µg/L | 11/06/20 | JL |
| 392581-024 | 1F-43 | E105B | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 16.4 | 5.00 | µg/L | 11/06/20 | JL |

392581-11/06/20 04:56 PM

Reviewed By: **Maggie Yokley**
Analyst

EPA Regulatory Limits

| Parameter | Reg. Limit | Unit |
|-----------|------------|------|
| Lead | 15.0 | µg/L |

State Certifications

| Method | Parameter | New York | Virginia |
|-------------------|-----------|----------------|-----------------|
| EPA 200.9 Rev 2.2 | Lead | ELAP Certified | VELAP Certified |

| State | Certificate Number |
|----------|--------------------|
| New York | ELAP 61370 |
| Virginia | VELAP 10779 |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



SCHNEIDER LABORATORIES GLOBAL, INC.

2512 West Cary Street, Richmond, Virginia 23220-5117
 804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475
 www.slabinc.com • info@slabinc.com

X 24

392581

V:\392\392581

thawks 11/2/2020 9:53:48 AM

UPS 1Z2E2899906931791

| | | | | | |
|----------------------------|------------------------|-----------------------|-----------------------|----------------|--|
| Submitting Co. | LaBella Associates | State of Collection | NY | Cert. Required | <input type="checkbox"/> YES <input type="checkbox"/> NO |
| 300 Pearl Street Suite 130 | | Acct # | | Phone | 716.710.3056 |
| Buffalo NY 14202 | | Email | jtorres@labellapc.com | | |
| Project Name | 2020 LIDW Silver Creek | PO # | | | |
| Project Location | Silver Creek CSD | Special Instructions: | | BOX 2 | |
| Project Number | 2201357 | EPA 200.9 Rev 2.2 | | | |
| Collected By | Julia Torres | | | | |

| Turn Around Time ** | Matrix | Tests/Analytes (Select ALL that Apply) Blank spaces are for additional analytes | | | |
|--|---|---|---|---|--|
| <input type="checkbox"/> 2 Hour * <input type="checkbox"/> Same day * <input type="checkbox"/> 1 business day <input type="checkbox"/> 2 business days <input type="checkbox"/> 3 business days <input checked="" type="checkbox"/> 5 business days <small>* not available for all tests</small> <small>** past 3 PM the TAT will begin next business day</small> <small>Please schedule rush tests in advance</small> | <input type="checkbox"/> Air <input type="checkbox"/> Paint <input type="checkbox"/> Soil <input type="checkbox"/> Wipe <input type="checkbox"/> Bulk <input type="checkbox"/> Waste Water <input type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Drinking Water <input type="checkbox"/> TSP / PM10 <input type="checkbox"/> _____ | Asbestos in Bulk | Metals Total | TCLP | Microbiology |
| | | <input type="checkbox"/> PLM | <input checked="" type="checkbox"/> Lead | <input type="checkbox"/> Lead | <input type="checkbox"/> BACT (MPN/PA) |
| | | <input type="checkbox"/> PLM Qualitative | <input type="checkbox"/> RCRA 8 Metals | <input type="checkbox"/> RCRA 8 Metals | <input type="checkbox"/> Mold Direct Exam |
| | | <input type="checkbox"/> 400 Point Count | <input type="checkbox"/> Chromium VI | <input type="checkbox"/> Full TCLP <small>(w/ organics 10 Day)</small> | <input type="checkbox"/> Allergens |
| | | <input type="checkbox"/> 1000 Point Count | <input type="checkbox"/> Mercury | Sub-Contract | |
| | | <input type="checkbox"/> Gravimetric Prep | <input type="checkbox"/> EPA 200.9 Rev 2.2 | <input type="checkbox"/> TEM Chatfield | |
| | | Asbestos in Air | Gravimetric | Miscellaneous | <input type="checkbox"/> TEM AHERA |
| | | <input type="checkbox"/> PCM | <input type="checkbox"/> Total Dust NIOSH 0500 | <input type="checkbox"/> Silica FTIR (7602) | <input type="checkbox"/> TEM 7402 |
| | | <input type="checkbox"/> PCM-B Rules | <input type="checkbox"/> Resp. Dust NIOSH 0600 | <input type="checkbox"/> _____ | <input type="checkbox"/> Silica XRD (7500) |

| Sample # | Date Sampled | Time Sampled | Sample Identification <small>(Employee, Bldg, Material, Type¹)</small> | Wipe Area | Time ² | | Flow Rate ³ | | Total Air ⁴ |
|----------|--------------|--------------|--|-----------|-------------------|------|------------------------|------|------------------------|
| | | | | | Start | Stop | Start | Stop | |
| | | | See attached spreadsheet | | | | | | |
| | | | 24 samples | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

For Aqueous and Solid samples ensure enough sample is sent for duplicate and spike analysis

¹Type: A=Area, B=Blank, P=Personal, E=Excursion ²Beginning/End of Sample Period ³Liters/Minute ⁴Volume in Liters [time in min x flow in L/min]

Relinquished By: Julia Torres Signature: Julia K Torres Date/Time 10/26/20

! ALL SHADED FIELDS MUST BE FILLED TO AVOID DELAYS !



Powered by partnership.

300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282
www.labellapc.com

| School | Silver Creek Central School District | | | | | | | |
|----------|--------------------------------------|-------------|------|--------------|---------|--------------------------|--|--|
| Date | 10/24/2020 | | | | | | | |
| Sample # | Sample Location / Room # | Outlet Type | Time | Manufacturer | Model # | Notes | | |
| 1F-80 | H265 | HB | 803 | | | Test - used for sports | | |
| 1F-79 | H262 | S | 800 | | | | | |
| 1F-78 | E125 | S | 805 | | | | | |
| 1F-77 | E125 | S | 805 | | | | | |
| 1F-75 | E132 | S | 809 | | | | | |
| 1F-74 | E131 | S | 808 | | | | | |
| 1F-73 | E127B | S | 815 | | | | | |
| 1F-72 | E129B | S | 815 | | | | | |
| 1F-82 | H253B | S | 820 | | | | | |
| 1C-6 | H253 | DF | 819 | | | | | |
| 1F-81 | H251B | S | 821 | | | | | |
| 1C-7 | H251C | DF | 821 | | | | | |
| 1F-31 | E114 | S | 838 | | | SLIGHTLY DISCOLORED | | |
| 1F-32 | E113 | S | 839 | | | | | |
| 1F-33 | E112 | S | 840 | | | | | |
| 1F-34 | E111 | S | 840 | | | | | |
| 1F-35 | E110 | S | 841 | | | | | |
| 1F-36 | E109 | S | 841 | | | | | |
| 1F-37 | E195 | S | 843 | | | | | |
| 1C-20 | E199A | DF | 843 | | | | | |
| 1F-40 | E107 | S | 845 | | | BOTTLE FILL, BUBBLER OFF | | |
| 1F-41 | E105A | S | 847 | | | | | |
| 1F-42 | E105 | S | 848 | | | | | |
| 1F-43 | E105B | S | 848 | | | | | |



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

| | |
|-----------------|--------|
| Order #: | 392582 |
|-----------------|--------|

Matrix Drinking Water
Received 11/02/20
Reported 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392582-001 | 1F-44 | E101C | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 7.15 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-002 | 1F-45 | E102B | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 17.2 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-003 | 1F-46 | E102 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 9.64 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-004 | 1F-47 | E101 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 17.7 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-005 | 1F-48 | E124E | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-006 | 1F-49 | E124 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-007 | 1A-15 | E124D | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-008 | 1F-52 | E120 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 8.28 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-009 | 1F-53 | E120 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-010 | 1A-7 | E120A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-011 | 1F-54 | E119 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 15.0 | 5.00 | µg/L | 11/05/20 | JL |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

| | |
|-----------------|--------|
| Order #: | 392582 |
|-----------------|--------|

Matrix Drinking Water
Received 11/02/20
Reported 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392582-012 | 1F-55 | E119 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-013 | 1A-8 | E119A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-014 | 1F-56 | E118 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 16.3 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-015 | 1F-57 | E118 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 8.38 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-016 | 1A-9 | E118A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-017 | 1C-2 | E199A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-018 | 1F-211 | E124F | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-019 | 1F-1 | E212 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 5.88 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-020 | 1F-2 | E211 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 15.7 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-021 | 1F-3 | E210 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 10.0 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-022 | 1F-4 | E209 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 9.15 | 5.00 | µg/L | 11/05/20 | JL |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392582

Matrix Drinking Water
Received 11/02/20
Reported 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392582-023 | 1F-5 | E208 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 10.9 | 5.00 | µg/L | 11/05/20 | JL |
| 392582-024 | 1F-6 | E207 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 14.0 | 5.00 | µg/L | 11/05/20 | JL |

392582-11/06/20 02:33 PM

Reviewed By: **Maggie Yokley**
Analyst

EPA Regulatory Limits

| Parameter | Reg. Limit | Unit |
|-----------|------------|------|
| Lead | 15.0 | µg/L |

State Certifications

| Method | Parameter | New York | Virginia |
|-------------------|-----------|----------------|-----------------|
| EPA 200.9 Rev 2.2 | Lead | ELAP Certified | VELAP Certified |

| State | Certificate Number |
|----------|--------------------|
| New York | ELAP 61370 |
| Virginia | VELAP 10779 |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



SCHNEIDER LABORATORIES GLOBAL, INC.

2512 West Cary Street, Richmond, Virginia 23220-5117
 804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475
 www.slabinc.com • info@slabinc.com

X 24

392582

V:\392\392582

thawks

11/2/2020 9:53:48 AM

UPS

1Z2E2899906931791

| | | | | | |
|----------------------------|------------------------|--|-----------------------|----------------|--|
| Submitting Co. | LaBella Associates | State of Collection | NY | Cert. Required | <input type="checkbox"/> YES <input type="checkbox"/> NO |
| 300 Pearl Street Suite 130 | | Acct # | | Phone | 716.710.3056 |
| Buffalo NY 14202 | | Email | jtorres@labellapc.com | | |
| Project Name | 2020 LIDW Silver CReek | PO # | | | |
| Project Location | Silver Creek CSD | Special Instructions: EPA 200.9 Rev 2.2 | | | |
| Project Number | 2201357 | Box 3 | | | |
| Collected By | Julia Torres | | | | |

| Turn Around Time ** | Matrix | Tests/Analytes (Select ALL that Apply) Blank spaces are for additional analytes | | | |
|--|---|--|--|--|---|
| <input type="checkbox"/> 2 Hour * <input type="checkbox"/> Same day * <input type="checkbox"/> 1 business day <input type="checkbox"/> 2 business days <input type="checkbox"/> 3 business days <input checked="" type="checkbox"/> 5 business days <small>* not available for all tests ** past 3 PM the TAT will begin next business day Please schedule rush tests in advance</small> | <input type="checkbox"/> Air <input type="checkbox"/> Paint <input type="checkbox"/> Soil <input type="checkbox"/> Wipe <input type="checkbox"/> Bulk <input type="checkbox"/> Waste Water <input type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Drinking Water <input type="checkbox"/> TSP / PM10 <input type="checkbox"/> _____ | Asbestos in Bulk | Metals Total | TCLP | Microbiology |
| | | <input type="checkbox"/> PLM <input type="checkbox"/> PLM Qualitative <input type="checkbox"/> 400 Point Count <input type="checkbox"/> 1000 Point Count <input type="checkbox"/> Gravimetric Prep | <input checked="" type="checkbox"/> Lead <input type="checkbox"/> RCRA 8 Metals <input type="checkbox"/> Chromium VI <input type="checkbox"/> Mercury <input type="checkbox"/> EPA 200.9 Rev 2.2 | <input type="checkbox"/> Lead <input type="checkbox"/> RCRA 8 Metals <input type="checkbox"/> Full TCLP <small>(w/ organics 10 Day)</small> | <input type="checkbox"/> BACT (MPN/PA) <input type="checkbox"/> Mold Direct Exam <input type="checkbox"/> Allergens |
| | | Asbestos in Air | Gravimetric | Miscellaneous | Sub-Contract |
| | | <input type="checkbox"/> PCM <input type="checkbox"/> PCM-B Rules | <input type="checkbox"/> Total Dust NIOSH 0500 <input type="checkbox"/> Resp. Dust NIOSH 0600 | <input type="checkbox"/> Silica FTIR (7602) <input type="checkbox"/> _____ | <input type="checkbox"/> TEM Chatfield <input type="checkbox"/> TEM AHERA <input type="checkbox"/> TEM 7402 <input type="checkbox"/> Silica XRD (7500) |

| Sample # | Date Sampled | Time Sampled | Sample Identification (Employee, Bldg, Material, Type ¹) | Wipe Area | Time ² | | Flow Rate ³ | | Total Air ⁴ |
|----------|--------------|--------------|---|-----------|-------------------|------|------------------------|------|------------------------|
| | | | | | Start | Stop | Start | Stop | |
| | | | See attached spreadsheet | | | | | | |
| | | | 24 samples | | | | | | |

For Aqueous and Solid samples ensure enough sample is sent for duplicate and spike analysis

¹Type: A=Area, B=Blank, P=Personal, E=Excursion ²Beginning/End of Sample Period ³Liters/Minute ⁴Volume in Liters [time in min x flow in L/min]

Relinquished By: Julia Torres Signature: Julia K Torres Date/Time 10/26/20

! ALL SHADED FIELDS MUST BE FILLED TO AVOID DELAYS !



LaBella
Powered by partnership.

300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282
www.labellapc.com

| School | Silver Creek Central School District | | | | | |
|----------|--------------------------------------|-------------|------|--------------|---------|--------------------------|
| Date | 10/24/2020 | | | | | |
| Sample # | Location | Outlet Type | Time | Manufacturer | Model # | Notes |
| 1F-44 | E101C | S | 851 | | | |
| 1F-45 | E102B | S | 851 | | | |
| 1F-46 | E102 | S | 852 | | | |
| 1F-47 | E101 | S | 852 | | | |
| 1F-48 | E124E | S | 829 | | | |
| 1F-49 | E124 | S | 831 | | | |
| 1A-15 | E124D | S | 832 | | | |
| 1F-52 | E120 | S | 855 | | | |
| 1F-53 | E120 | S | 855 | | | |
| 1A-7 | E120A | B | 855 | | | |
| 1F-54 | E119 | S | 856 | | | |
| 1F-55 | E119 | S | 856 | | | |
| 1A-8 | E119A | B | 856 | | | |
| 1F-56 | E118 | S | 858 | | | |
| 1F-57 | E118 | S | 858 | | | |
| 1A-9 | E118A | B | 858 | | | |
| 1C-2 | E199A | DF | 836 | | | BOTTLE FILL, BUBBLER OFF |
| 1F-211 | E124F | S | 832 | | | |
| 1F-1 | E212 | S | 906 | | | |
| 1F-2 | E211 | S | 907 | | | |
| 1F-3 | E210 | S | 908 | | | |
| 1F-4 | E209 | S | 909 | | | |
| 1F-5 | E208 | S | 910 | | | |
| 1F-6 | E207 | S | 912 | | | |



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

| | |
|-----------------|--------|
| Order #: | 392584 |
|-----------------|--------|

Matrix Drinking Water
Received 11/02/20
Reported 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392584-001 | 1F-10 | E205 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 17.8 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-002 | 1F-11 | E204 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 6.53 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-003 | 1F-12 | E203 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 7.91 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-004 | 1F-13 | E202 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 7.78 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-005 | 1F-14 | E201 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 15.3 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-006 | 1F-15 | E200 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 15.9 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-007 | 1F-16 | E219 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 39.4 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-008 | 1F-17 | E219C | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-009 | 1F-18 | E219B | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 9.06 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-010 | 1F-19 | E218A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 9.60 | 5.00 | µg/L | 11/05/20 | JL |
| 392584-011 | 1F-20 | E218A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 6.45 | 5.00 | µg/L | 11/05/20 | JL |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392584

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Rows include sample IDs 392584-012 through 392584-022, all for Lead analysis.

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392584

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with 8 columns: Sample ID, Cust. Sample ID, Location, Method, Result, RL*, Units, Analysis Date, Analyst. Contains two rows of Metals Analysis results for Lead.

392584-11/06/20 02:27 PM

Handwritten signature of Maggie Yokley

Reviewed By: Maggie Yokley
Analyst

EPA Regulatory Limits

Table with 3 columns: Parameter, Reg. Limit, Unit. Row for Lead with Reg. Limit 15.0 and Unit µg/L.

State Certifications

Table with 4 columns: Method, Parameter, New York, Virginia. Row for EPA 200.9 Rev 2.2, Lead, ELAP Certified, VELAP Certified.

Table with 2 columns: State, Certificate Number. Rows for New York (ELAP 61370) and Virginia (VELAP 10779).

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



SCHNEIDER LABORATORIES GLOBAL, INC.

2512 West Cary Street, Richmond, Virginia 23220-5117
 804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475
 www.slabinc.com • info@slabinc.com

X 24
392584
 V:\392\392584
 thawks 11/2/2020 9:53:48 AM
 UPS 1Z2E2899906931791

| | | | |
|--|---|------------------------------------|---|
| Submitting Co. LaBella Associates | | State of Collection NY | Cert. Required <input type="checkbox"/> YES <input type="checkbox"/> NO |
| 300 Pearl Street Suite 130 | | Acct # | Phone 716.710.3056 |
| Buffalo NY 14202 | | Email jtorres@labellapc.com | |
| Project Name 2020 LIDW Silver Creek | PO # | | |
| Project Location Silver Creek CSD | Special Instructions: EPA 200.9 Rev 2.2 Box 4 | | |
| Project Number 2201357 | | | |
| Collected By Julia Torres | | | |

| Turn Around Time ** | Matrix | Tests/Analytes (Select ALL that Apply) Blank spaces are for additional analytes | | | |
|--|---|---|---|---|--|
| <input type="checkbox"/> 2 Hour * <input type="checkbox"/> Same day * <input type="checkbox"/> 1 business day <input type="checkbox"/> 2 business days <input type="checkbox"/> 3 business days <input checked="" type="checkbox"/> 5 business days <small>* not available for all tests ** past 3 PM the TAT will begin next business day Please schedule rush tests in advance</small> | <input type="checkbox"/> Air <input type="checkbox"/> Paint <input type="checkbox"/> Soil <input type="checkbox"/> Wipe <input type="checkbox"/> Bulk <input type="checkbox"/> Waste Water <input type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Drinking Water <input type="checkbox"/> TSP / PM10 <input type="checkbox"/> _____ | Asbestos in Bulk | Metals Total | TCLP | Microbiology |
| | | <input type="checkbox"/> PLM | <input checked="" type="checkbox"/> Lead | <input type="checkbox"/> Lead | <input type="checkbox"/> BACT (MPN/PA) |
| | | <input type="checkbox"/> PLM Qualitative | <input type="checkbox"/> RCRA 8 Metals | <input type="checkbox"/> RCRA 8 Metals | <input type="checkbox"/> Mold Direct Exam |
| | | <input type="checkbox"/> 400 Point Count | <input type="checkbox"/> Chromium VI | <input type="checkbox"/> Full TCLP <small>(w/ organics 10 Day)</small> | <input type="checkbox"/> Allergens |
| | | <input type="checkbox"/> 1000 Point Count | <input type="checkbox"/> Mercury | | Sub-Contract |
| | | <input type="checkbox"/> Gravimetric Prep | <input type="checkbox"/> EPA 200.9 Rev 2.2 | | <input type="checkbox"/> TEM Chatfield |
| | | Asbestos in Air | Gravimetric | Miscellaneous | <input type="checkbox"/> TEM AHERA |
| | | <input type="checkbox"/> PCM | <input type="checkbox"/> Total Dust NIOSH 0500 | <input type="checkbox"/> Silica FTIR (7602) | <input type="checkbox"/> TEM 7402 |
| | | <input type="checkbox"/> PCM-B Rules | <input type="checkbox"/> Resp. Dust NIOSH 0600 | <input type="checkbox"/> _____ | <input type="checkbox"/> Silica XRD (7500) |

| Sample # | Date Sampled | Time Sampled | Sample Identification <small>(Employee, Bldg, Material, Type¹)</small> | Wipe Area | Time ² | | Flow Rate ³ | | Total Air ⁴ |
|----------|--------------|--------------|--|-----------|-------------------|------|------------------------|------|------------------------|
| | | | | | Start | Stop | Start | Stop | |
| | | | See attached spreadsheet | | | | | | |
| | | | 24 samples | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

For Aqueous and Solid samples ensure enough sample is sent for duplicate and spike analysis

¹Type: A=Area, B=Blank, P=Personal, E=Excursion ²Beginning/End of Sample Period ³Liters/Minute ⁴Volume in Liters [time in min x flow in L/min]

Relinquished By: Julia Torres Signature: Julia K. Torres Date/Time: 10/26/20

| ALL SHADED FIELDS MUST BE FILLED TO AVOID DELAYS |



Powered by partnership.

300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282
www.labellapc.com

| School | Creek Central School District | | Date | 10/24/2020 | Sample # | Location | Outlet Type | Time | Manufacturer | Model # | Notes |
|--------|-------------------------------|---|------|------------|----------|----------|-------------|------|--------------|---------|-------|
| 1F-10 | E205 | S | | | | | | 915 | | | |
| 1F-11 | E204 | S | | | | | | 916 | | | |
| 1F-12 | E203 | S | | | | | | 921 | | | |
| 1F-13 | E202 | S | | | | | | 922 | | | |
| 1F-14 | E201 | S | | | | | | 923 | | | |
| 1F-15 | E200 | S | | | | | | 924 | | | |
| 1F-16 | E219 | S | | | | | | 929 | | | |
| 1F-17 | E219C | S | | | | | | 930 | | | |
| 1F-18 | E219B | S | | | | | | 931 | | | |
| 1F-19 | E218A | S | | | | | | 932 | | | |
| 1F-20 | E218A | S | | | | | | 933 | | | |
| 1A-1 | E218 | B | | | | | | 933 | | | |
| 1F-21 | E217A | S | | | | | | 934 | | | |
| 1F-22 | E217 | S | | | | | | 935 | | | |
| 1A-2 | E217 | B | | | | | | 936 | | | |
| 1F-23 | E216A | S | | | | | | 937 | | | |
| 1F-24 | E216 | S | | | | | | 937 | | | |
| 1A-3 | E216 | B | | | | | | 938 | | | |
| 1F-25 | E215A | S | | | | | | 939 | | | |
| 1F-26 | E215 | S | | | | | | 939 | | | |
| 1A-4 | E215 | B | | | | | | 940 | | | |
| 1F-27 | E214A | S | | | | | | 941 | | | |
| 1F-28 | E214 | S | | | | | | 941 | | | |
| 1F-29 | E213A | S | | | | | | 944 | | | |



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392585

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with 8 columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 11 rows of data for Lead analysis across various sample IDs (392585-001 to 392585-011).

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392585

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 22 rows of data for Lead analysis across various sample IDs (392585-012 to 392585-022).

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392585

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with 8 columns: Sample ID, Cust. Sample ID, Location, Method, Result, RL*, Units, Analysis Date, Analyst. Contains two rows of Metals Analysis results for Lead.

392585-11/06/20 02:58 PM

Handwritten signature of Maggie Yokley

Reviewed By: Maggie Yokley
Analyst

EPA Regulatory Limits

Table with 3 columns: Parameter, Reg. Limit, Unit. Row for Lead with Reg. Limit 15.0 and Unit µg/L.

State Certifications

Table with 4 columns: Method, Parameter, New York, Virginia. Row for EPA 200.9 Rev 2.2, Lead, ELAP Certified, VELAP Certified.

Table with 2 columns: State, Certificate Number. Rows for New York (ELAP 61370) and Virginia (VELAP 10779).

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



SCHNEIDER LABORATORIES GLOBAL, INC.

2512 West Cary Street, Richmond, Virginia 23220-5117
 804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475
 www.slabinc.com • info@slabinc.com

X 24

392585

V:\392\392585

thawks

11/2/2020 9:53:48 AM

UPS

1Z2E2899906931791

| | | | | | |
|----------------------------|------------------------|--|-----------------------|----------------|--|
| Submitting Co. | LaBella Associates | State of Collection | NY | Cert. Required | <input type="checkbox"/> YES <input type="checkbox"/> NO |
| 300 Pearl Street Suite 130 | | Acct # | | Phone | 716.710.3056 |
| Buffalo NY 14202 | | Email | jtorres@labellapc.com | | |
| Project Name | 2020 LIDW Silver CReek | PO # | | | |
| Project Location | Silver Creek CSD | Special Instructions: EPA 200.9 Rev 2.2 | | | |
| Project Number | 2201357 | <i>Box 5</i> | | | |
| Collected By | Julia Torres | | | | |

| Turn Around Time ** | Matrix | Tests/Analytes (Select ALL that Apply) Blank spaces are for additional analytes | | | |
|--|---|--|--|--|---|
| <input type="checkbox"/> 2 Hour * <input type="checkbox"/> Same day * <input type="checkbox"/> 1 business day <input type="checkbox"/> 2 business days <input type="checkbox"/> 3 business days <input checked="" type="checkbox"/> 5 business days <small>* not available for all tests ** past 3 PM the TAT will begin next business day Please schedule rush tests in advance</small> | <input type="checkbox"/> Air <input type="checkbox"/> Paint <input type="checkbox"/> Soil <input type="checkbox"/> Wipe <input type="checkbox"/> Bulk <input type="checkbox"/> Waste Water <input type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Drinking Water <input type="checkbox"/> TSP / PM10 <input type="checkbox"/> _____ | Asbestos in Bulk | Metals Total | TCLP | Microbiology |
| | | <input type="checkbox"/> PLM <input type="checkbox"/> PLM Qualitative <input type="checkbox"/> 400 Point Count <input type="checkbox"/> 1000 Point Count <input type="checkbox"/> Gravimetric Prep | <input checked="" type="checkbox"/> Lead <input type="checkbox"/> RCRA 8 Metals <input type="checkbox"/> Chromium VI <input type="checkbox"/> Mercury <input type="checkbox"/> EPA 200.9 Rev.2.2 | <input type="checkbox"/> Lead <input type="checkbox"/> RCRA 8 Metals <input type="checkbox"/> Full TCLP <small>(w/ organics 10 Day)</small> | <input type="checkbox"/> BACT (MPN/PA) <input type="checkbox"/> Mold Direct Exam <input type="checkbox"/> Allergens |
| | | Asbestos in Air | Gravimetric | Miscellaneous | Sub-Contract |
| | | <input type="checkbox"/> PCM <input type="checkbox"/> PCM-B Rules | <input type="checkbox"/> Total Dust NIOSH 0500 <input type="checkbox"/> Resp. Dust NIOSH 0600 | <input type="checkbox"/> Silica FTIR (7602) <input type="checkbox"/> _____ | <input type="checkbox"/> TEM Chatfield <input type="checkbox"/> TEM AHERA <input type="checkbox"/> TEM 7402 <input type="checkbox"/> Silica XRD (7500) |

| Sample # | Date Sampled | Time Sampled | Sample Identification (Employee, Bldg, Material, Type ¹) | Wipe Area | Time ² | | Flow Rate ³ | | Total Air ⁴ |
|----------|--------------|--------------|---|-----------|-------------------|------|------------------------|------|------------------------|
| | | | | | Start | Stop | Start | Stop | |
| | | | <i>See attached spreadsheet</i> | | | | | | |
| | | | <i>24 samples</i> | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

For Aqueous and Solid samples ensure enough sample is sent for duplicate and spike analysis

¹Type: A=Area, B=Blank, P=Personal, E=Excursion ²Beginning/End of Sample Period ³Liters/Minute ⁴Volume in Liters [time in min x flow in L/min]

Relinquished By: Julia Torres Signature: Julia Torres Date/Time: 10/26/20

! ALL SHADED FIELDS MUST BE FILLED TO AVOID DELAYS !



Powered by partnership.

300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282
www.labellapp.com

| School | Creek Central School District | | | | | | |
|----------|-------------------------------|-------------|------|--------------|---------|-------|--|
| Date | 10/24/2020 | | | | | | |
| Sample # | Location | Outlet Type | Time | Manufacturer | Model # | Notes | |
| 1F-59 | M415 | S | 1015 | | | | |
| 1A-10 | M415 | B | 1016 | | | | |
| 1F-60 | M417 | S | 1010 | | | | |
| 1F-61 | M445 | S | 955 | | | | |
| 1F-62 | M427 | S | 959 | | | | |
| 1F-64 | M430 | S | 1005 | | | | |
| 1F-65 | M429 | S | 1006 | | | | |
| 1F-66 | M432 | S | 1017 | | | | |
| 1A-12 | M432 | B | 1018 | | | | |
| 1F-67 | M433 | S | 1019 | | | | |
| 1A-13 | M433 | B | 1020 | | | | |
| 1F-68 | M433 | S | 1021 | | | | |
| 1F-69 | M434 | S | 1023 | | | | |
| 1F-70 | M434 | S | 1024 | | | | |
| 1A-14 | M434 | B | 1025 | | | | |
| 1F-196 | M404 | S | 1043 | | | | |
| 1A-19 | M404 | B | 1042 | | | | |
| 1F-195 | M405 | S | 1039 | | | | |
| 1A-18 | M405 | B | 1040 | | | | |
| 1F-194 | M406 | S | 1037 | | | | |
| 1A-17 | M406 | B | 1036 | | | | |
| 1F-193 | M407 | S | 1034 | | | | |
| 1A-16 | M407 | B | 1035 | | | | |
| 1F-197 | M410 | S | 1028 | | | | |



Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

| | |
|-----------------|--------|
| Order #: | 392586 |
|-----------------|--------|

Matrix Drinking Water
Received 11/02/20
Reported 11/09/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392586-001 | 1F-87 | M305 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-002 | 1F-86 | M304 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-003 | 1F-85 | M303 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-004 | 1F-84 | M300 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-005 | 1F-102 | M397 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-006 | 1F-101 | M398 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-007 | 1F-95 | H209 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 17.2 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-008 | 1F-96 | H209 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 13.8 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-009 | 1F-97 | H209 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 14.3 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-010 | 1F-92 | H208 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 22.4 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-011 | 1F-93 | H208 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 13.0 | 5.00 | µg/L | 11/07/20 | HI |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

| | |
|-----------------|--------|
| Order #: | 392586 |
|-----------------|--------|

Matrix Drinking Water
Received 11/02/20
Reported 11/09/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392586-012 | 1F-94 | H208 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 13.7 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-013 | 1F-91 | M309 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 15.3 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-014 | 1F-90 | M308 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 17.5 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-015 | 1F-89 | M306 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 36.7 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-016 | 1F-88 | M306 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 23.7 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-017 | 1C-21 | M306 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-018 | 1C-22 | M306 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-019 | 1F-99 | M310 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 10.6 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-020 | 1F-30 | E213A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 10.4 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-021 | 1A-5 | E214 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | 5.41 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-022 | 1F-185 | BG111 | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392586

Matrix Drinking Water
Received 11/02/20
Reported 11/09/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392586-023 | 1F-186 | BG103A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |
| 392586-024 | 1F-187 | BG103A | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/07/20 | HI |

392586-11/09/20 03:53 PM

Reviewed By: **Jennifer Lee**
Manager

EPA Regulatory Limits

| Parameter | Reg. Limit | Unit |
|-----------|------------|------|
| Lead | 15.0 | µg/L |

State Certifications

| Method | Parameter | New York | Virginia |
|-------------------|-----------|----------------|-----------------|
| EPA 200.9 Rev 2.2 | Lead | ELAP Certified | VELAP Certified |

| State | Certificate Number |
|----------|--------------------|
| New York | ELAP 61370 |
| Virginia | VELAP 10779 |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



SCHNEIDER LABORATORIES GLOBAL, INC.

2512 West Cary Street, Richmond, Virginia 23220-5117
 804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475
 www.slabinc.com • info@slabinc.com

X 24

392586

V:\392\392586

thawks

11/2/2020 9:53:48 AM

UPS

1Z2E2899906931791

| | | | | | |
|----------------------------|------------------------|--|-----------------------|----------------|--|
| Submitting Co. | LaBella Associates | State of Collection | NY | Cert. Required | <input type="checkbox"/> YES <input type="checkbox"/> NO |
| 300 Pearl Street Suite 130 | | Acct # | | Phone | 716.710.3056 |
| Buffalo NY 14202 | | Email | jtorres@labellapc.com | | |
| Project Name | 2020 LIDW Silver CReek | PO # | | | |
| Project Location | Silver Creek CSD | Special Instructions: EPA 200.9 Rev 2.2 | | | |
| Project Number | 2201357 | | | | |
| Collected By | Julia Torres | | | | |

Box 6

| Turn Around Time ** | Matrix | Tests/Analytes (Select ALL that Apply) Blank spaces are for additional analytes | | | |
|---|---|---|--|---|--|
| | | Asbestos in Bulk | Metals Total | TCLP | Microbiology |
| <input type="checkbox"/> 2 Hour * | <input type="checkbox"/> Air | <input type="checkbox"/> PLM | <input checked="" type="checkbox"/> Lead | <input type="checkbox"/> Lead | <input type="checkbox"/> BACT (MPN/PA) |
| <input type="checkbox"/> Same day * | <input type="checkbox"/> Paint | <input type="checkbox"/> PLM Qualitative | <input type="checkbox"/> RCRA 8 Metals | <input type="checkbox"/> RCRA 8 Metals | <input type="checkbox"/> Mold Direct Exam |
| <input type="checkbox"/> 1 business day | <input type="checkbox"/> Soil | <input type="checkbox"/> 400 Point Count | <input type="checkbox"/> Chromium VI | <input type="checkbox"/> Full TCLP | <input type="checkbox"/> Allergens |
| <input type="checkbox"/> 2 business days | <input type="checkbox"/> Wipe | <input type="checkbox"/> 1000 Point Count | <input type="checkbox"/> Mercury | (w/ organics 10 Day) | |
| <input type="checkbox"/> 3 business days | <input type="checkbox"/> Bulk | <input type="checkbox"/> Gravimetric Prep | <input type="checkbox"/> EPA 200.9 Rev 2.2 | | |
| <input checked="" type="checkbox"/> 5 business days | <input type="checkbox"/> Waste Water | | | | |
| * not available for all tests | <input type="checkbox"/> Ground Water | Asbestos in Air | Gravimetric | Miscellaneous | Sub-Contract |
| ** past 3 PM the TAT will begin next business day | <input type="checkbox"/> Drinking Water | <input type="checkbox"/> PCM | <input type="checkbox"/> Total Dust NIOSH 0500 | <input type="checkbox"/> Silica FTIR (7602) | <input type="checkbox"/> TEM Chatfield |
| Please schedule rush tests in advance | <input type="checkbox"/> TSP / PM10 | <input type="checkbox"/> PCM-B Rules | <input type="checkbox"/> Resp. Dust NIOSH 0600 | <input type="checkbox"/> | <input type="checkbox"/> TEM AHERA |
| | <input type="checkbox"/> | | | | <input type="checkbox"/> TEM 7402 |
| | | | | | <input type="checkbox"/> Silica XRD (7500) |

| Sample # | Date Sampled | Time Sampled | Sample Identification (Employee, Bldg, Material, Type ¹) | Wipe Area | Time ² | | Flow Rate ³ | | Total Air ⁴ |
|----------|--------------|--------------|---|-----------|-------------------|------|------------------------|------|------------------------|
| | | | | | Start | Stop | Start | Stop | |
| | | | See attached spreadsheet | | | | | | |
| | | | 24 Samples | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

For Aqueous and Solid samples ensure enough sample is sent for duplicate and spike analysis

¹Type: A=Area, B=Blank, P=Personal, E=Excursion ²Beginning/End of Sample Period ³Liters/Minute ⁴Volume in Liters [time in min x flow in L/min]

Relinquished By: Julia Torres Signature: Julia Torres Date/Time 10/26/20

! ALL SHADED FIELDS MUST BE FILLED TO AVOID DELAYS !



Powered by partnership.

300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282
www.labellapc.com

| School | Creek Central School District | Date | 10/24/2020 | Sample # | Location | Outlet Type | Time | Manufacturer | Model # | Notes |
|--------|-------------------------------|------|------------|----------|----------|-------------|------|--------------|------------|-------|
| 1F-87 | M305 | S | 1108 | | | | | | | |
| 1F-86 | M304 | S | 1109 | | | | | | | |
| 1F-85 | M303 | S | 1110 | | | | | | | |
| 1F-84 | M300 | S | 1052 | | | | | | | |
| 1F-102 | M397 | S | 1056 | | | | | | | |
| 1F-101 | M398 | S | 1057 | | | | | | | |
| 1F-95 | H209 | S | 1114 | | | | | | | |
| 1F-96 | H209 | S | 1115 | | | | | | | |
| 1F-97 | H209 | S | 1116 | | | | | | | |
| 1F-92 | H208 | S | 1111 | | | | | | | |
| 1F-93 | H208 | S | 1112 | | | | | | | |
| 1F-94 | H208 | S | 1113 | | | | | | | |
| 1F-91 | M309 | S | 1058 | | | | | | | |
| 1F-90 | M308 | S | 1059 | | | | | | | |
| 1F-89 | M306 | S | 1101 | | | | | | | |
| 1F-88 | M306 | S | 1102 | | | | | | | |
| 1C-21 | M306 | DF | 1103 | | | | | | | |
| 1C-22 | M306 | DF | 1104 | ELKAY | | | | | EZFSTL8 1E | |
| 1F-99 | M310 | S | 1053 | | | | | | | |
| 1F-30 | E213A | S | 945 | | | | | | | |
| 1A-5 | E214 | B | 942 | | | | | | | |
| 1F-185 | BG111 | S | 1315 | | | | | | | |
| 1F-186 | BG103A | S | 1320 | | | | | | | |
| 1F-187 | BG103A | S | 1321 | | | | | | | |



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392583

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 11 rows of lead analysis data for various sample IDs (392583-001 to 392583-011).

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392583

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 22 rows of analysis data for Lead, including sample IDs 392583-012 through 392583-022.

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392583

Matrix Drinking Water
Received 11/02/20
Reported 11/06/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|------------------------|-----------------|-------------------|--------|------|-------|---------------|---------|
| Parameter | | Method | | | | | |
| 392583-023 | 1F-189 | BG103B | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/06/20 | JL |
| 392583-024 | 1F-190 | BG103B | | | | | |
| Metals Analysis | | | | | | | |
| Lead | | EPA 200.9 Rev 2.2 | <5.00 | 5.00 | µg/L | 11/06/20 | JL |

392583-11/06/20 04:54 PM

Reviewed By: **Maggie Yokley**
Analyst

EPA Regulatory Limits

| Parameter | Reg. Limit | Unit |
|-----------|------------|------|
| Lead | 15.0 | µg/L |

State Certifications

| Method | Parameter | New York | Virginia |
|-------------------|-----------|----------------|-----------------|
| EPA 200.9 Rev 2.2 | Lead | ELAP Certified | VELAP Certified |

| State | Certificate Number |
|----------|--------------------|
| New York | ELAP 61370 |
| Virginia | VELAP 10779 |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



SCHNEIDER LABORATORIES GLOBAL, INC.

2512 West Cary Street, Richmond, Virginia 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475
www.slabin.com • info@slabin.com

392583

V:3921392583

thawks 11/2/2020 9:53:48 AM
UPS 1Z2E2899906931791

| | | | | | |
|----------------------------|------------------------|--|-----------------------|----------------|--|
| Submitting Co. | LaBella Associates | State of Collection | NY | Cert. Required | <input type="checkbox"/> YES <input type="checkbox"/> NO |
| 300 Pearl Street Suite 130 | | Acct # | | Phone | 716.710.3056 |
| Buffalo NY 14202 | | Email | jtorres@labellapc.com | | |
| Project Name | 2020 LIDW Silver CRook | | PO # | | |
| Project Location | Silver Creek CSD | Special Instructions: EPA 200.9 Rev 2.2 | | | |
| Project Number | 2201357 | | | | |
| Collected By | Julia Torres | | | | |

Box 7

| Turn Around Time ** | Matrix | Tests/Analytes (Select ALL that Apply) Blank spaces are for additional analytes | | | |
|--|---|---|---|---|--|
| <input type="checkbox"/> 2 Hour * <input type="checkbox"/> Same day * <input type="checkbox"/> 1 business day <input type="checkbox"/> 2 business days <input type="checkbox"/> 3 business days <input checked="" type="checkbox"/> 5 business days <small>* not available for all tests</small> <small>** past 3 PM the TAT will begin next business day</small> <small>Please schedule rush tests in advance</small> | <input type="checkbox"/> Air <input type="checkbox"/> Paint <input type="checkbox"/> Soil <input type="checkbox"/> Wipe <input type="checkbox"/> Bulk <input type="checkbox"/> Waste Water <input type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Drinking Water <input type="checkbox"/> TSP / PM10 <input type="checkbox"/> _____ | Asbestos in Bulk | Metals Total | TCLP | Microbiology |
| | | <input type="checkbox"/> PLM | <input checked="" type="checkbox"/> Lead | <input type="checkbox"/> Lead | <input type="checkbox"/> BACT (MPN/PA) |
| | | <input type="checkbox"/> PLM Qualitative | <input type="checkbox"/> RCRA 8 Metals | <input type="checkbox"/> RCRA 8 Metals | <input type="checkbox"/> Mold Direct Exam |
| | | <input type="checkbox"/> 400 Point Count | <input type="checkbox"/> Chromium VI | <input type="checkbox"/> Full TCLP <small>(w/ organics 10 Day)</small> | <input type="checkbox"/> Allergens |
| | | <input type="checkbox"/> 1000 Point Count | <input type="checkbox"/> Mercury | | Sub-Contract |
| | | <input type="checkbox"/> Gravimetric Prep | <input type="checkbox"/> EPA 200.9 Rev 2.2 | | <input type="checkbox"/> TEM Chatfield |
| | | Asbestos in Air | Gravimetric | Miscellaneous | <input type="checkbox"/> TEM AHERA |
| | | <input type="checkbox"/> PCM | <input type="checkbox"/> Total Dust NIOSH 0500 | <input type="checkbox"/> Silica FTIR (7602) | <input type="checkbox"/> TEM 7402 |
| | | <input type="checkbox"/> PCM-B Rules | <input type="checkbox"/> Resp. Dust NIOSH 0600 | <input type="checkbox"/> _____ | <input type="checkbox"/> Silica XRD (7500) |

| Sample # | Date Sampled | Time Sampled | Sample Identification (Employee, Bldg, Material, Type ¹) | Wipe Area | Time ² | | Flow Rate ³ | | Total Air ⁴ |
|--------------------------|--------------|--------------|---|-----------|-------------------|------|------------------------|------|------------------------|
| | | | | | Start | Stop | Start | Stop | |
| See attached spreadsheet | | | | | | | | | |
| 24 samples | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

For Aqueous and Solid samples ensure enough sample is sent for duplicate and spike analysis

¹Type: A=Area, B=Blank, P=Personal, E=Excursion ²Beginning/End of Sample Period ³Liters/Minute ⁴Volume in Liters [time in min x flow in L/min]

Relinquished By: Julia Torres Signature: Julia K. Jones Date/Time: 10/26/20

! ALL SHADED FIELDS MUST BE FILLED TO AVOID DELAYS !



Labella

Powered by partnership.

300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282

www.labellappc.com

| School | Silver Creek Central School District | | | | | | | |
|----------|--------------------------------------|-------------|------|--------------|---------|-------|--|----------------|
| Date | | | | | | | | |
| Sample # | Location | Outlet Type | Time | Manufacturer | Model # | Notes | | |
| 1C-15 | H146 | DF | 1152 | ELKAY | LZF8_1Z | | | |
| 1F-198 | H136 | S | 1159 | | | | | |
| 1F-166 | H142 | S | 1202 | | | | | |
| 1F-167 | H142 | S | 1203 | | | | | |
| 1F-168 | H145 | S | 1206 | | | | | |
| 1F-169 | H145 | S | 1207 | | | | | |
| 1F-170 | H145 | S | 1208 | | | | | |
| 1F-171 | H141 | S | 1201 | | | | | |
| 1F-178 | H155 | S | 1156 | | | | | |
| 1F-179 | H155 | S | 1156 | | | | | |
| 1F-180 | H155 | S | 1157 | | | | | |
| 1F-181 | H156 | S | 1153 | | | | | |
| 1F-182 | H156 | S | 1153 | | | | | |
| 1F-183 | H156 | S | 1154 | | | | | DISCOLORED |
| 1F-113 | H171 | S | 1147 | | | | | SCREEN CLOGGED |
| 1F-114 | H171 | S | 1135 | | | | | |
| 1F-115 | H172 | S | 1132 | | | | | |
| 1F-116 | H172 | S | 1133 | | | | | |
| 1F-117 | H172 | S | 1134 | | | | | |
| 1C-9 | H174 | DF | 1130 | ELKAY | LZF8_1C | | | |
| 1F-129 | H177B | S | 1125 | | | | | |
| 1F-130 | H175C | S | 1123 | | | | | |
| 1F-189 | BG103B | S | 1323 | | | | | |
| 1F-190 | BG103B | S | 1324 | | | | | |



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392587

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/03/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 11 rows of lead analysis data for various sample IDs (392587-001 to 392587-011).

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392587

Matrix: Drinking Water
Received: 11/02/20
Reported: 11/03/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

Table with columns: Sample ID, Cust. Sample ID, Location, Parameter, Method, Result, RL*, Units, Analysis Date, Analyst. Contains 12 rows of lead analysis data for various sample IDs (392587-012 to 392587-019).

392587-11/03/20 05:37 PM

Handwritten signature of Maggie Yokley

Reviewed By: Maggie Yokley
Analyst

EPA Regulatory Limits

Table with columns: Parameter, Reg. Limit, Unit. Row: Lead, 15.0, µg/L

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: Labella Associates (1126)
Address: 300 State Street
Rochester, NY 14614-1098

Order #: 392587

Matrix Drinking Water
Received 11/02/20
Reported 11/03/20

Attn:
Project: 2020 LIDW Silver Creek
Location: Silver Creek CSD
Number: 2201357

PO Number:

| Sample ID | Cust. Sample ID | Location | Result | RL* | Units | Analysis Date | Analyst |
|-----------|-----------------|----------|--------|-----|-------|---------------|---------|
| Parameter | | Method | | | | | |

State Certifications

| Method | Parameter | New York | Virginia |
|-------------------|-----------|----------------|-----------------|
| EPA 200.9 Rev 2.2 | Lead | ELAP Certified | VELAP Certified |

| State | Certificate Number |
|----------|--------------------|
| New York | ELAP 61370 |
| Virginia | VELAP 10779 |

All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and *Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. Solid PPM = mg/kg | PPB = µg/kg and Water PPM = mg/L | PPB = µg/L. The test results reported relate only to the samples submitted.



SCHNEIDER LABORATORIES GLOBAL, INC.

2512 West Cary Street, Richmond, Virginia 23220-5117
 804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475
 www.slabinc.com • info@slabinc.com

X 19

392587

V:\392\392587

thawks 11/2/2020 9:53:48 AM
 UPS 1Z2E2899906931791

| | | | | | |
|----------------------------|------------------------|--|-----------------------|----------------|--|
| Submitting Co. | LaBella Associates | State of Collection | NY | Cert. Required | <input type="checkbox"/> YES <input type="checkbox"/> NO |
| 300 Pearl Street Suite 130 | | Acct # | | Phone | 716.710.3056 |
| Buffalo NY 14202 | | Email | jtorres@labellapc.com | | |
| Project Name | 2020 LIDW Silver CReek | PO # | | | |
| Project Location | Silver Creek CSD | Special Instructions: EPA 200.9 Rev 2.2 | | | |
| Project Number | 2201357 | BOX B | | | |
| Collected By | Julia Torres | | | | |

| Turn Around Time ** | Matrix | Tests/Analytes (Select ALL that Apply) Blank spaces are for additional analytes | | | |
|---|---|--|--|---|---|
| <input type="checkbox"/> 2 Hour * <input type="checkbox"/> Same day * <input type="checkbox"/> 1 business day <input type="checkbox"/> 2 business days <input type="checkbox"/> 3 business days <input checked="" type="checkbox"/> 5 business days * not available for all tests ** past 3 PM the TAT will begin next business day Please schedule rush tests in advance | <input type="checkbox"/> Air <input type="checkbox"/> Paint <input type="checkbox"/> Soil <input type="checkbox"/> Wipe <input type="checkbox"/> Bulk <input type="checkbox"/> Waste Water <input type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Drinking Water <input type="checkbox"/> TSP / PM10 <input type="checkbox"/> _____ | Asbestos in Bulk | Metals Total | TCLP | Microbiology |
| | | <input type="checkbox"/> PLM <input type="checkbox"/> PLM Qualitative <input type="checkbox"/> 400 Point Count <input type="checkbox"/> 1000 Point Count <input type="checkbox"/> Gravimetric Prep | <input checked="" type="checkbox"/> Lead <input type="checkbox"/> RCRA 8 Metals <input type="checkbox"/> Chromium VI <input type="checkbox"/> Mercury <input type="checkbox"/> EPA 200.9 Rev 2.2 | <input type="checkbox"/> Lead <input type="checkbox"/> RCRA 8 Metals <input type="checkbox"/> Full TCLP (w/ organics 10 Day) | <input type="checkbox"/> BACT (MPN/PA) <input type="checkbox"/> Mold Direct Exam <input type="checkbox"/> Allergens |
| | | Asbestos in Air | Gravimetric | Miscellaneous | Sub-Contract |
| | | <input type="checkbox"/> PCM <input type="checkbox"/> PCM-B Rules | <input type="checkbox"/> Total Dust NIOSH 0500 <input type="checkbox"/> Resp. Dust NIOSH 0600 | <input type="checkbox"/> Silica FTIR (7602) <input type="checkbox"/> _____ | <input type="checkbox"/> TEM Chatfield <input type="checkbox"/> TEM AHERA <input type="checkbox"/> TEM 7402 <input type="checkbox"/> Silica XRD (7500) |

| Sample # | Date Sampled | Time Sampled | Sample Identification (Employee, Bldg, Material, Type ¹) | Wipe Area | Time ² Start | Time ² Stop | Flow Rate ³ Start | Flow Rate ³ Stop | Total Air ⁴ |
|--------------------------|--------------|--------------|--|-----------|-------------------------|------------------------|------------------------------|-----------------------------|------------------------|
| See attached spreadsheet | | | | | | | | | |
| 19 Samples | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

For Aqueous and Solid samples ensure enough sample is sent for duplicate and spike analysis

¹Type: A=Area, B=Blank, P=Personal, E=Excursion ²Beginning/End of Sample Period ³Liters/Minute ⁴Volume in Liters [time in min x flow in L/min]

Relinquished By: Julia Torres Signature: Julia Torres Date/Time 10/26/20

! ALL SHADED FIELDS MUST BE FILLED TO AVOID DELAYS !



Powered by partnership.


300 Pearl Street, Suite 130 | Buffalo, NY 14202 | p 716-551-6281 | f 716-551-6282
www.labellapp.com

| School | Silver Creek Central School District | | | | | | |
|----------|--------------------------------------|-------------|------|--------------|---------|-------|--|
| Date | 10/24/2020 | | | | | | |
| Sample # | Location | Outlet Type | Time | Manufacturer | Model # | Notes | |
| 1F-149 | H219B | S | 1225 | | | | |
| 1F-150 | H219B | S | 1225 | | | | |
| 1F-151 | H219B | S | 1226 | | | | |
| 1F-152 | H219A | S | 1228 | | | | |
| 1F-153 | H219A | S | 1228 | | | | |
| 1F-154 | H219A | S | 1229 | | | | |
| 1F-156 | H121 | S | 1234 | | | | |
| 1F-157 | H122 | S | 1233 | | | | |
| 1F-158 | H122 | S | 1232 | | | | |
| 1F-159 | H105 | S | 1231 | | | | |
| 1F-160 | H102 | S | 1230 | | | | |
| 1F-163 | H128B | S | 1217 | | | | |
| 1C-14 | H101 | DF | 1230 | EIKAY | LZF8_1C | | |
| 1A-20 | M410 | B | 1029 | | | | |
| 1C-3 | M411 | DF | 1027 | | | | |
| 1F-213 | M428 | S | 1250 | | | | |
| 1F-214 | M428 | S | 1251 | | | | |
| 1A-213 | M428 | B | 1252 | | | | |
| 1A-214 | M428 | B | 1253 | | | | |


Appendix B

Sample Location Drawings


1F-79 (17.8 PPB)

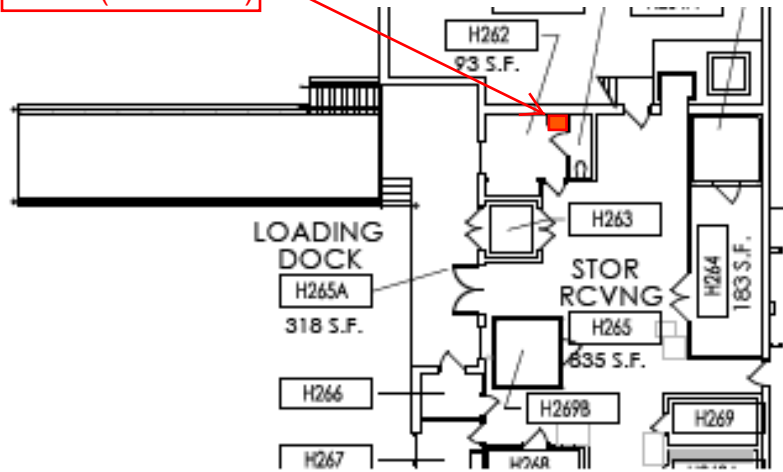


1F-77 (17.2 PPB)

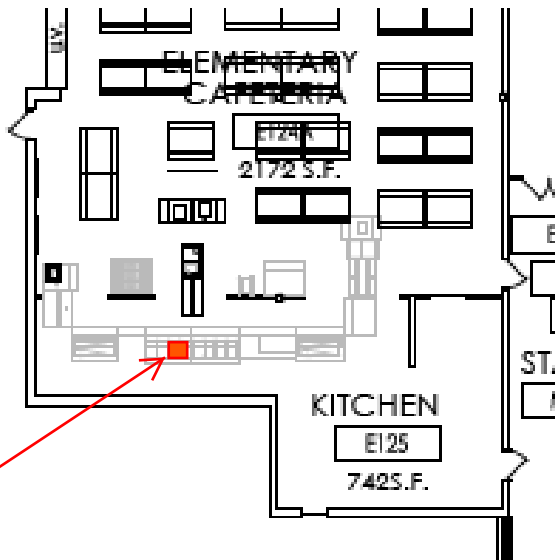

1C-7 (1,750 PPB)

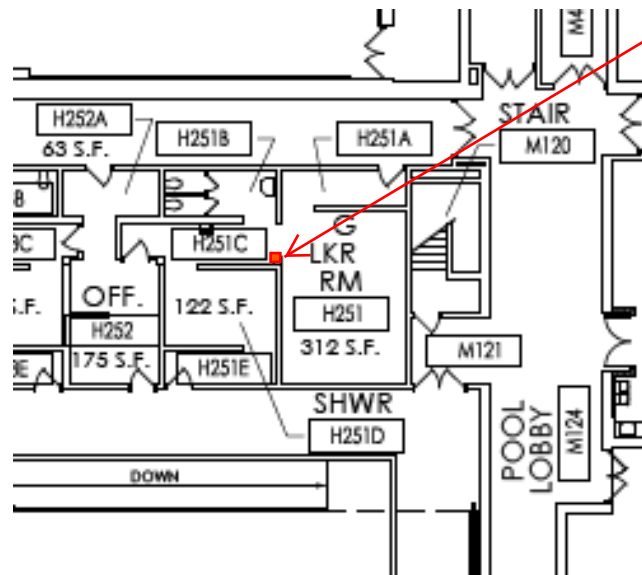

1F-36 (18.4 PPB)

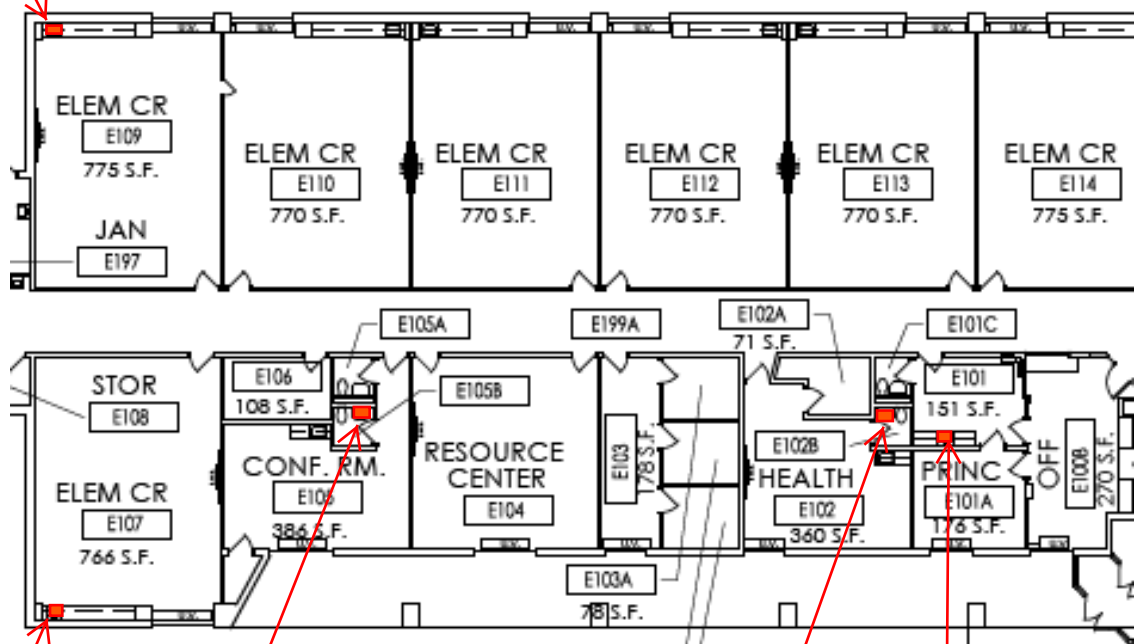


1F-40 (22.9 PPB)

1F-43 (16.4 PPB)

1F-45 (17.2 PPB)


1F-47 (17.7 PPB)

STAIRS
E198B

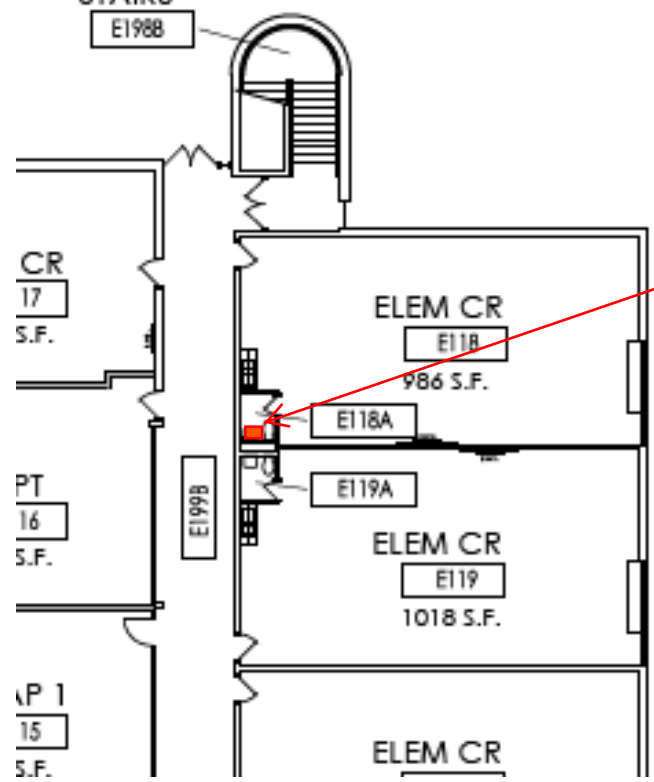


1F-56 (16.3 PPB)

1F-2 (15.7 PPB)

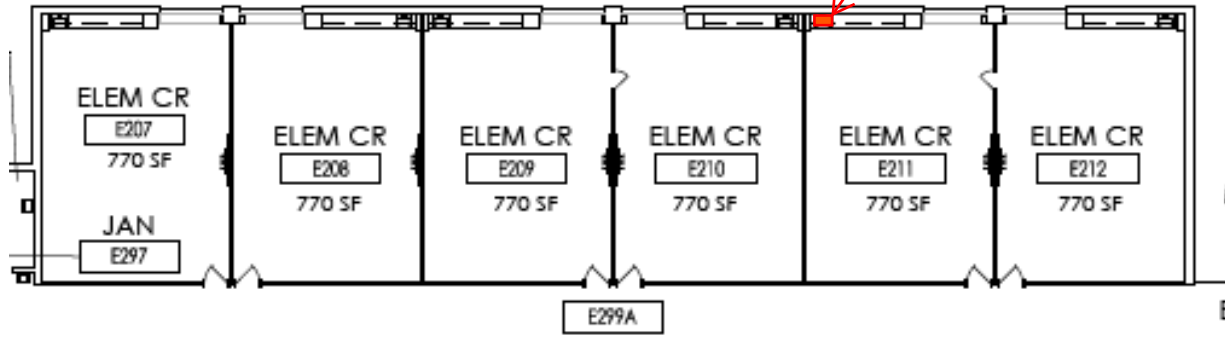

1F-10 (17.8 PPB)

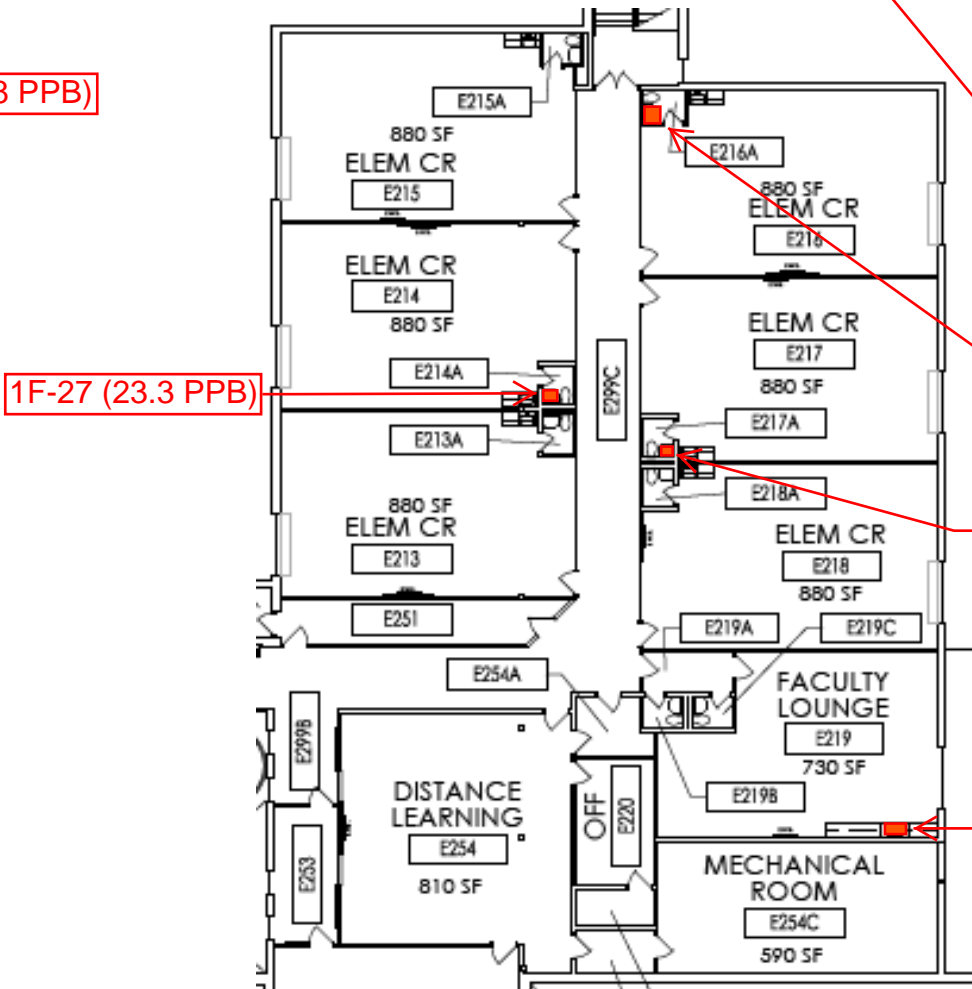

1F-15 (15.9 PPB)



1F-14 (15.3 PPB)



1F-27 (23.3 PPB)


1F-23 (17.1 PPB)


1F-21 (15.3 PPB)


1F-16 (39.4 PPB)

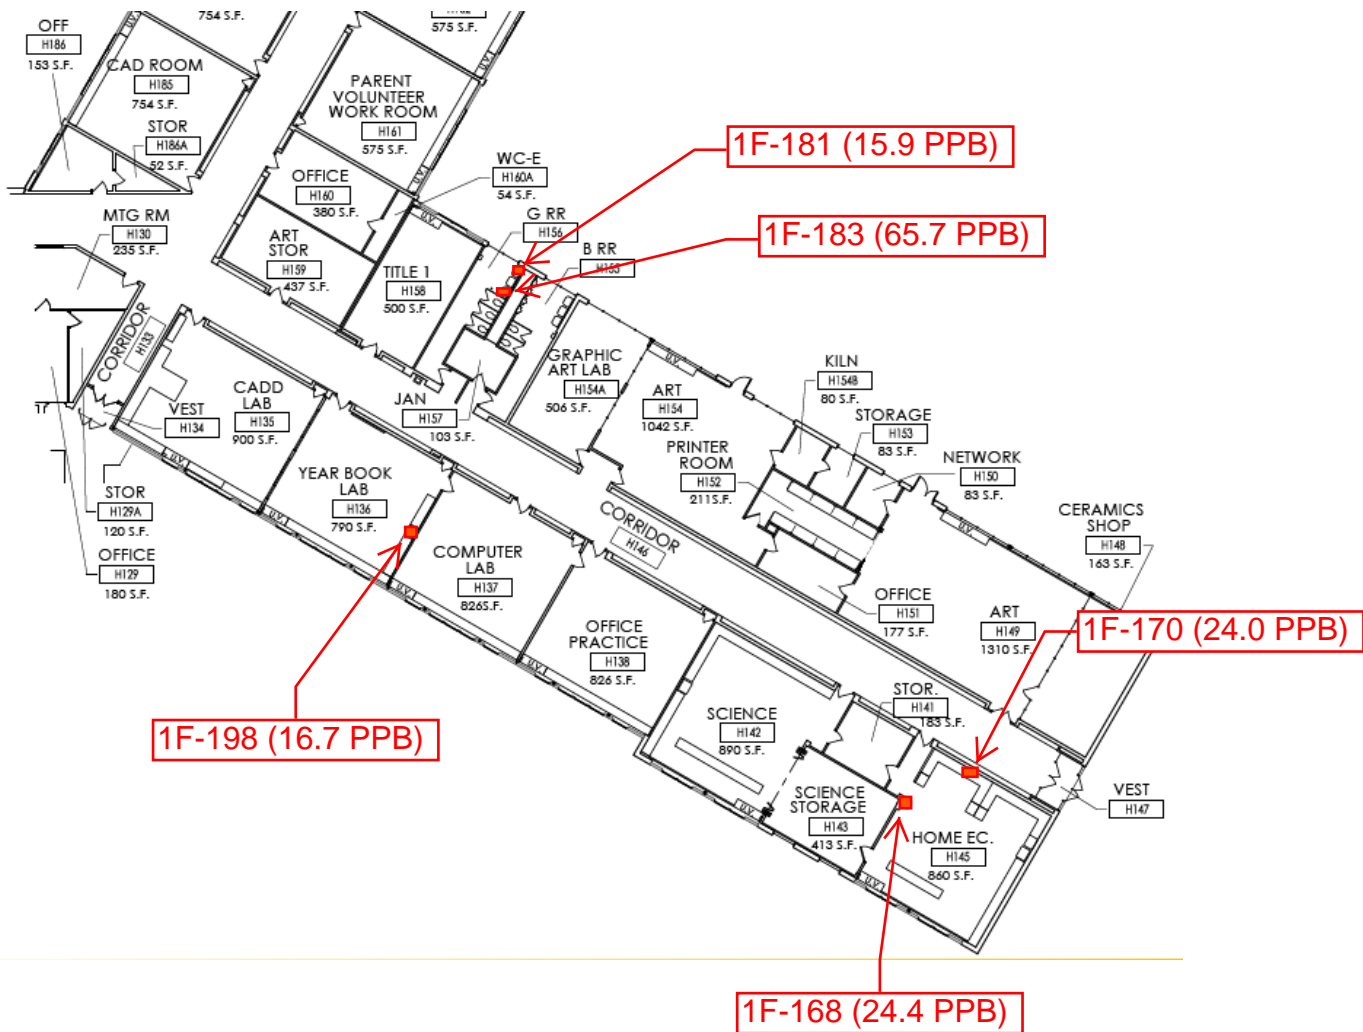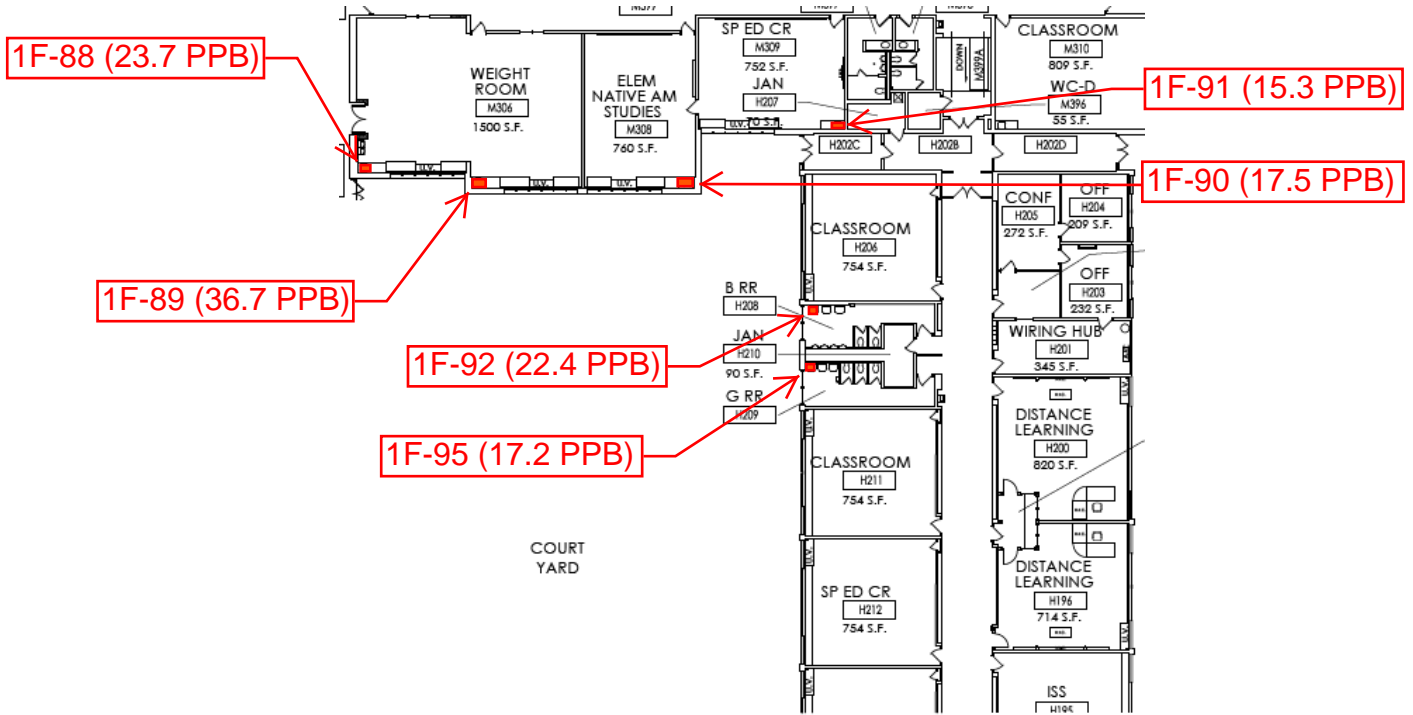


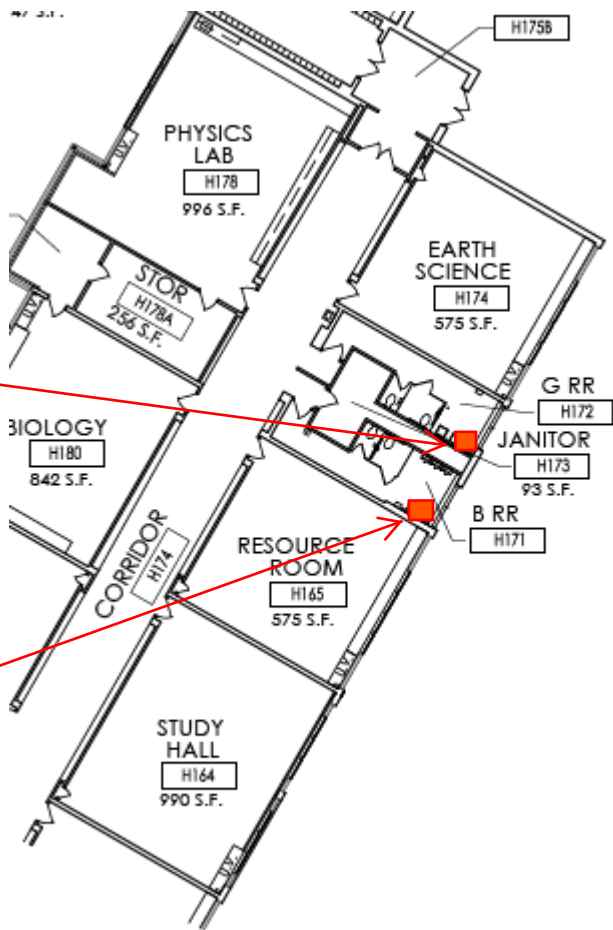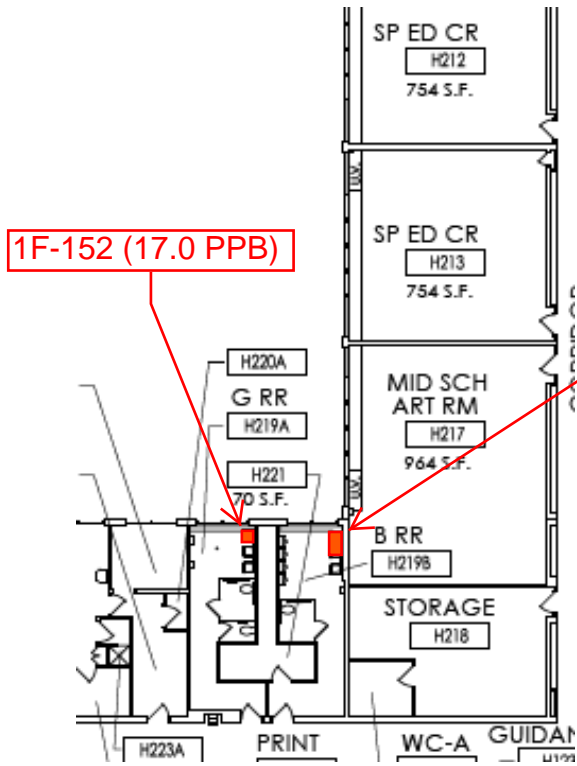


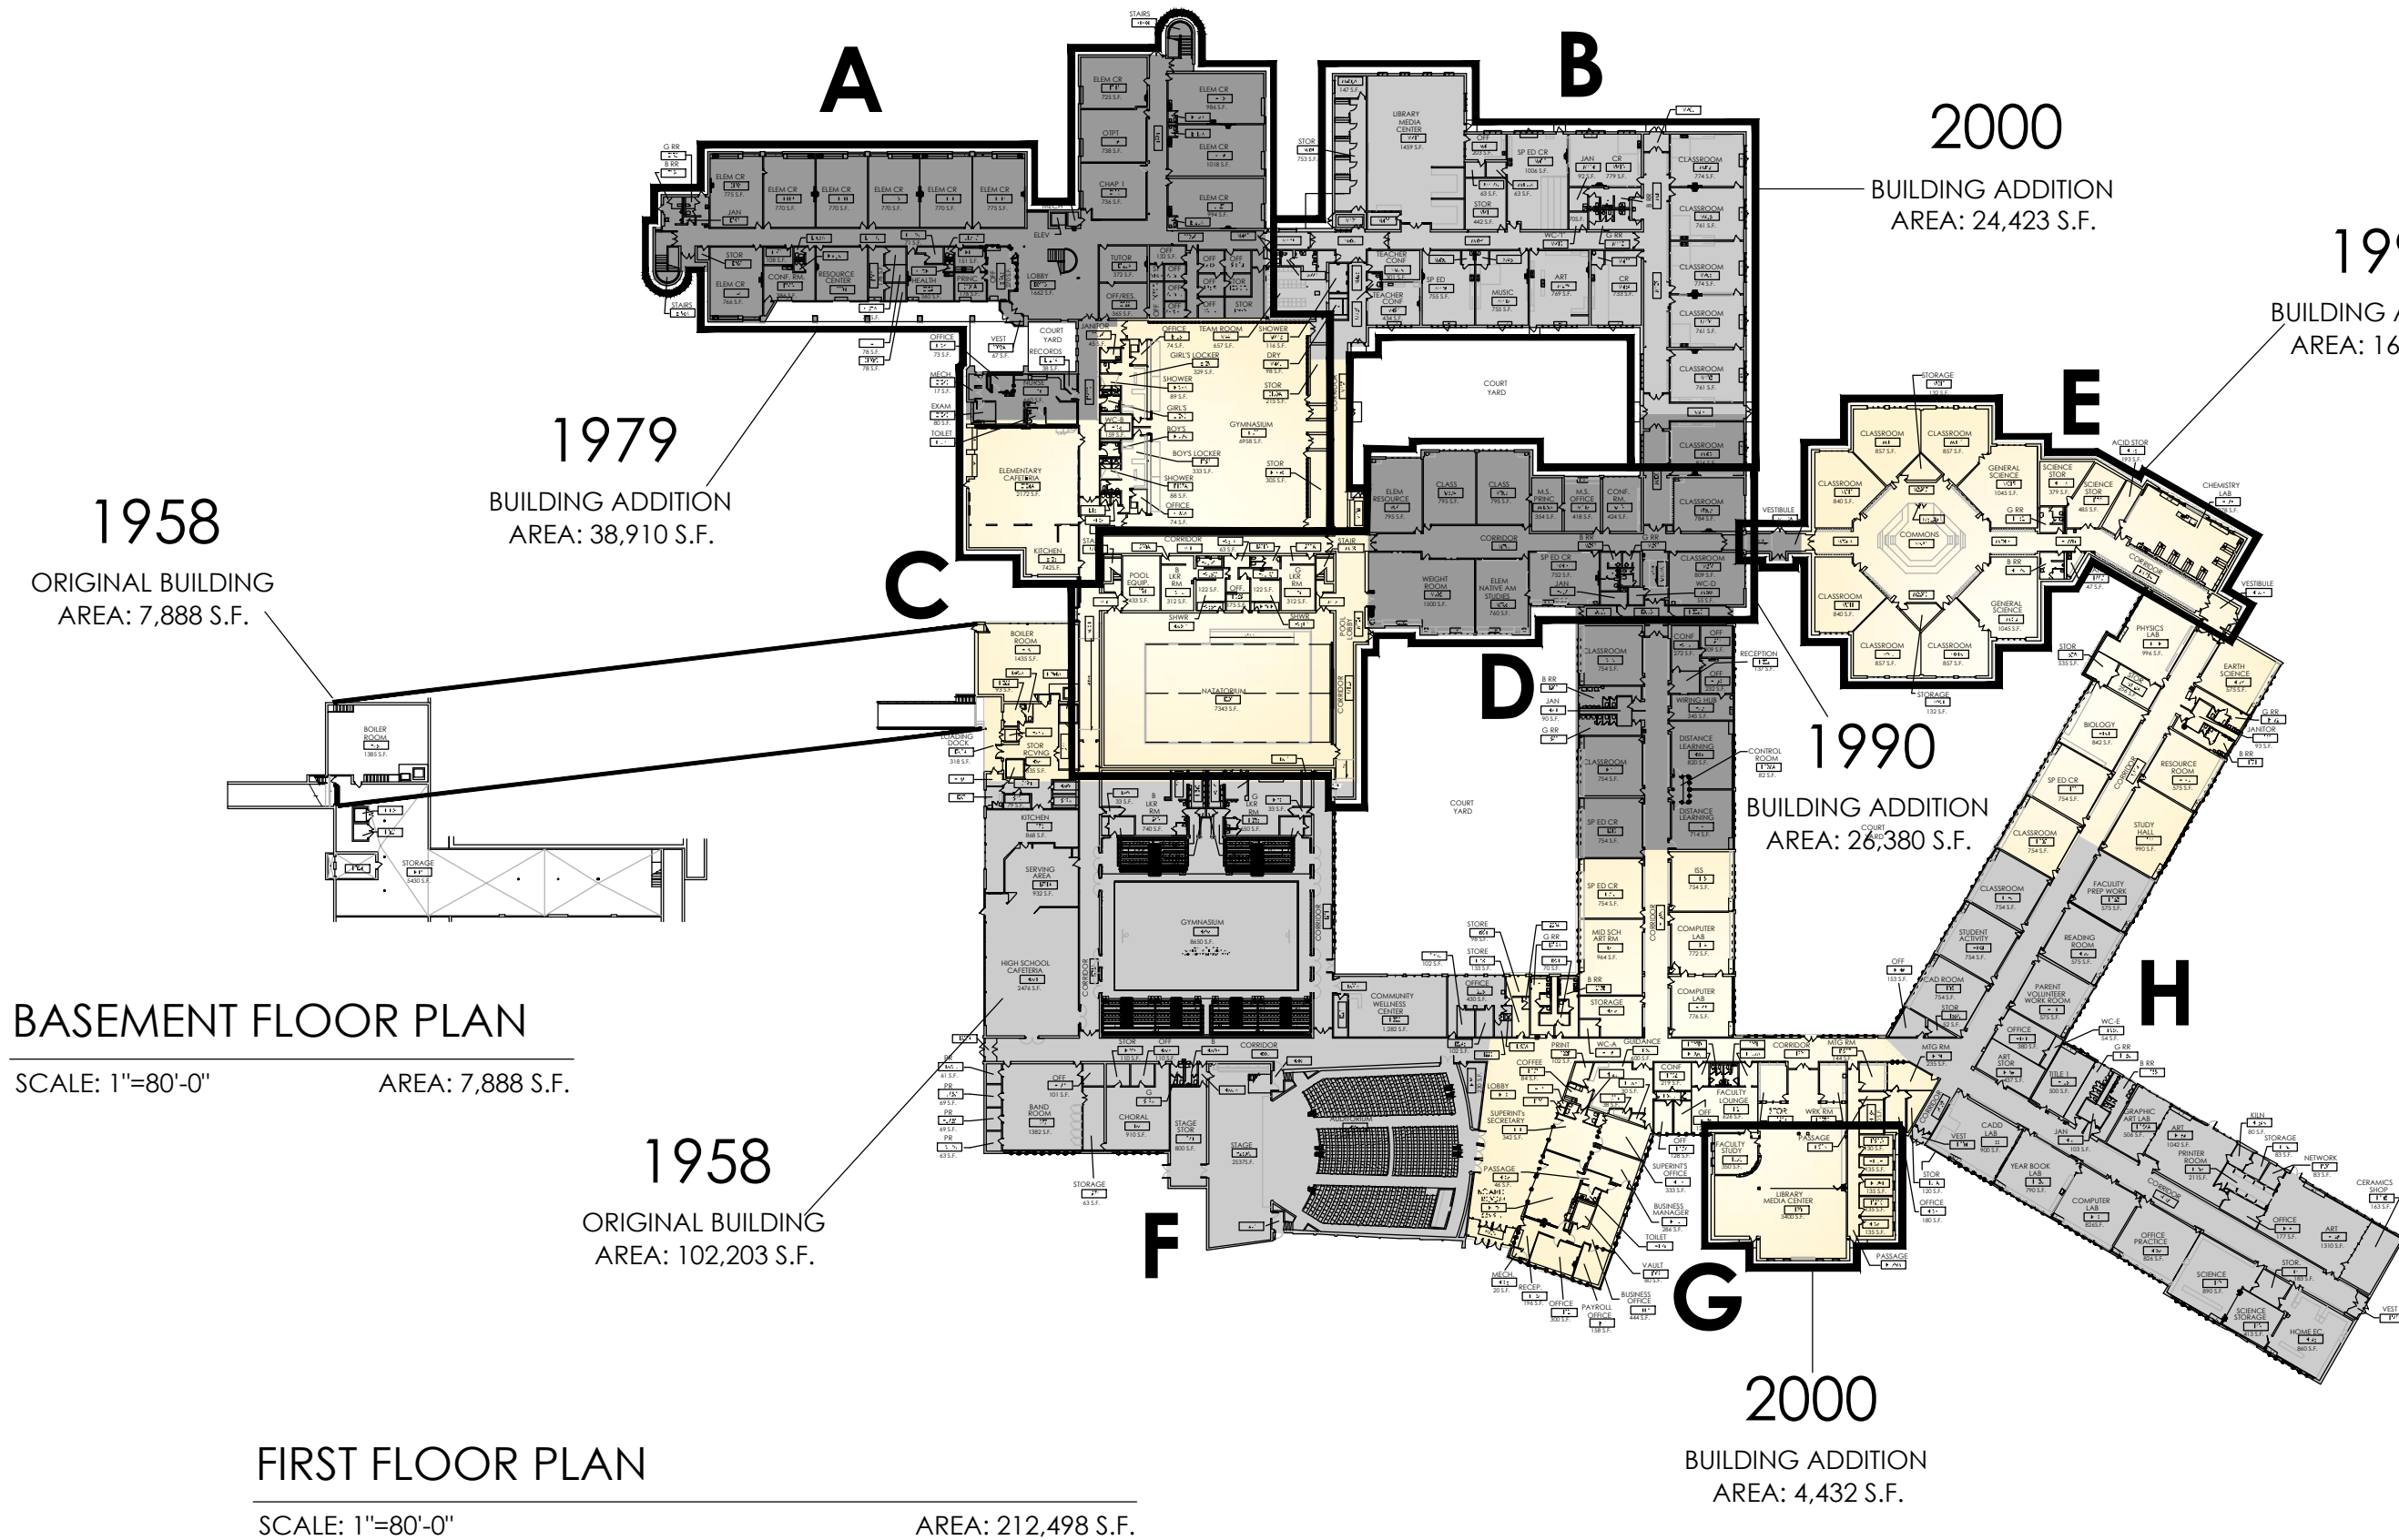



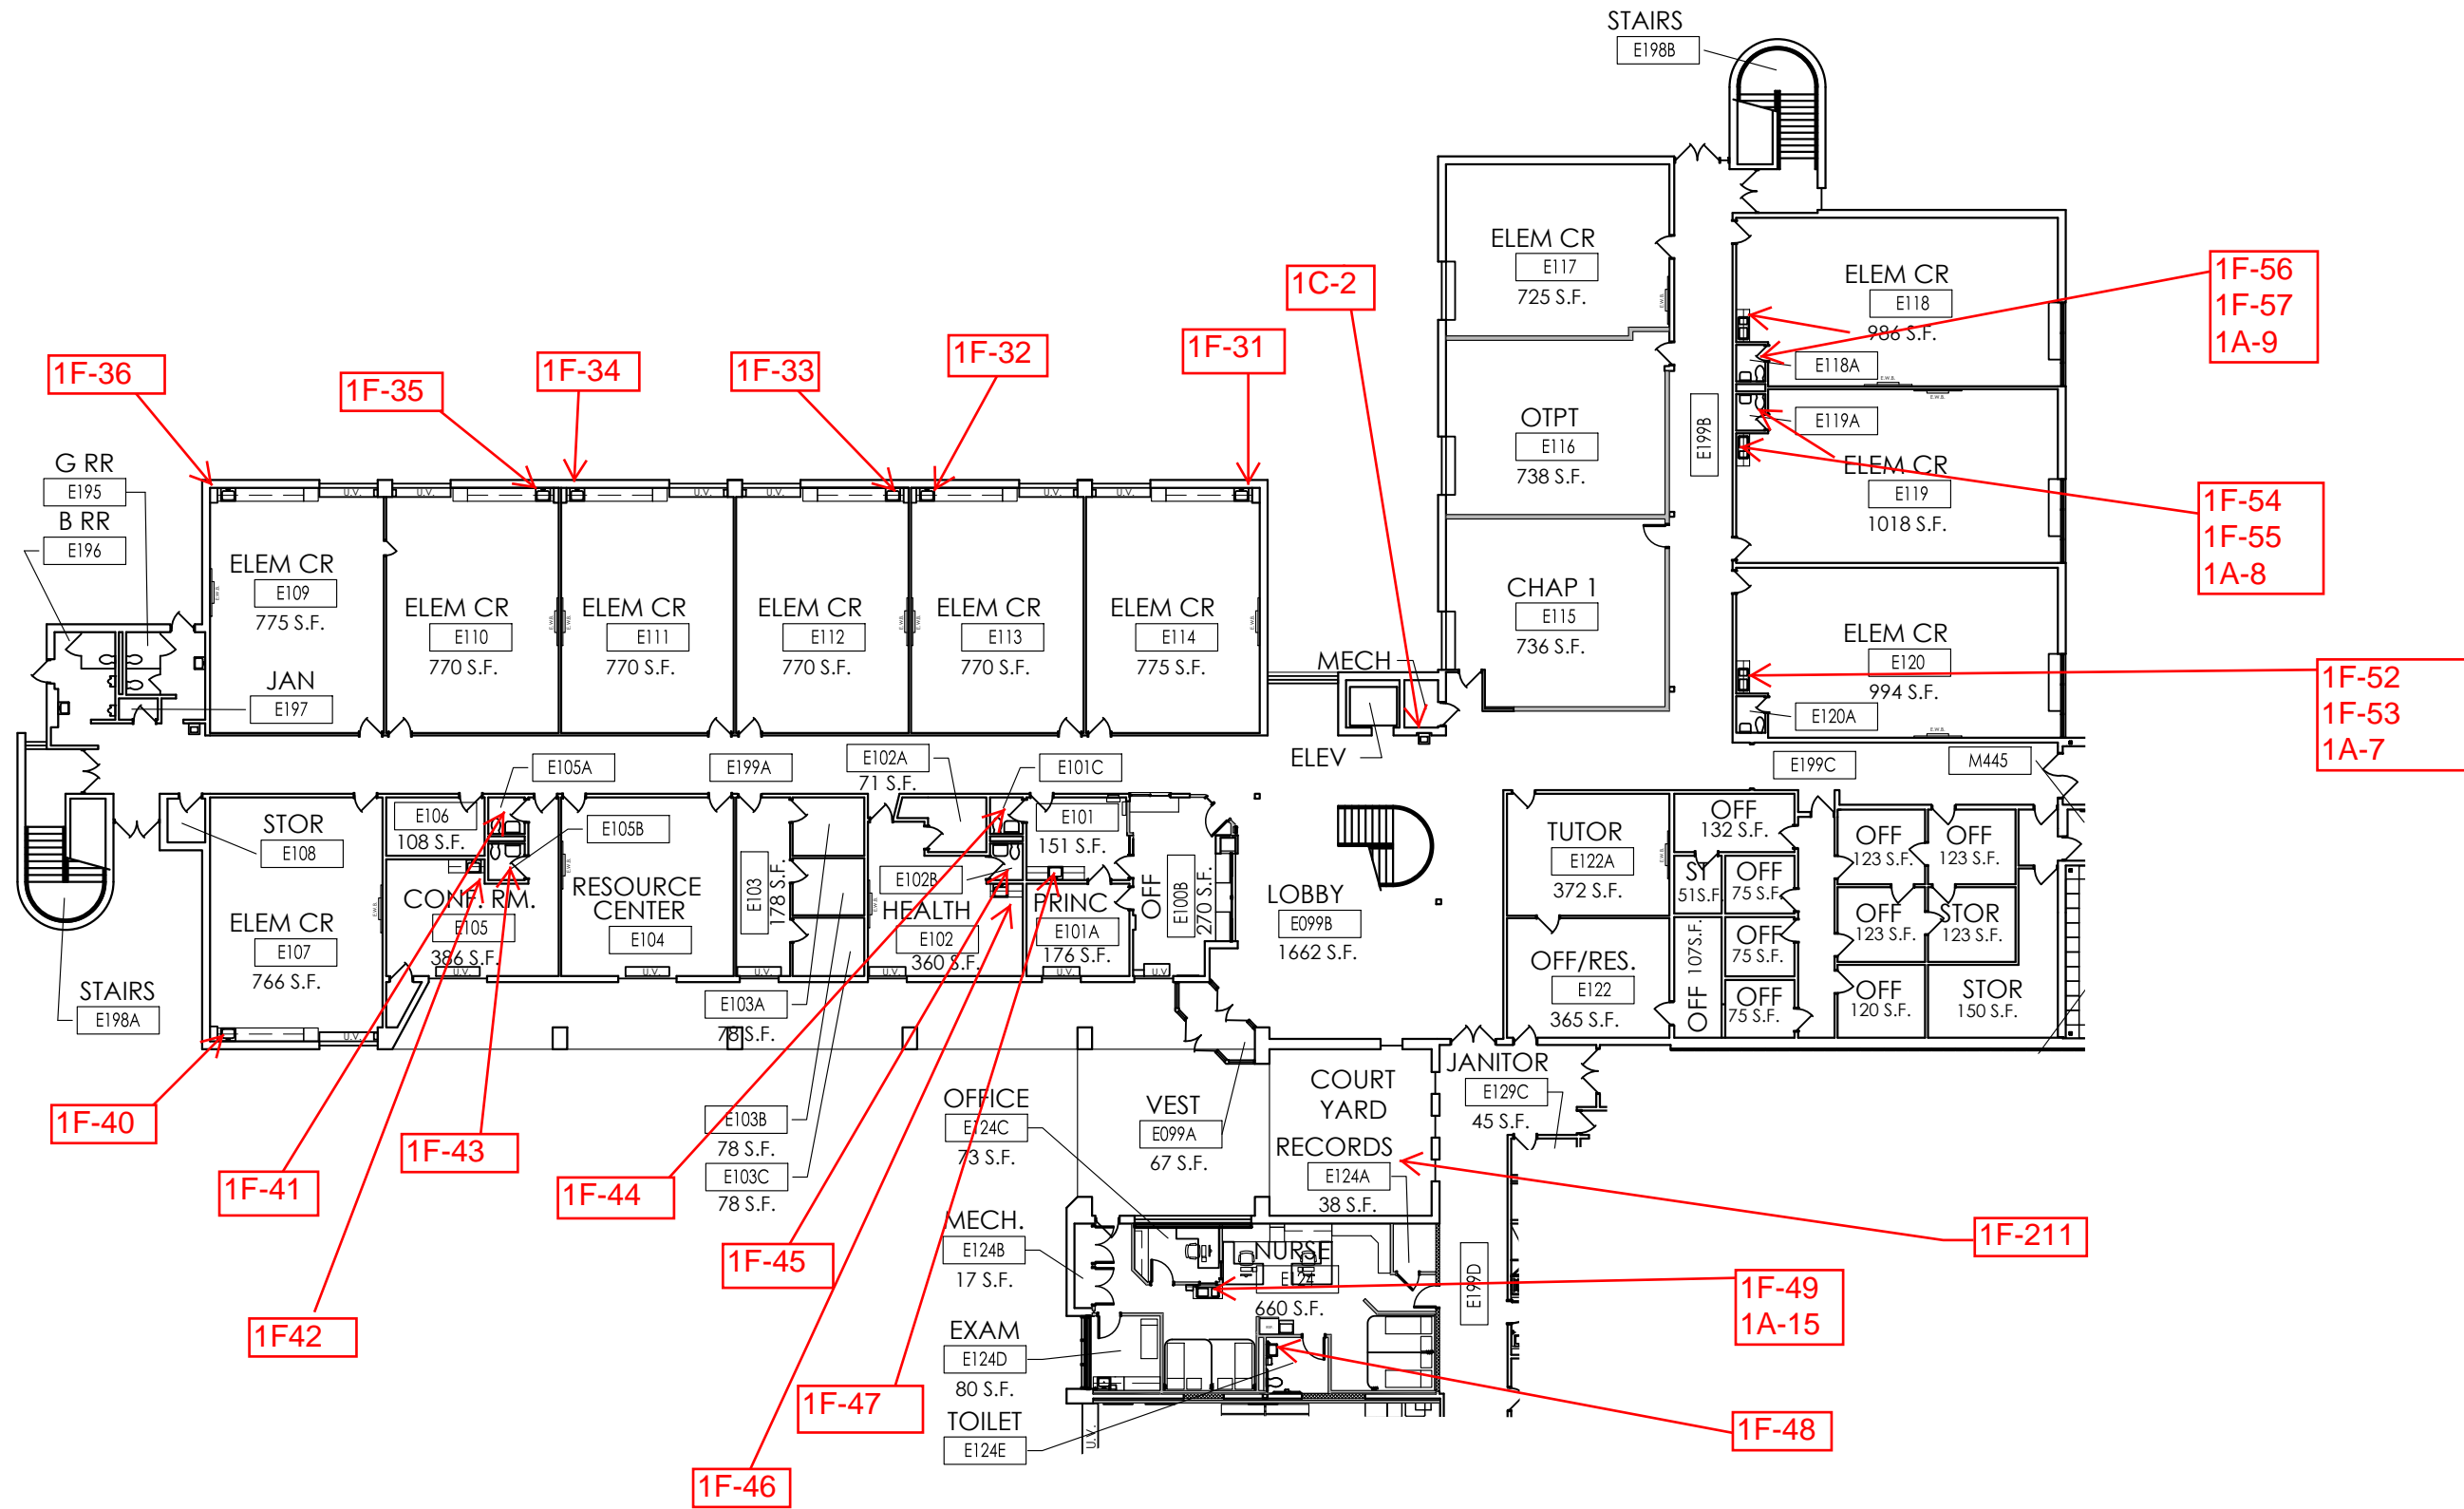


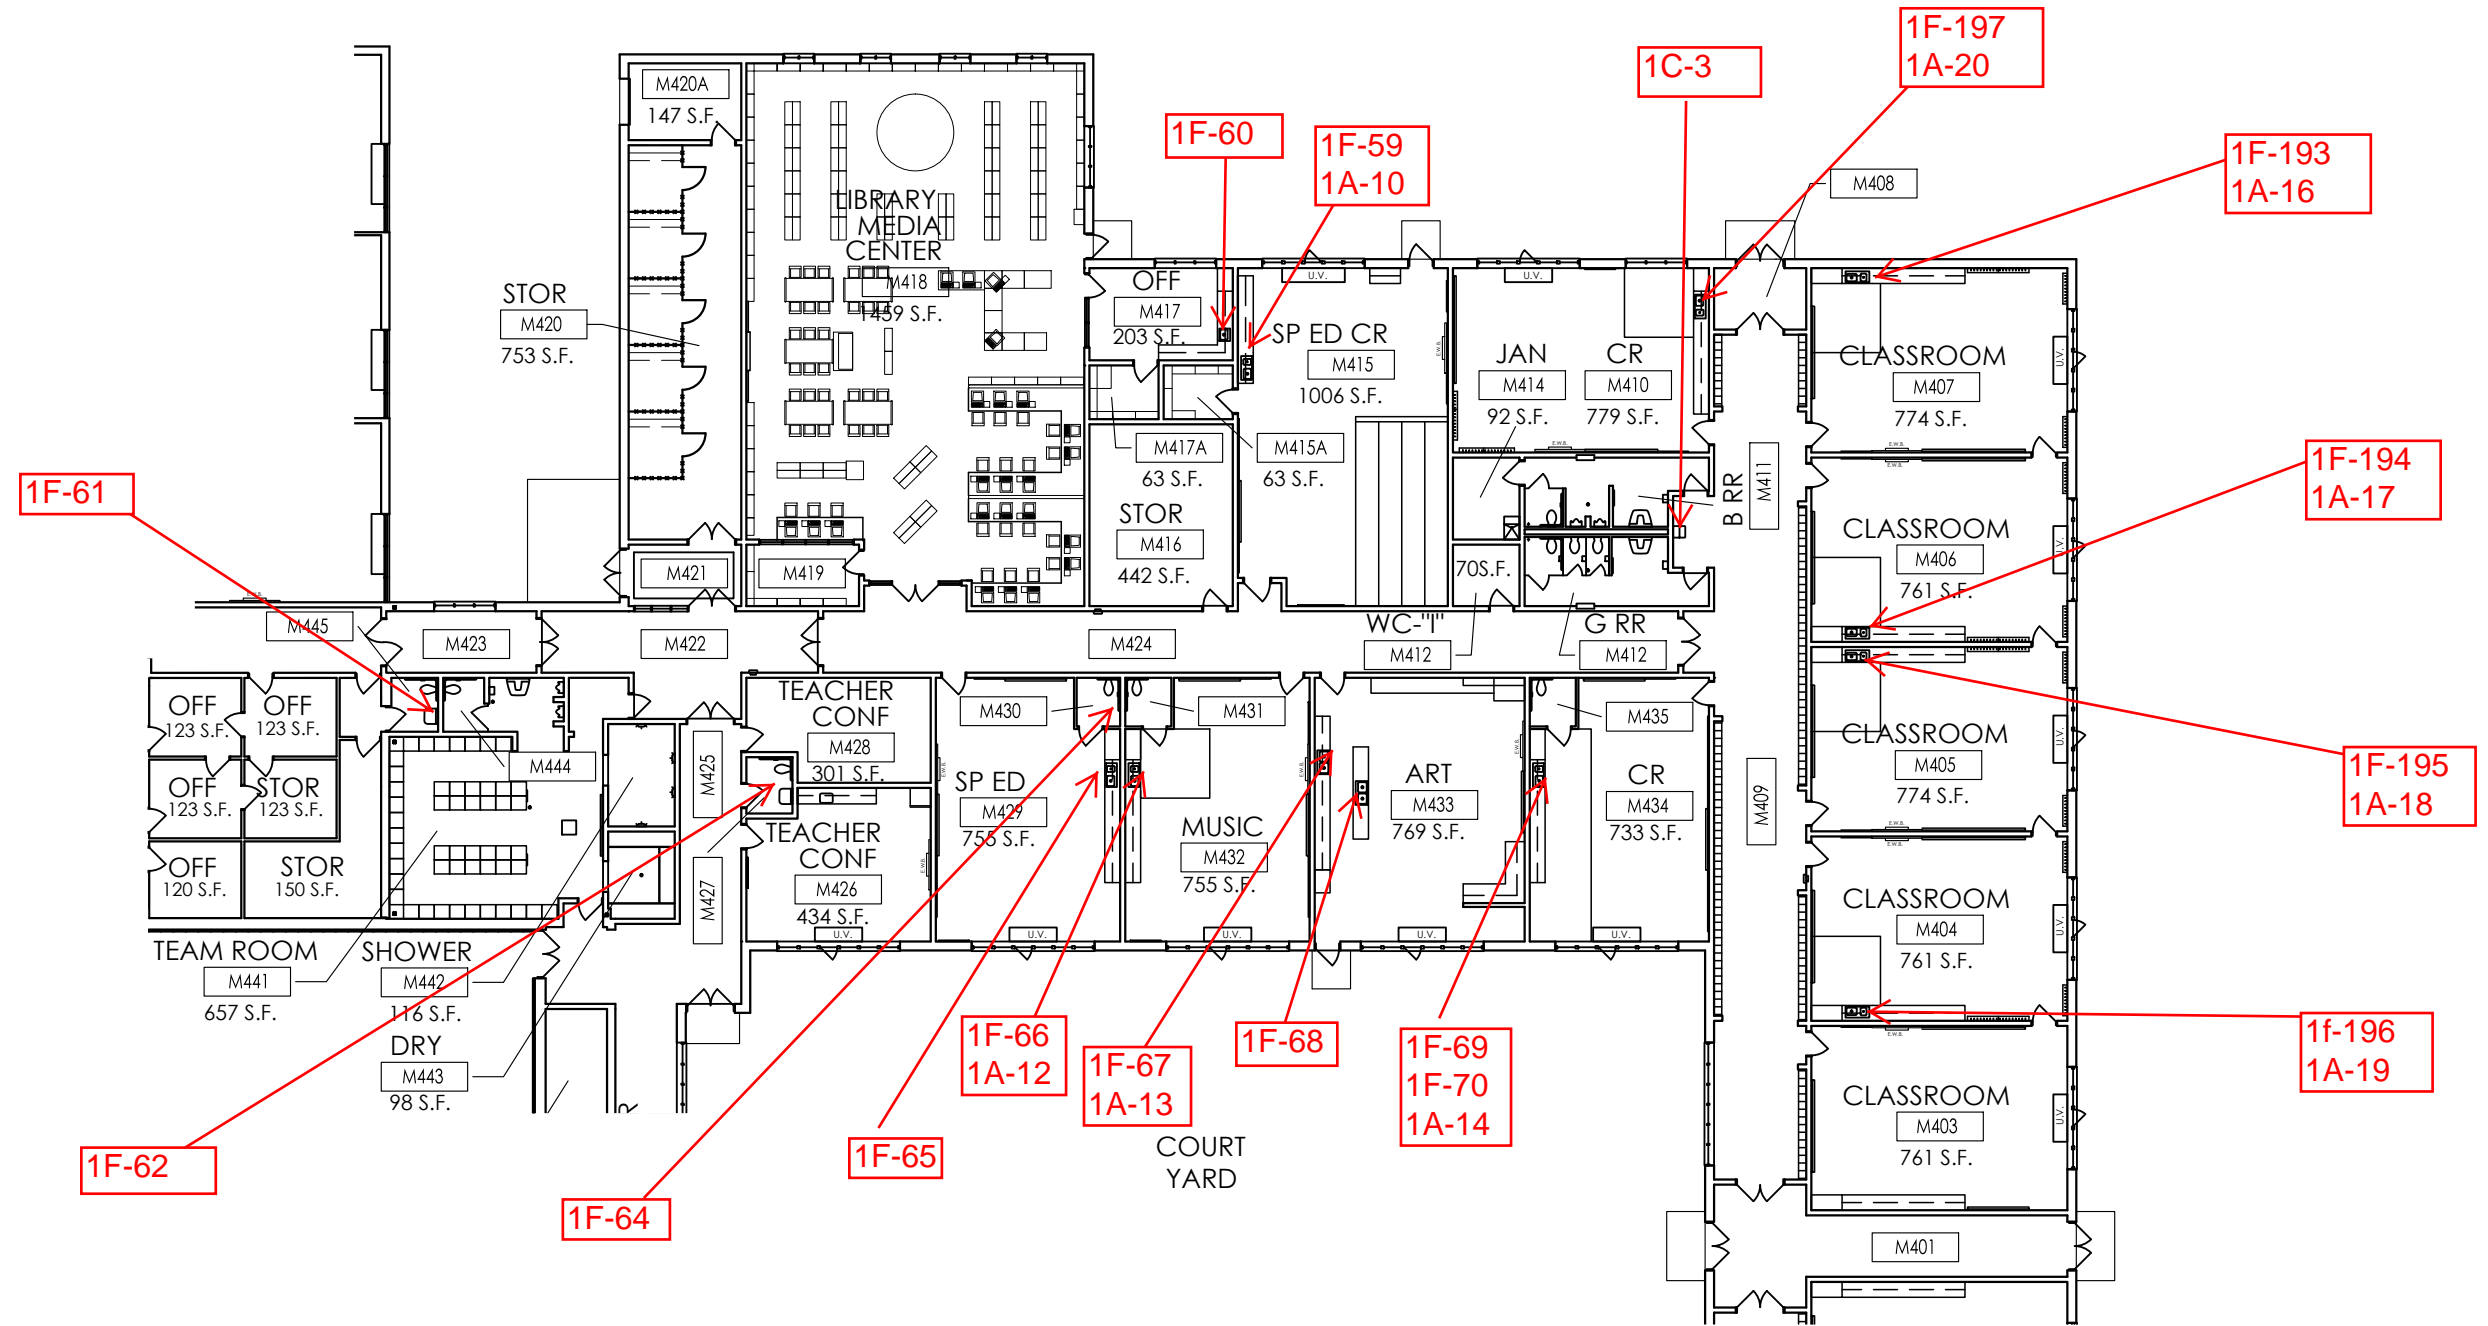


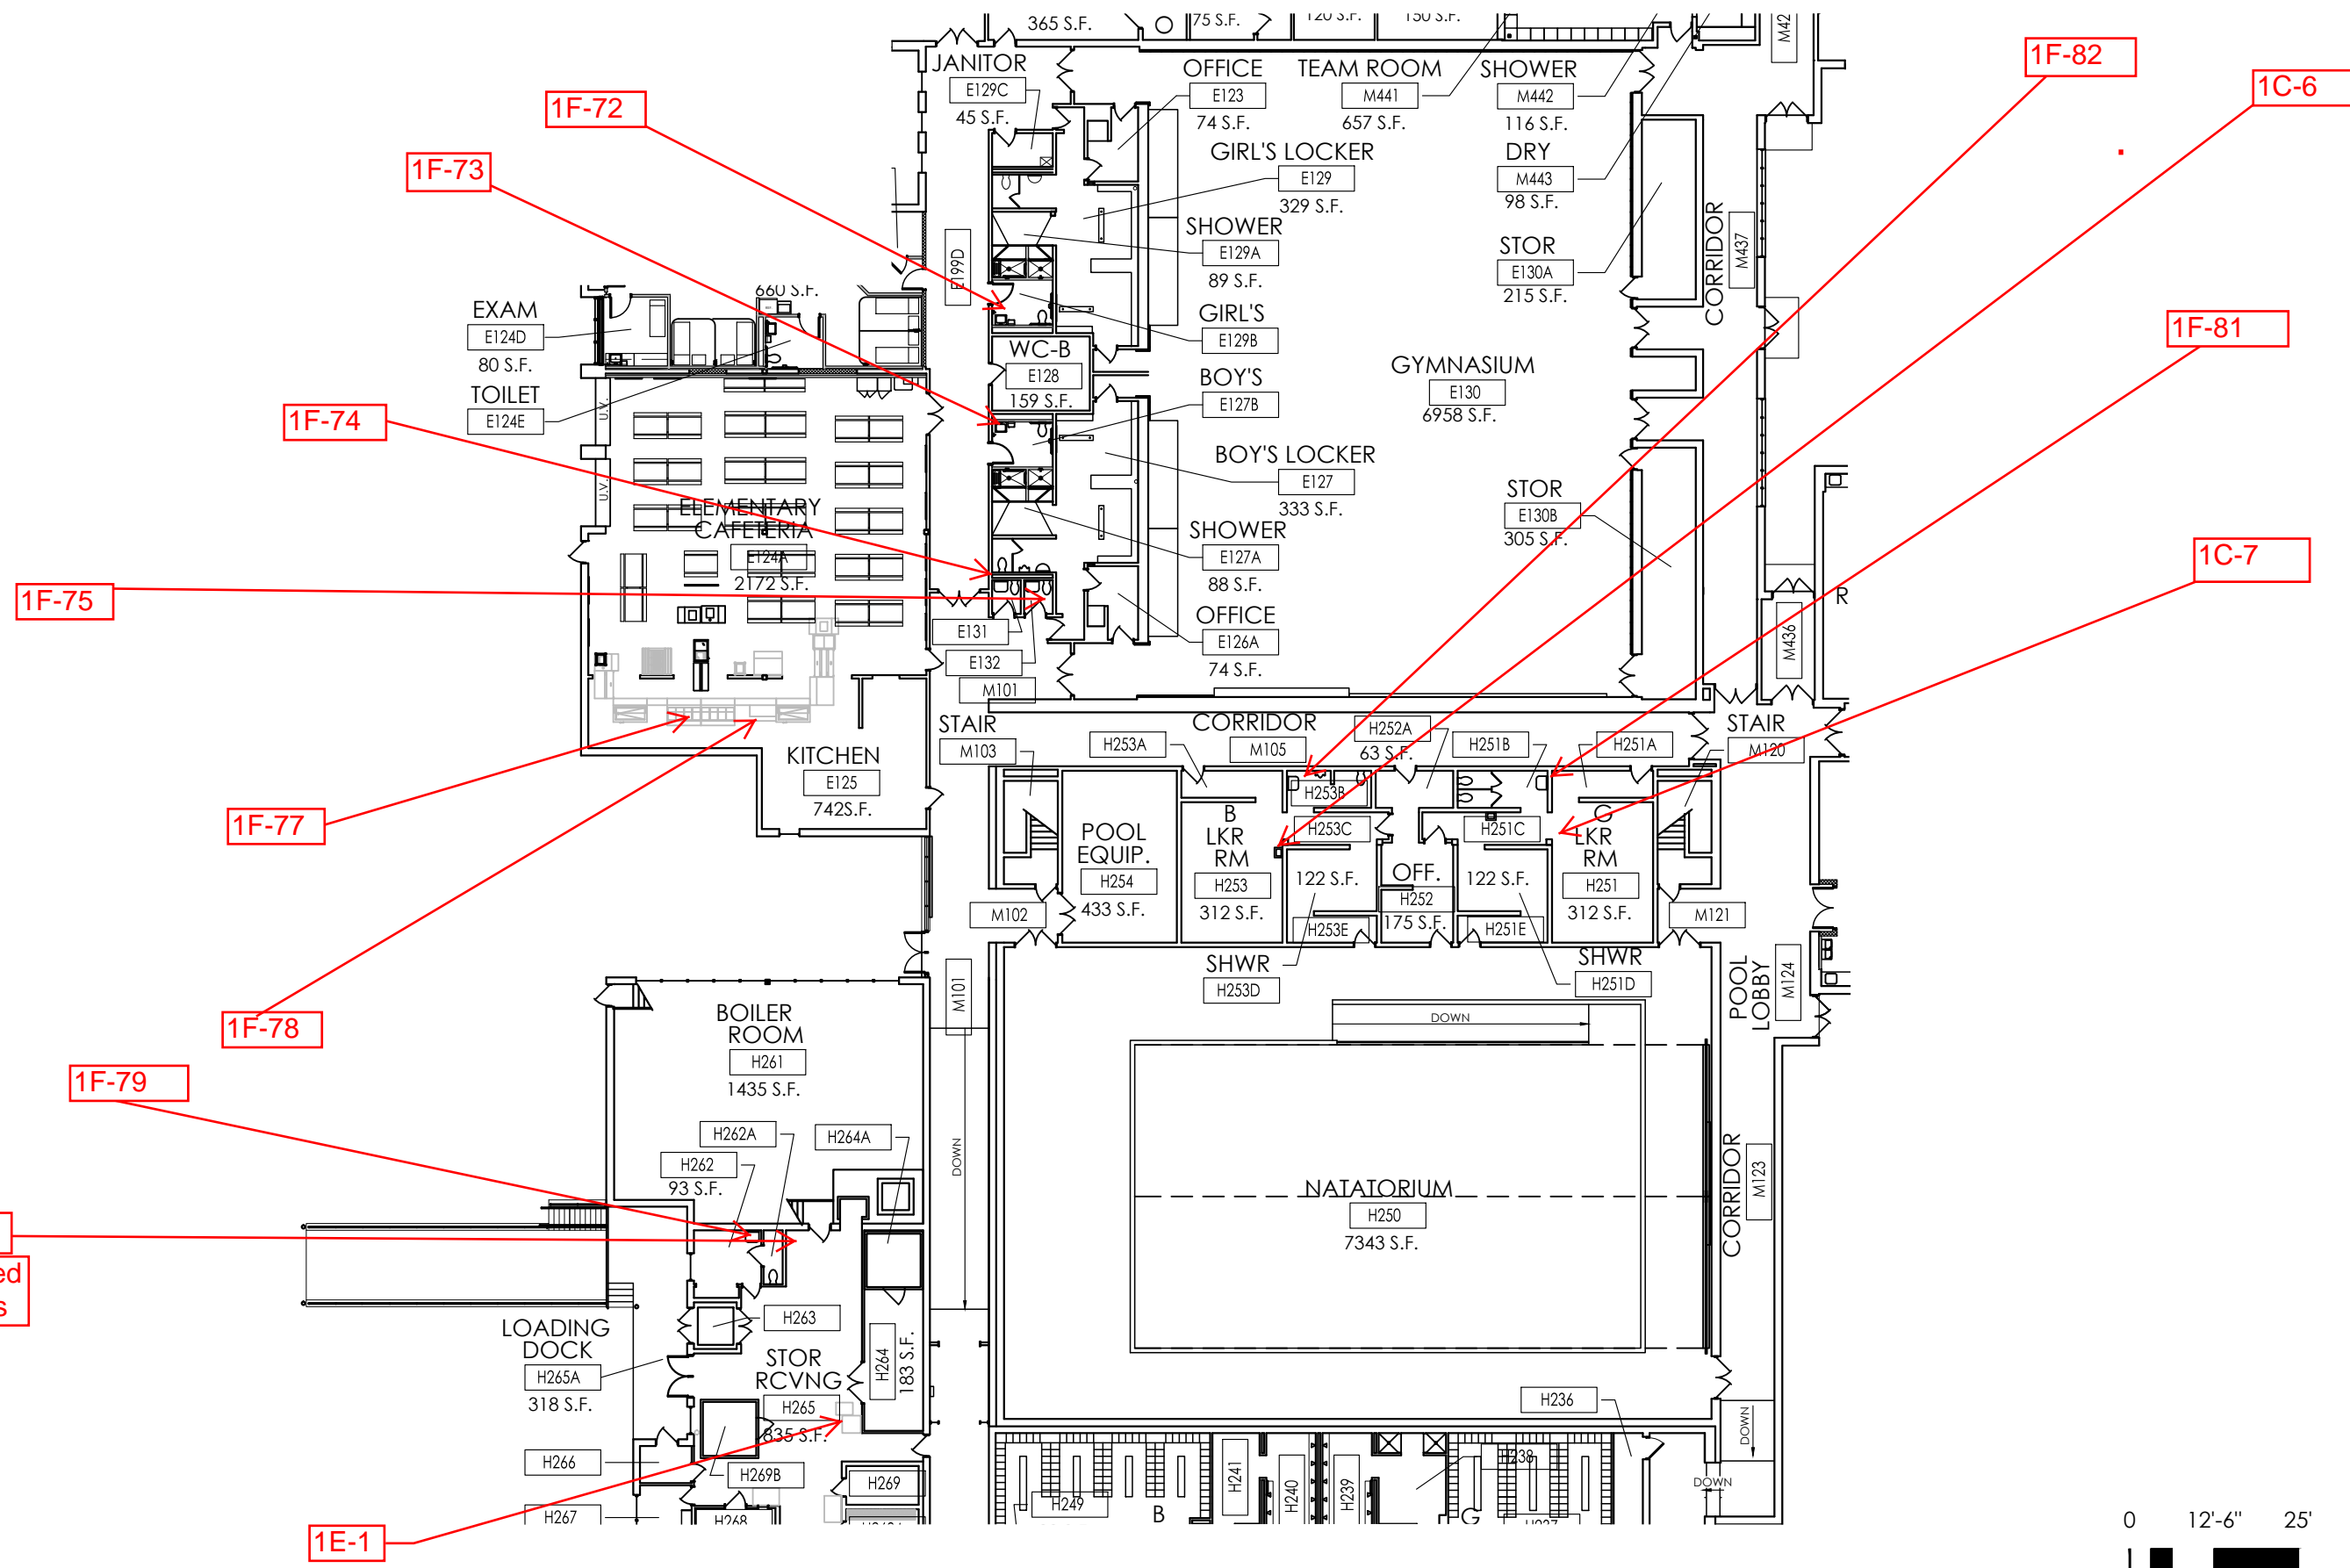


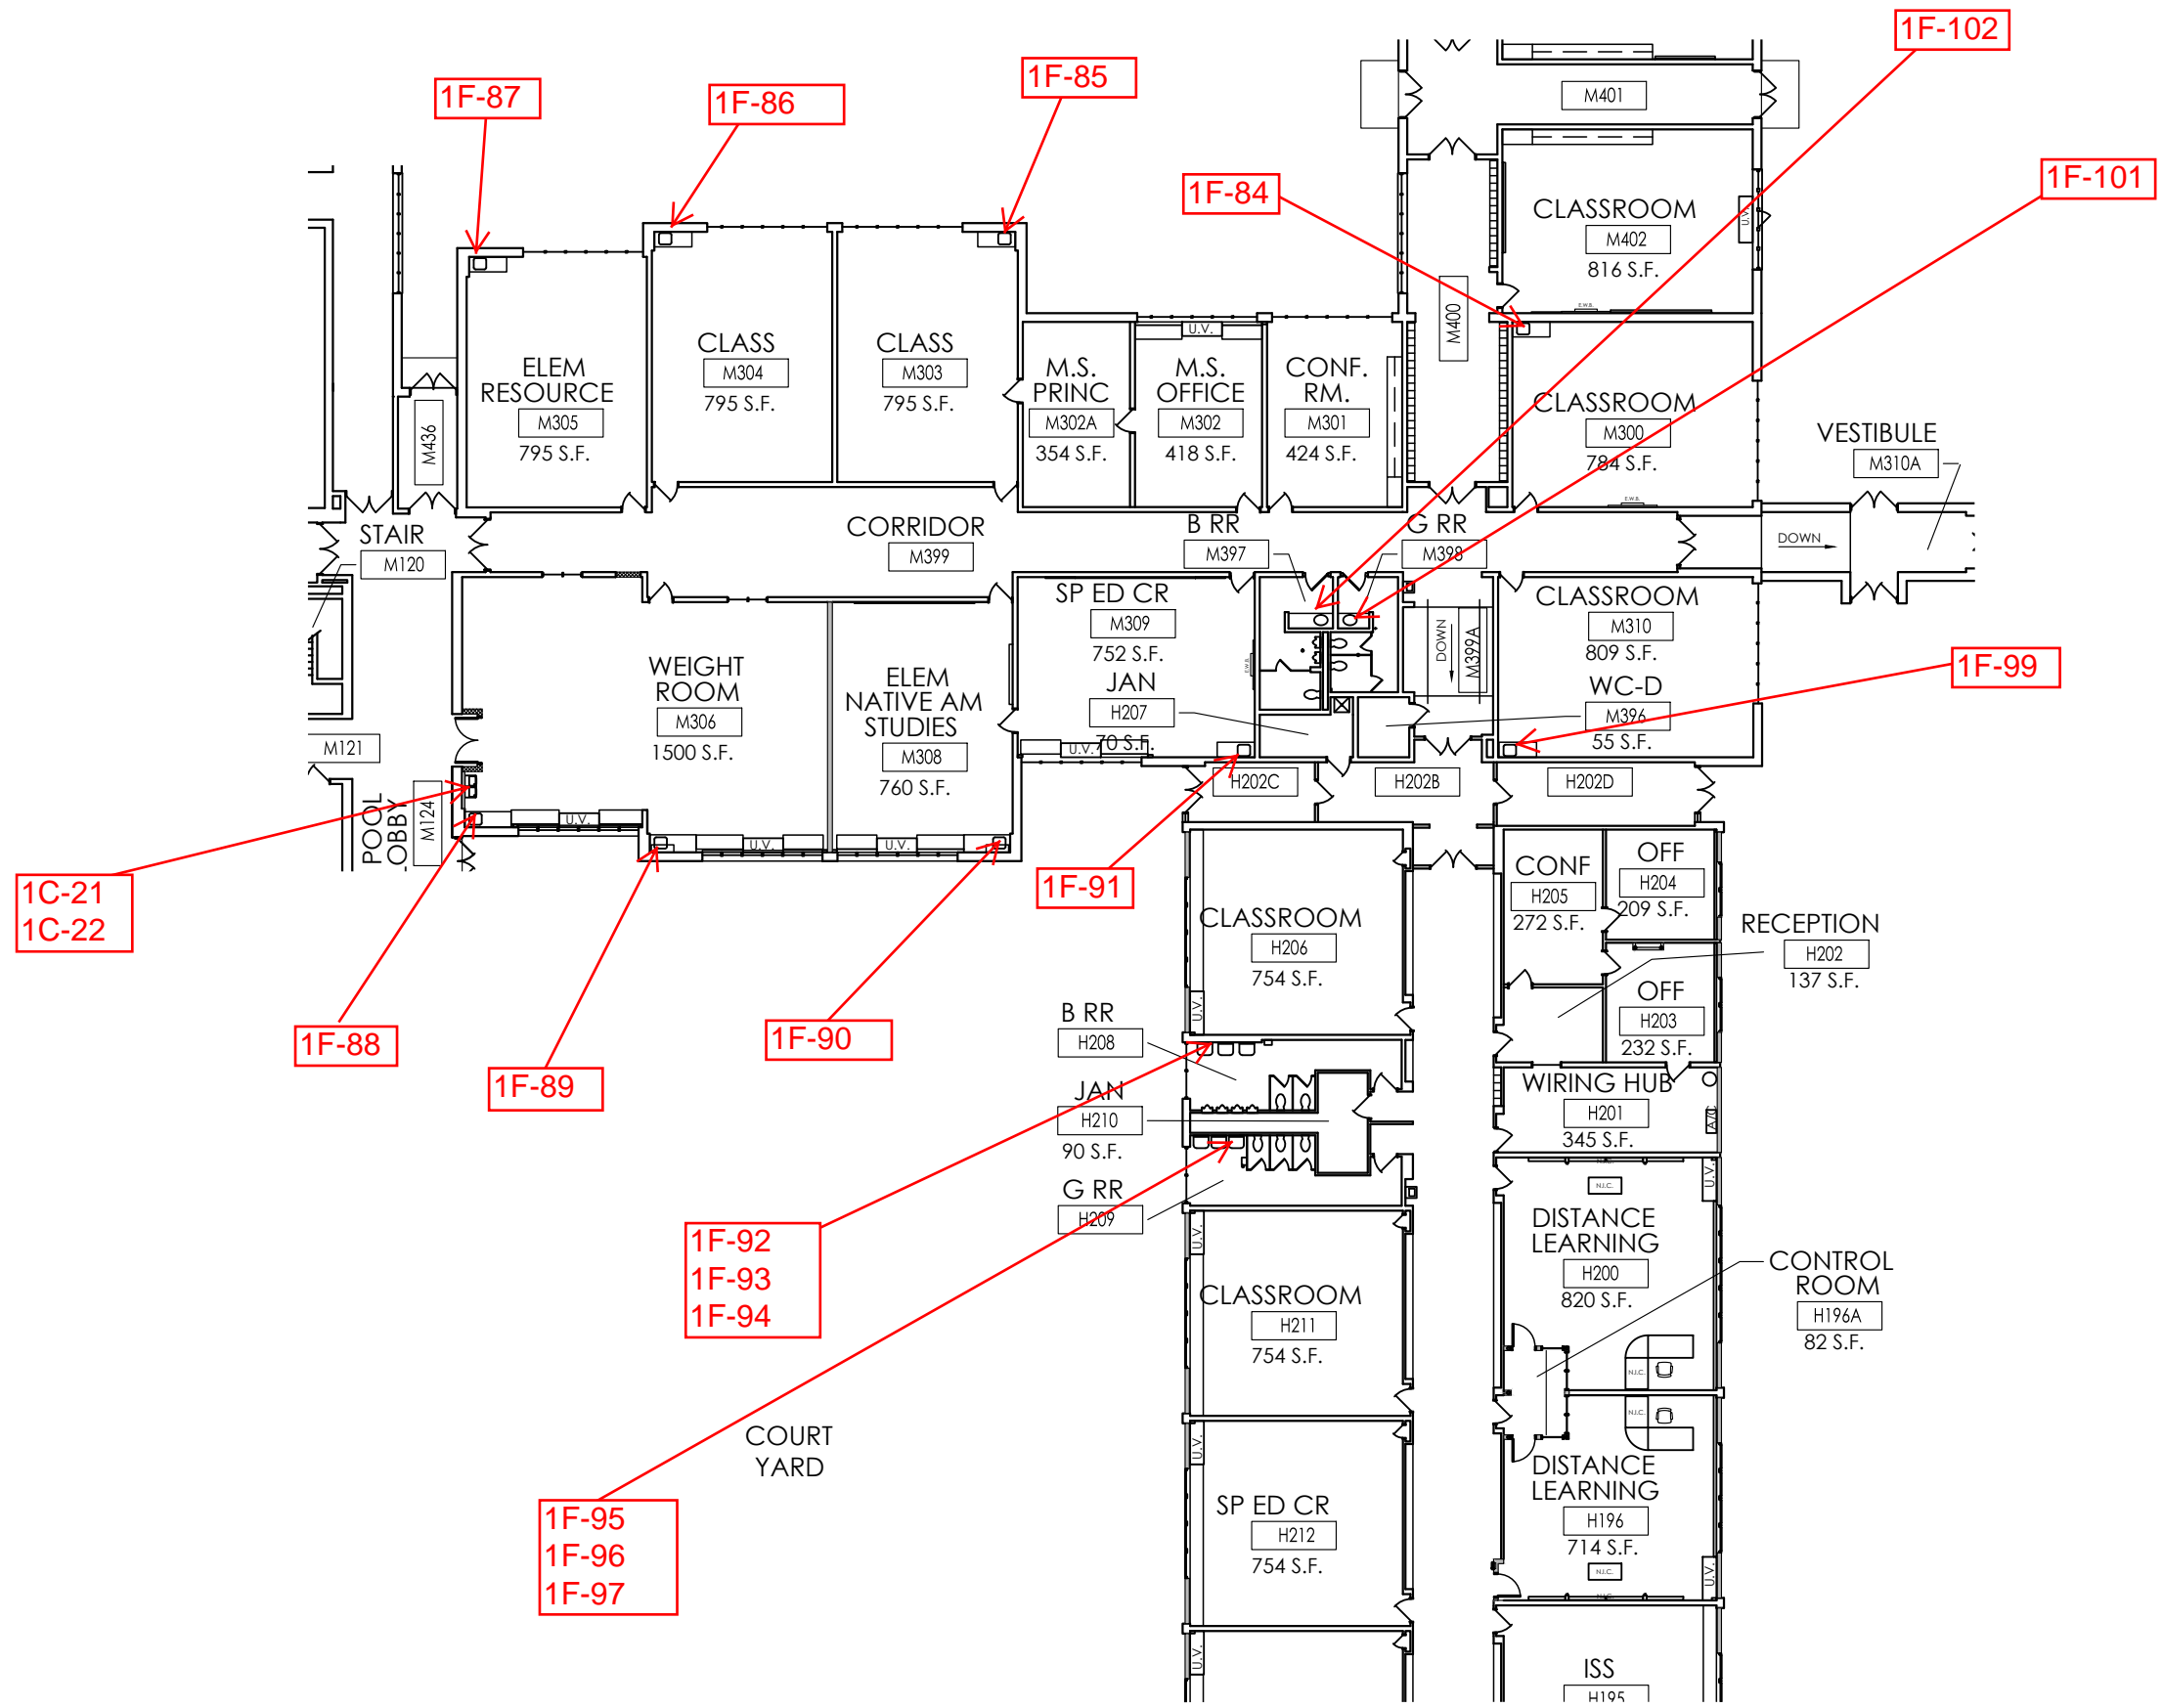

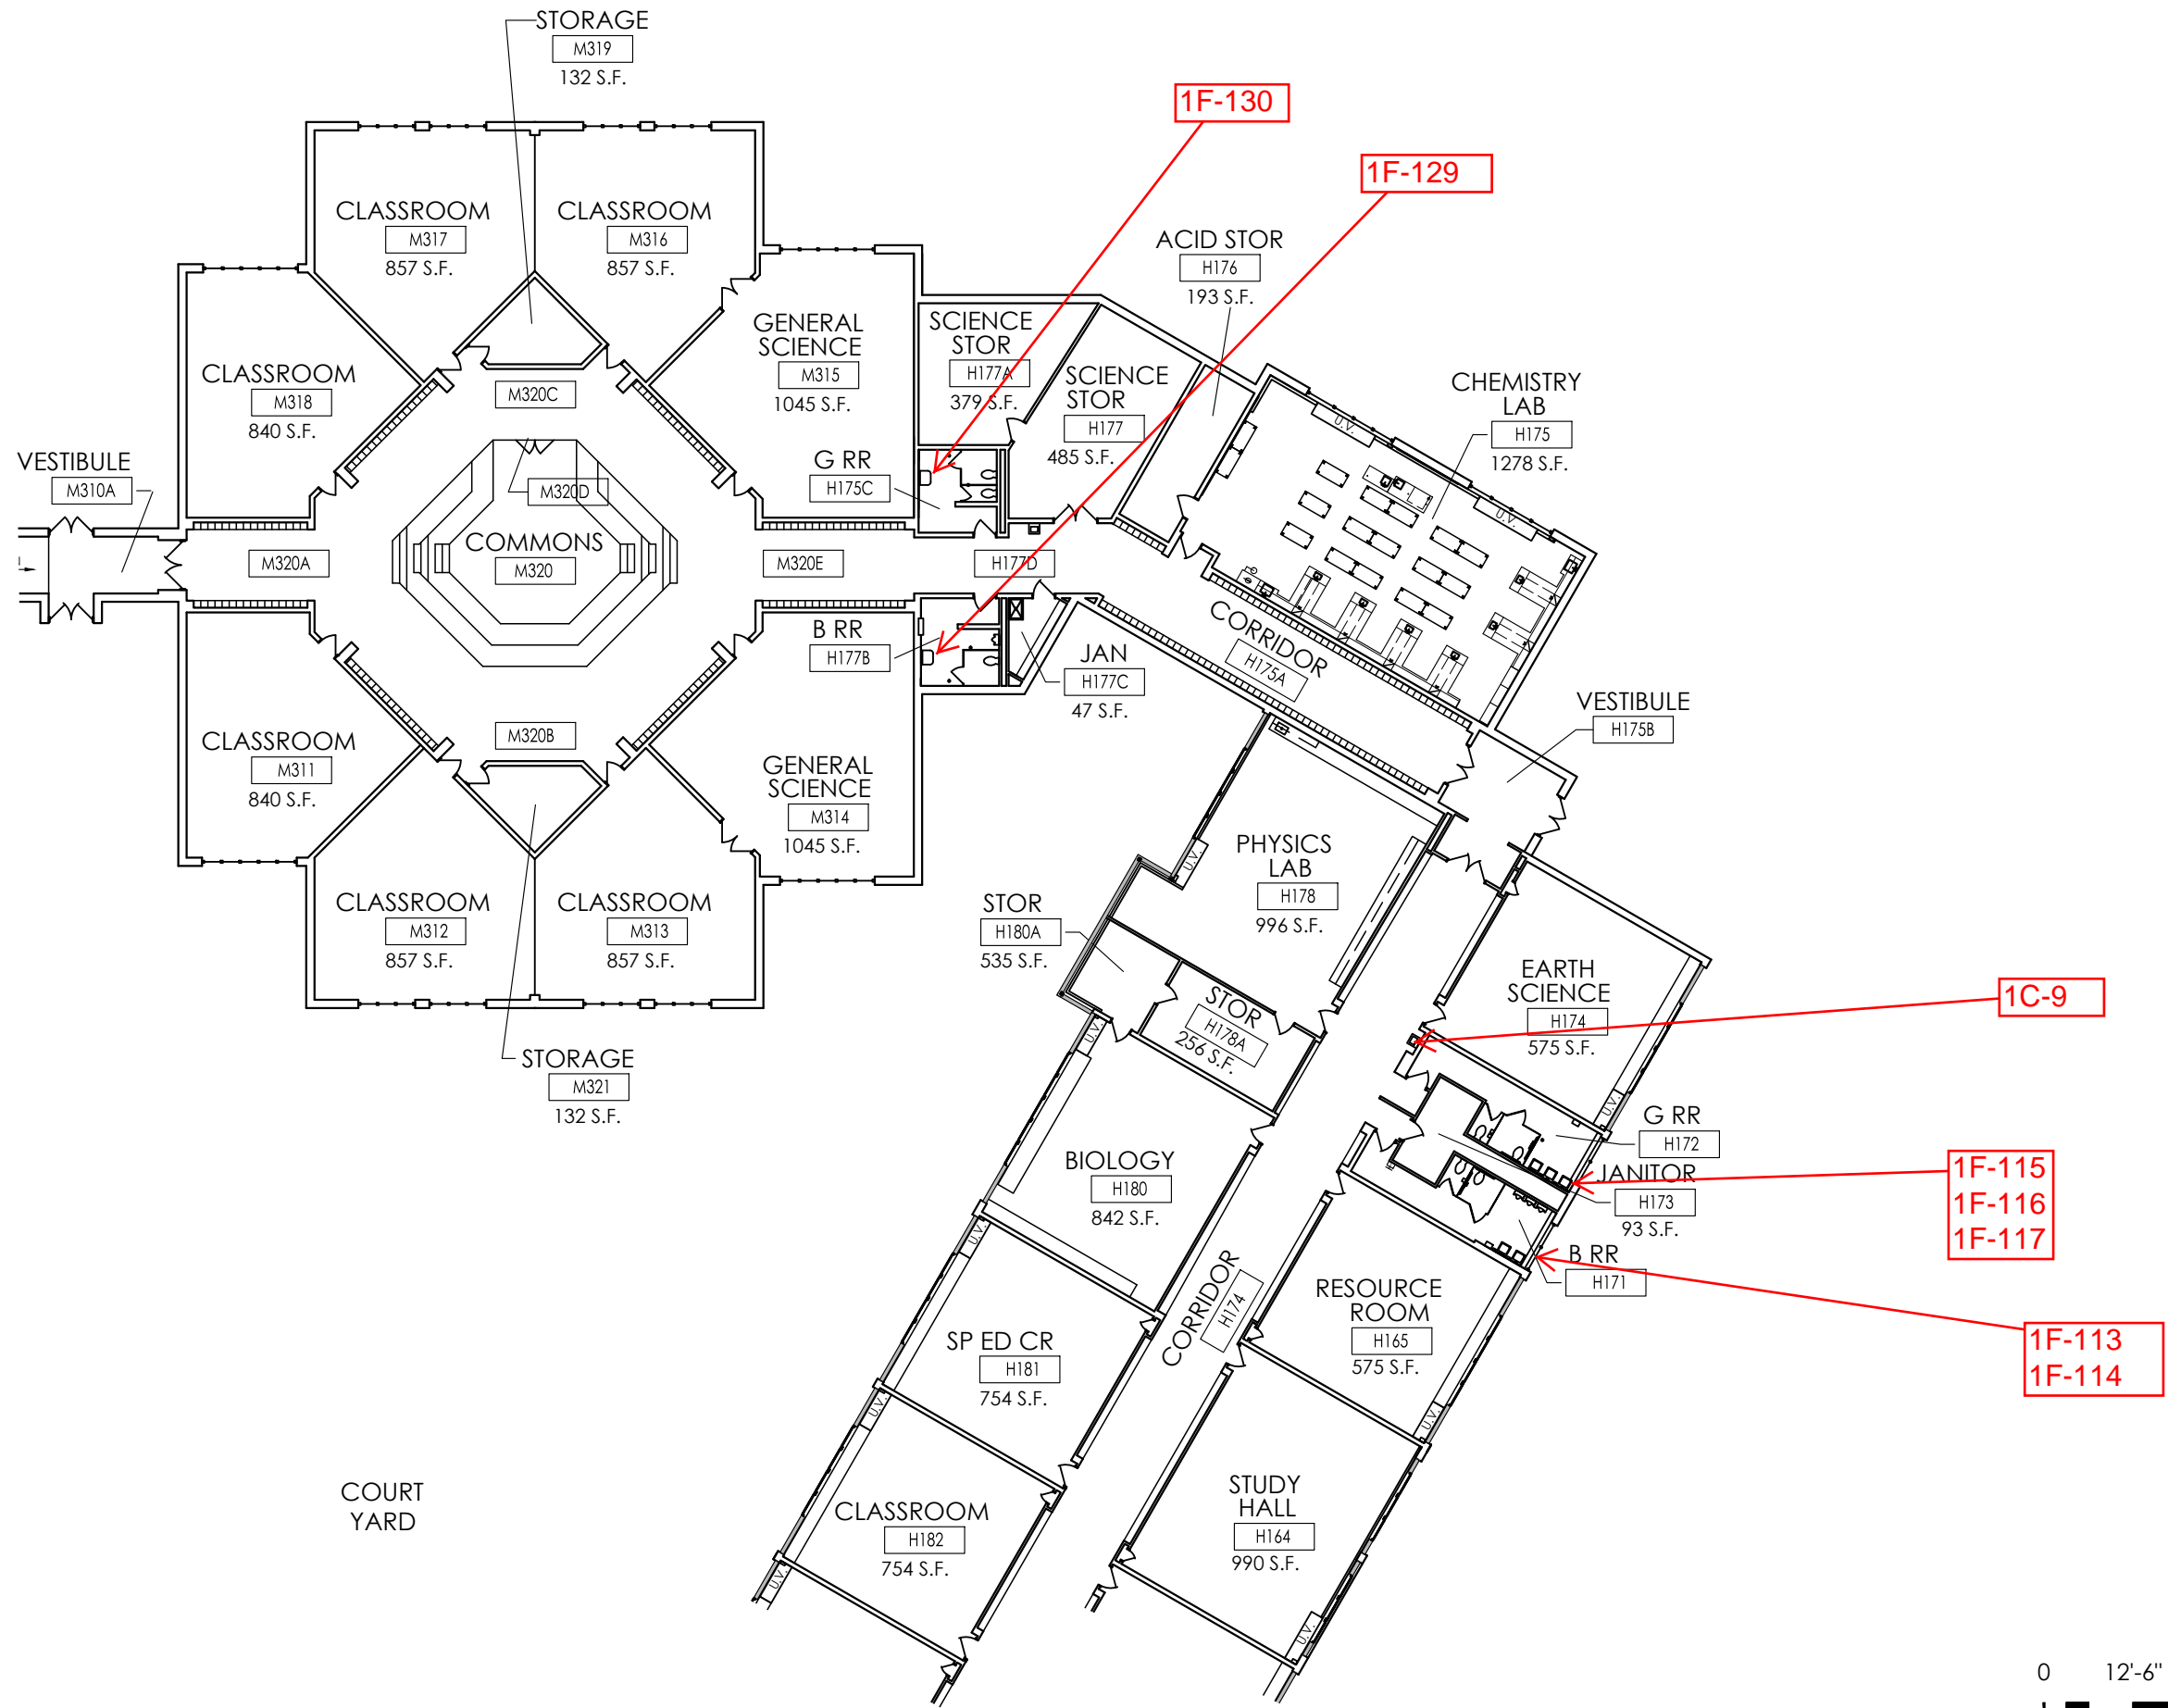

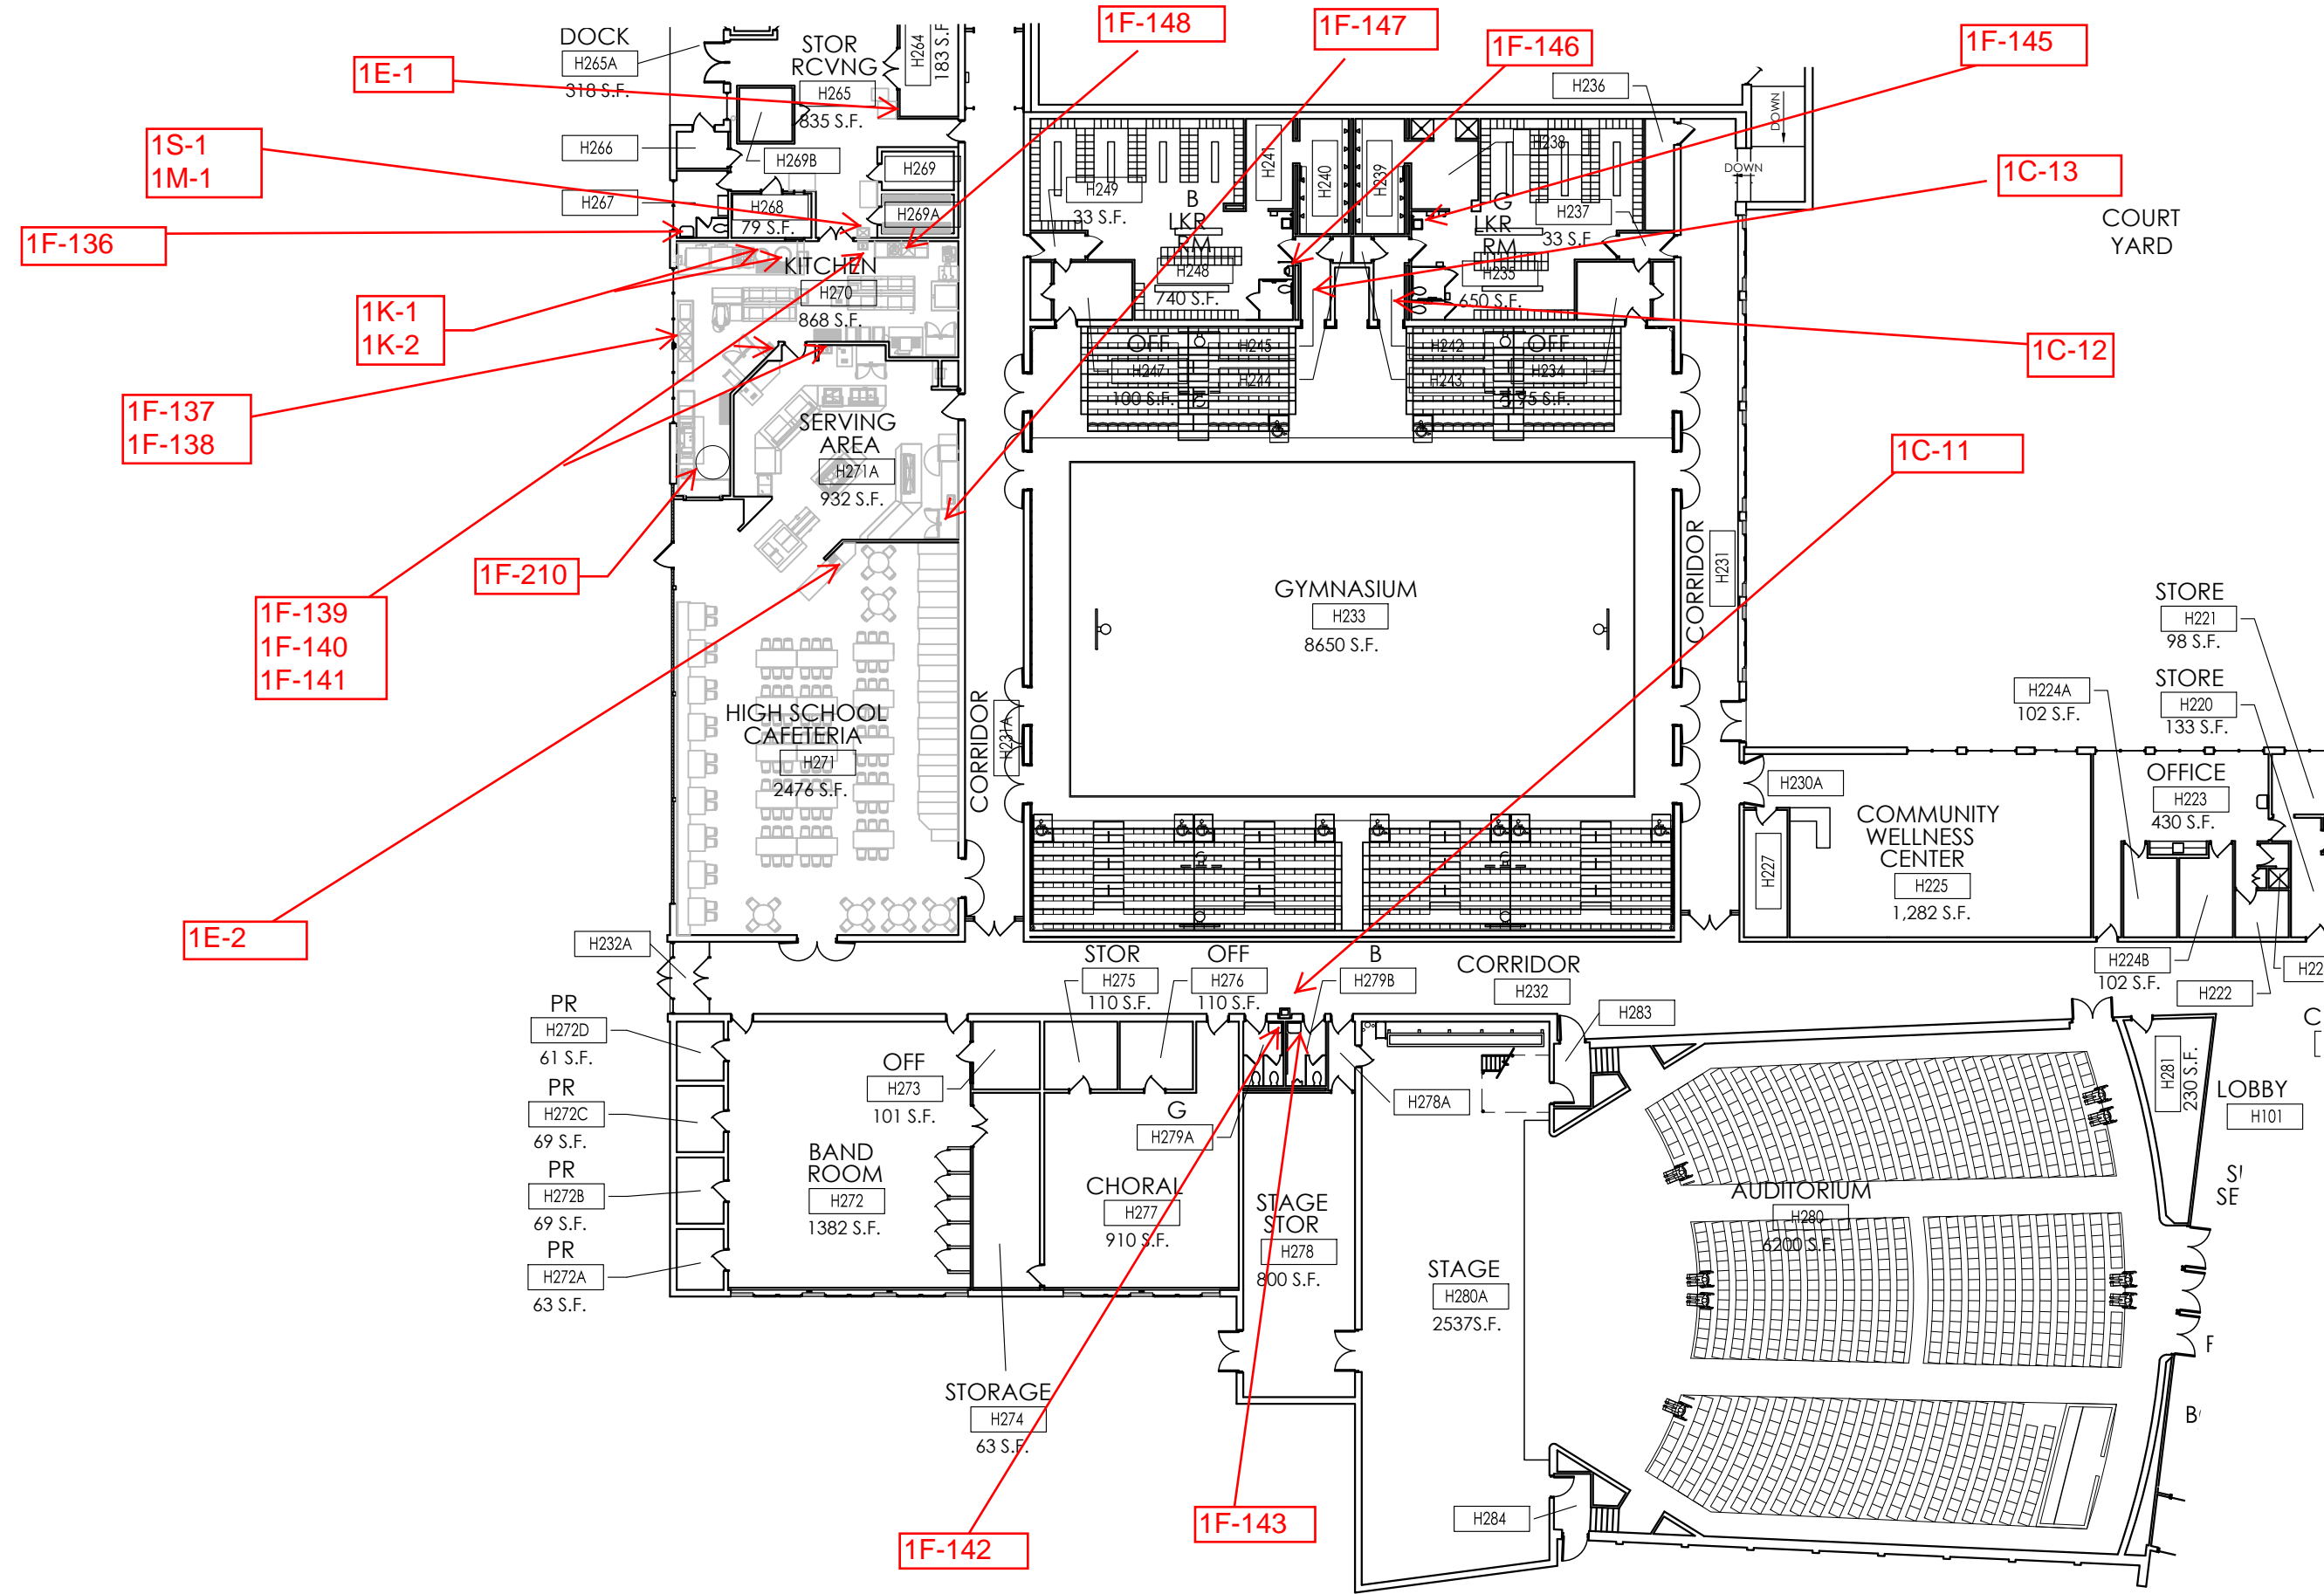

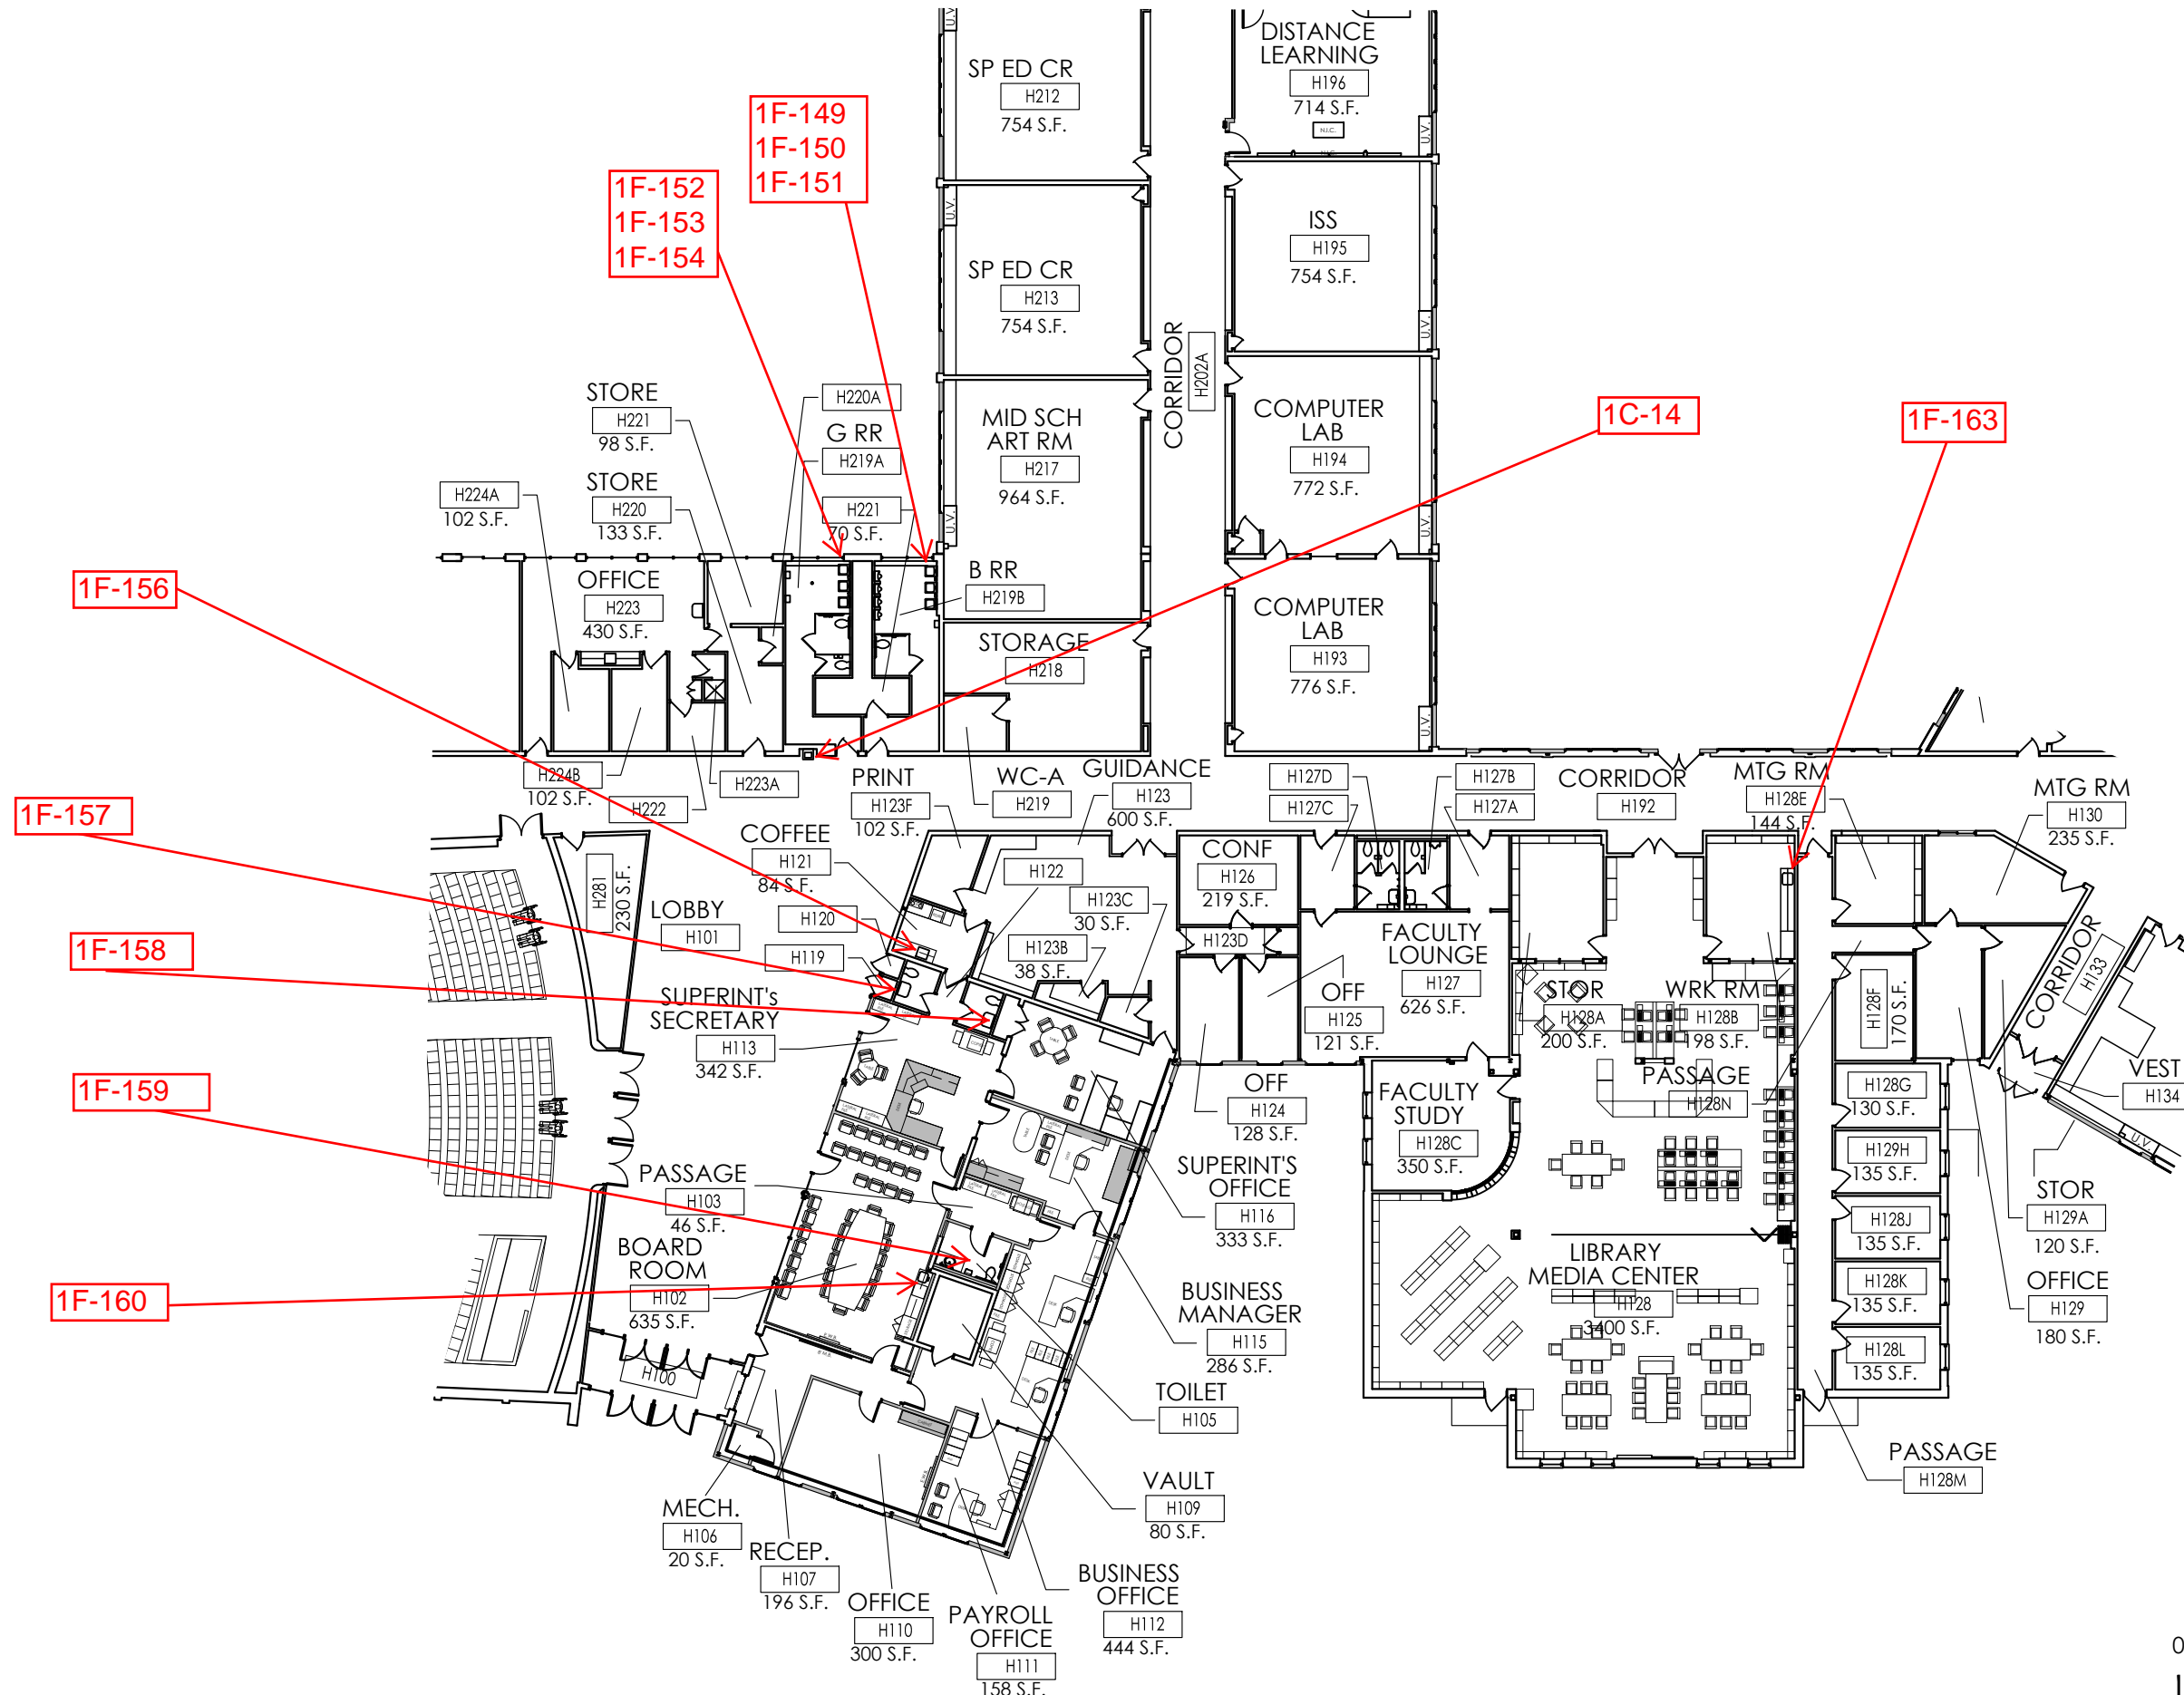

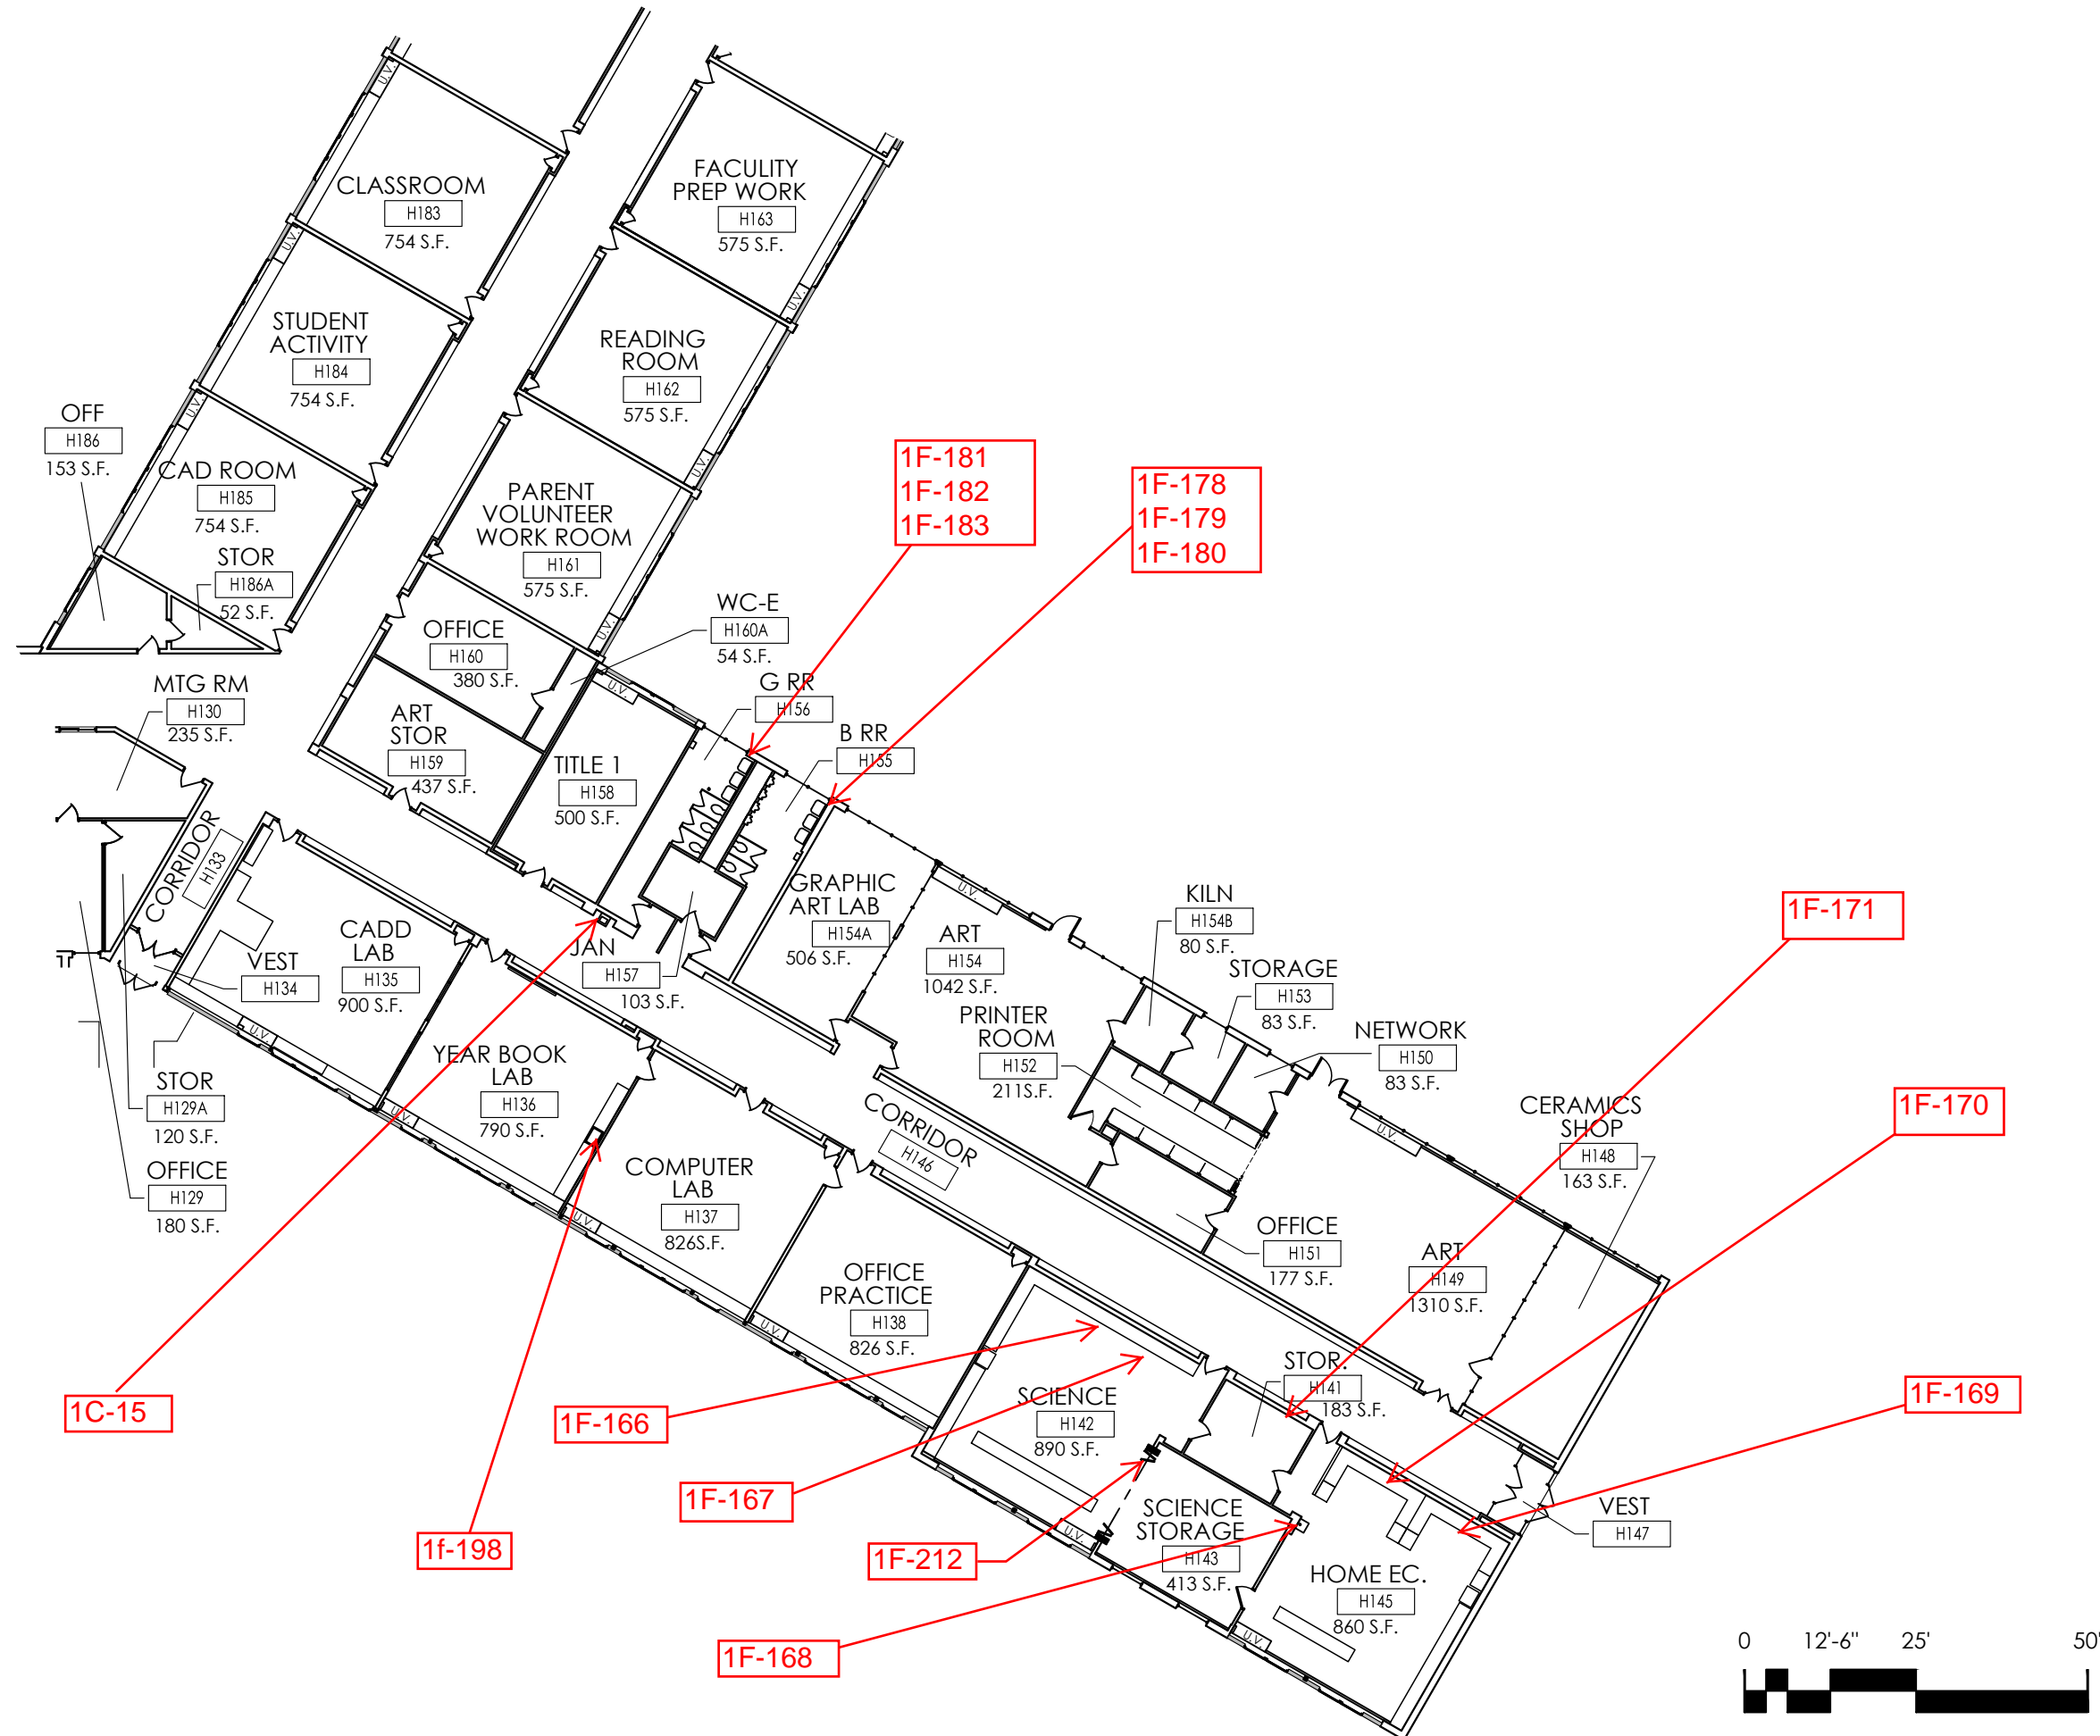

OFF
H186
153 S.F.

CLASSROOM
H183
754 S.F.

FACILITY
PREP WORK
H163
575 S.F.

STUDENT
ACTIVITY
H184
754 S.F.

READING
ROOM
H162
575 S.F.

1F-181
1F-182
1F-183

1F-178
1F-179
1F-180

CAD ROOM
H185
754 S.F.

PARENT
VOLUNTEER
WORK ROOM
H161
575 S.F.

OFFICE
H160
380 S.F.

WC-E
H160A
54 S.F.

MTG RM
H130
235 S.F.

ART
STOR
H159
437 S.F.

TITLE 1
H158
500 S.F.

G RR
H156

B RR
H155

CORRIDOR
H133

CADD
LAB
H135
900 S.F.

JAN
H157
103 S.F.

GRAPHIC
ART LAB
H154A
506 S.F.

ART
H154
1042 S.F.

KILN
H154B
80 S.F.

STORAGE
H153
83 S.F.

NETWORK
H150
83 S.F.

STOR
H129A
120 S.F.

OFFICE
H129
180 S.F.

YEAR BOOK
LAB
H136
790 S.F.

COMPUTER
LAB
H137
826 S.F.

PRINTER
ROOM
H152
211 S.F.

OFFICE
H151
177 S.F.

CERAMICS
SHOP
H148
163 S.F.

1C-15

1F-166

1F-167

1F-198

1F-212

1F-168

1F-171

1F-170

1F-169


SCIENCE
H142
890 S.F.


STOR
H141
183 S.F.


SCIENCE
STORAGE
H143
413 S.F.


HOME EC.
H145
860 S.F.

VEST
H147



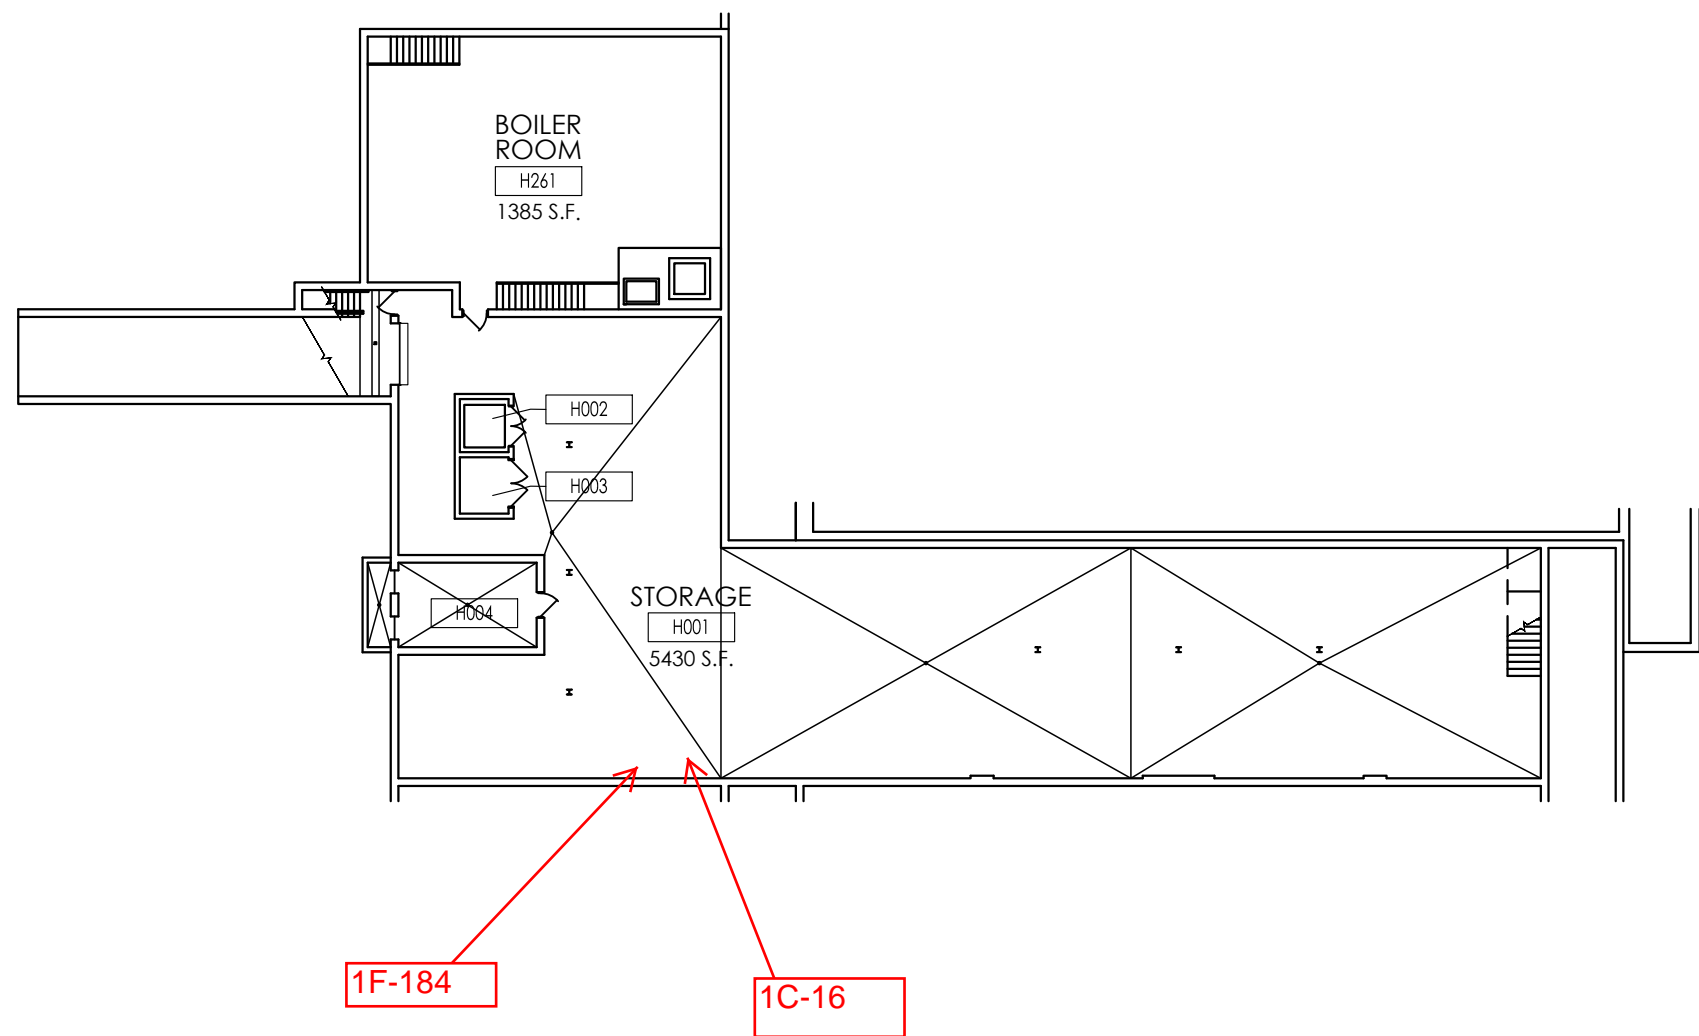

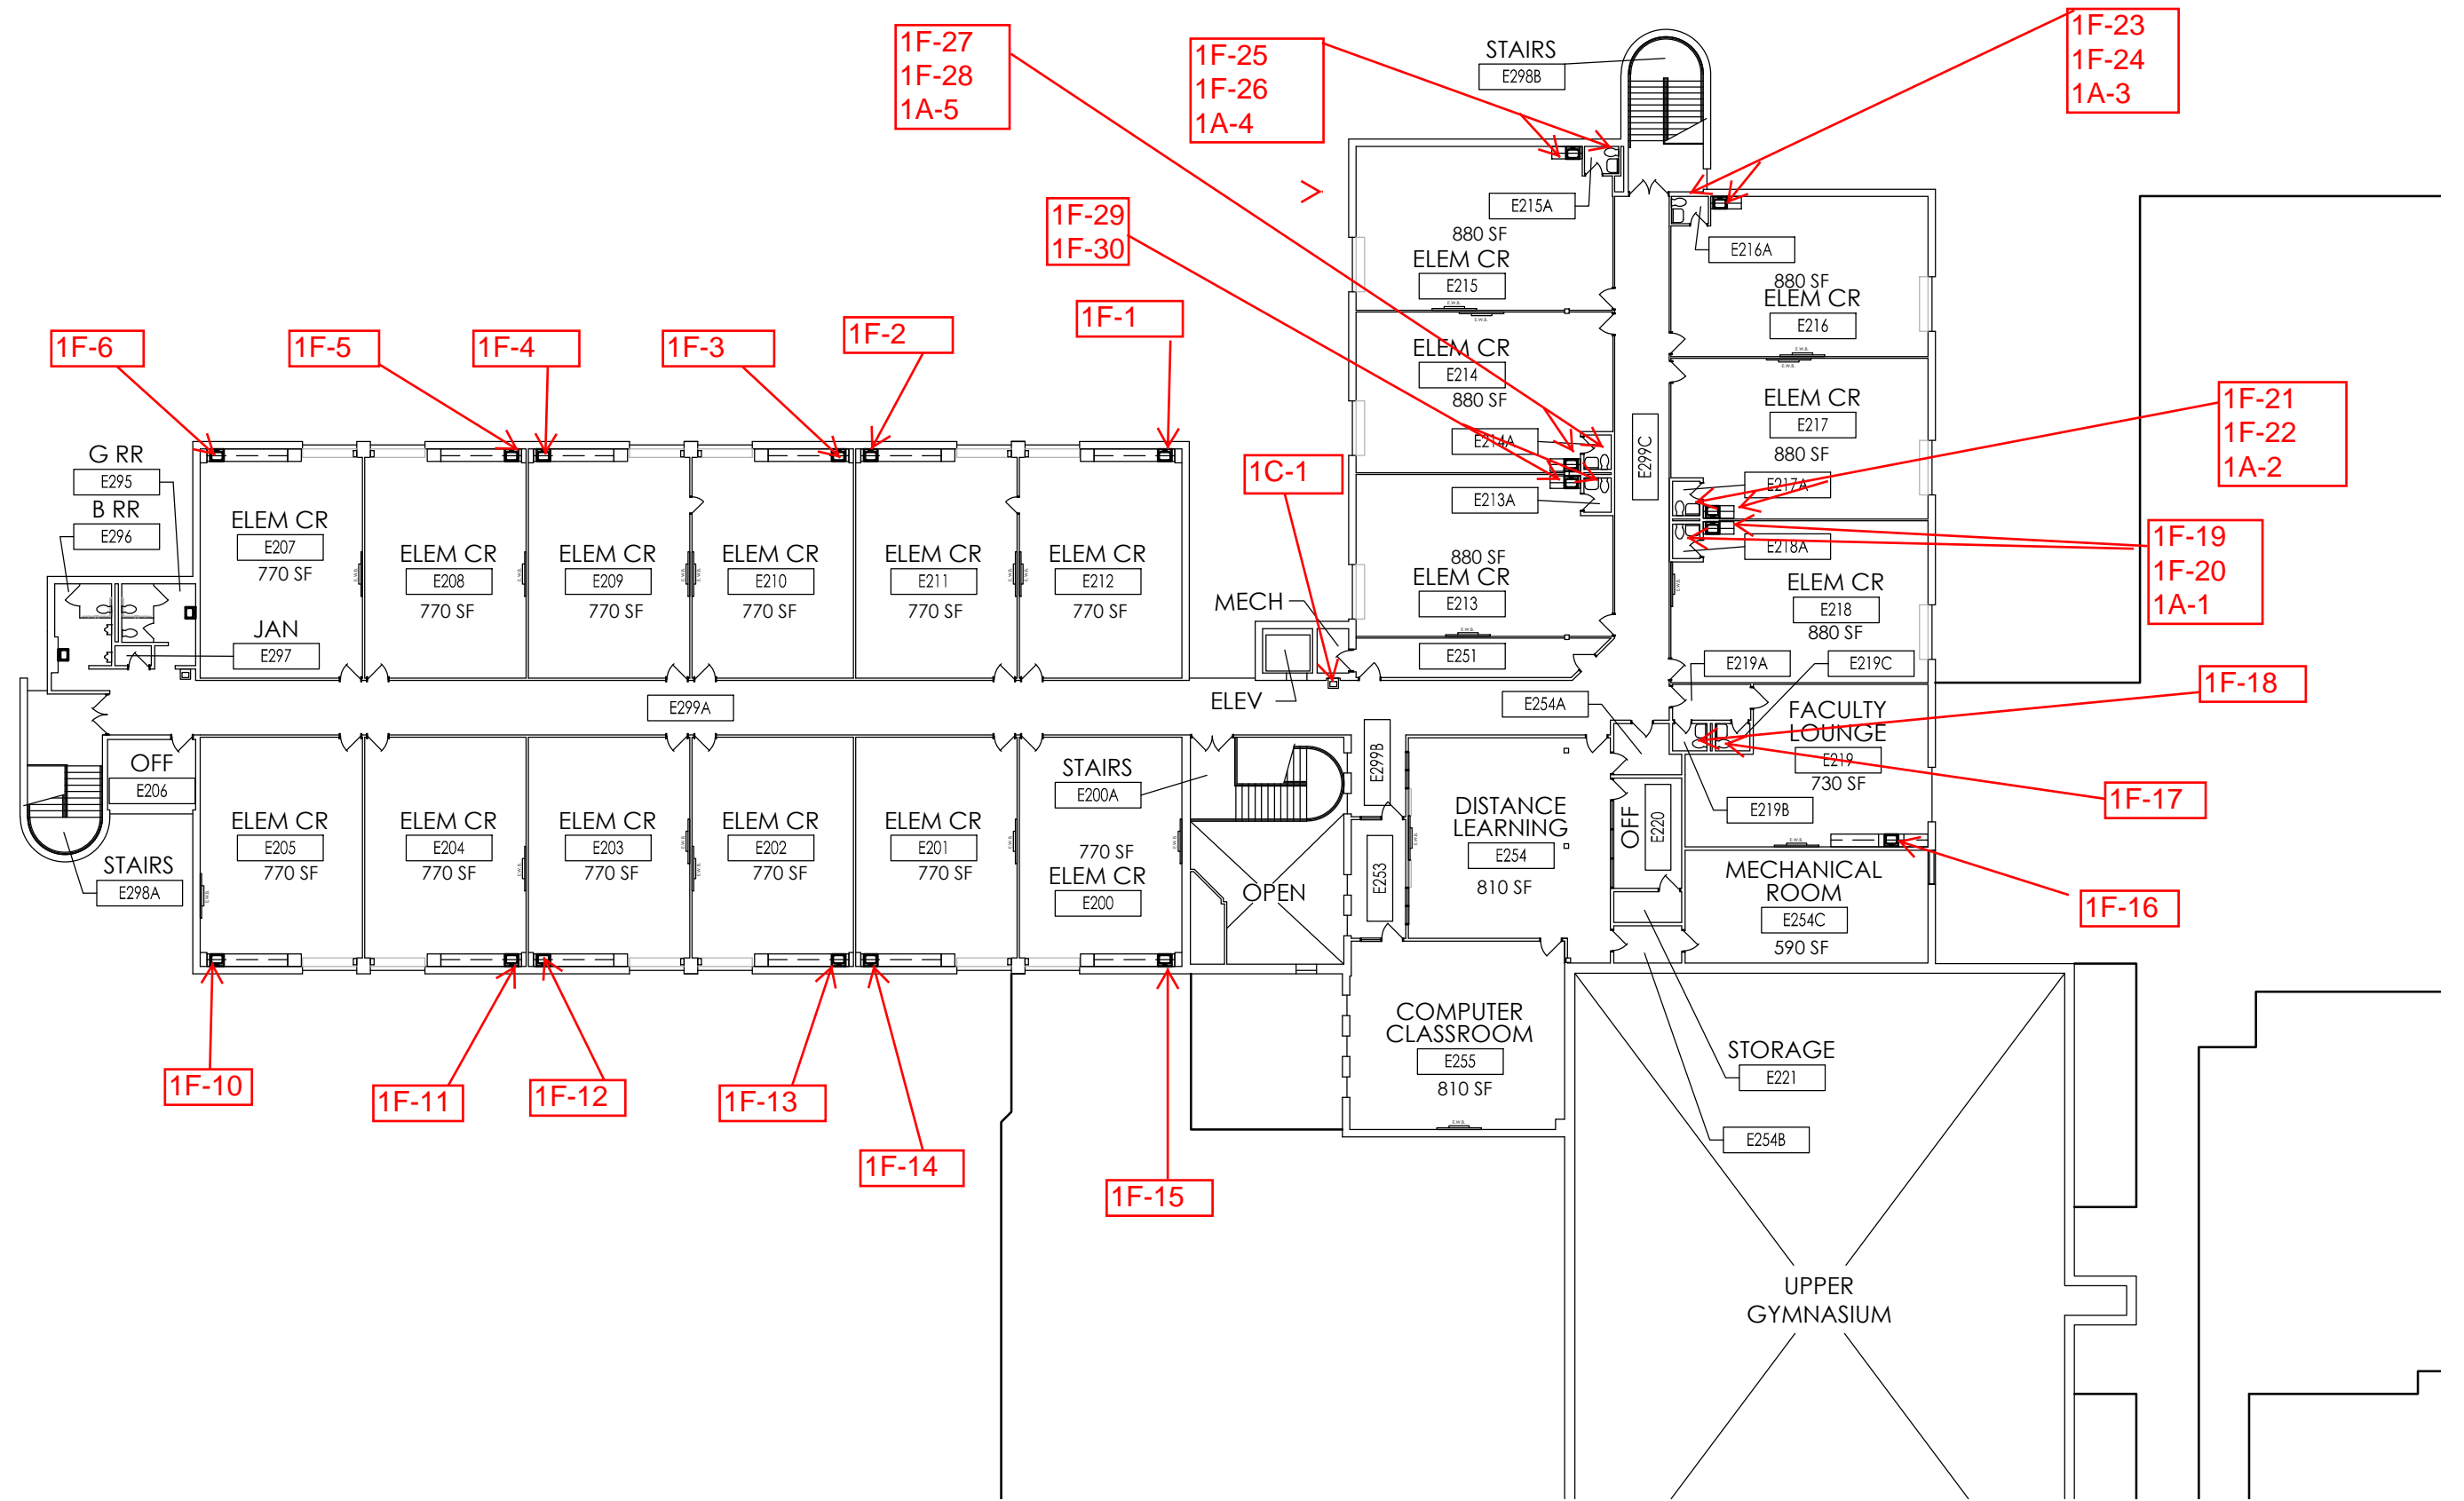

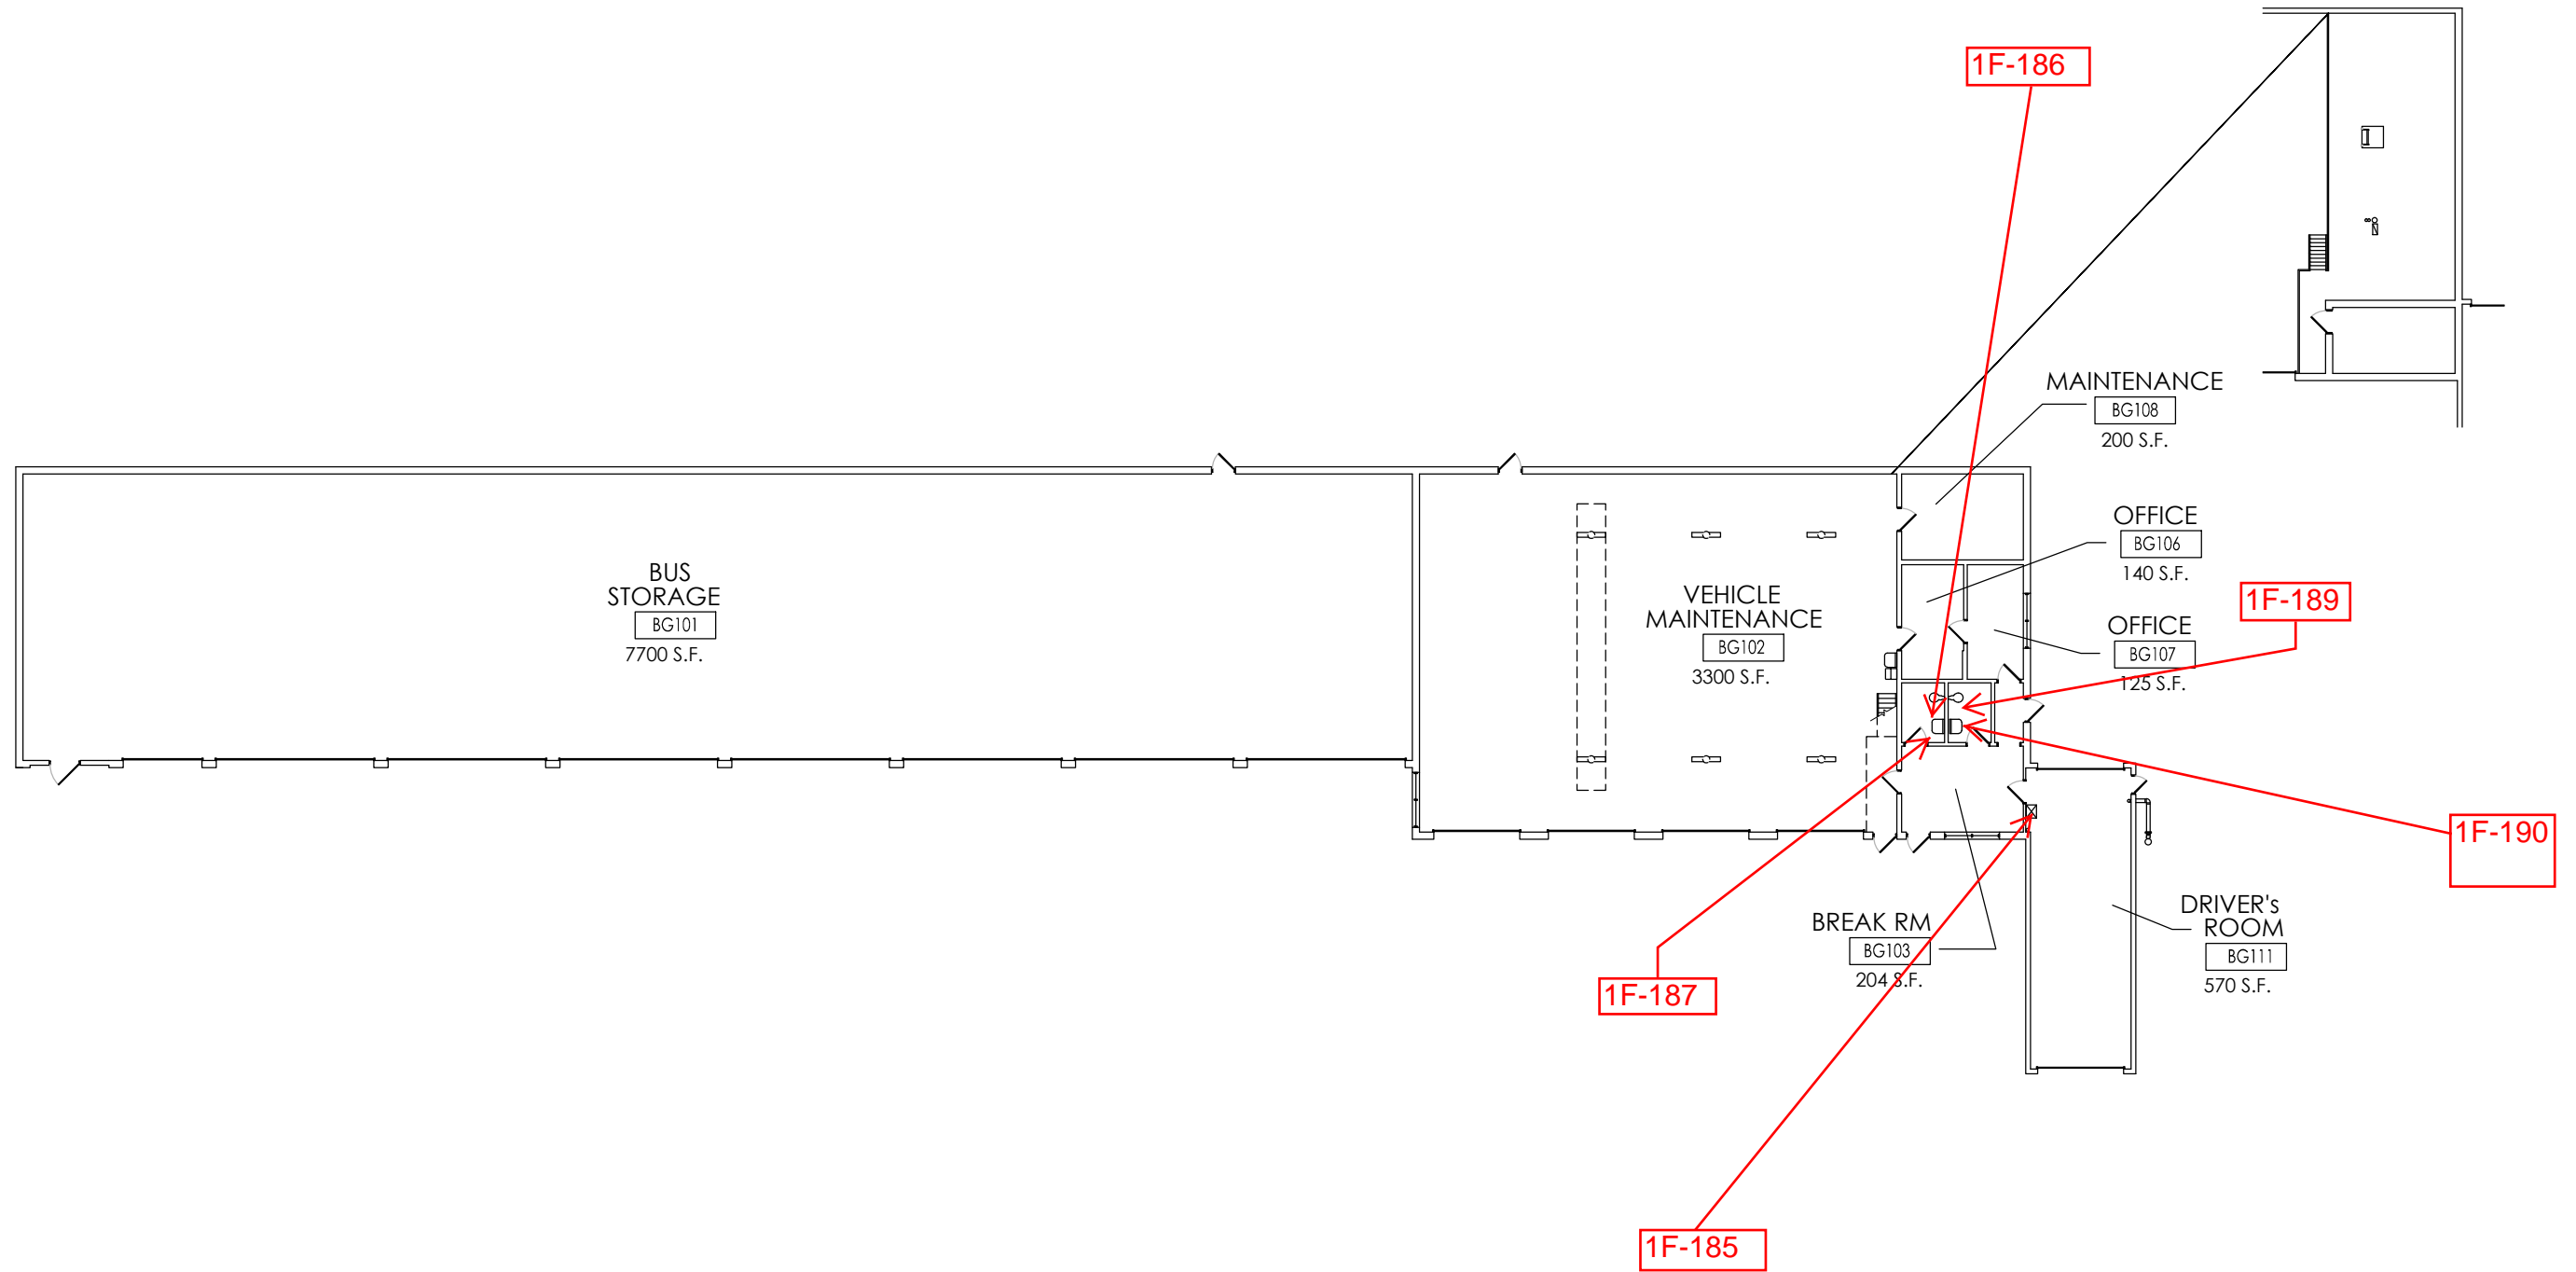

Appendix C

Licenses and Certifications

United States Environmental Protection Agency

This is to certify that

Labella Associates, D.P.C.

has fulfilled the requirements of the Toxic Substances Control Act (TSCA) Section 402, and has received certification to conduct lead-based paint activities pursuant to 40 CFR Part 745.226

In the Jurisdiction of:

All EPA Administered Lead-based Paint Activities Program States, Tribes and Territories


This certification is valid from the date of issuance and expires September 26, 2021

LBP-2226-1

Certification #

September 04, 2018

Issued On



Michelle Price, Chief

Lead, Heavy Metals, and Inorganics Branch





UNITED STATES ENVIRONMENTAL PROTECTION AGENCY
WASHINGTON, D.C. 20460

September 04, 2018

Ryan Burke
Labella Associates, D.P.C.
300 State Street
Rochester, NY 14614

OFFICE OF CHEMICAL SAFETY
AND POLLUTION PREVENTION

Dear Ryan Burke:

Thank you for applying to the U.S. Environmental Protection Agency (EPA) for certification to conduct Lead-based Paint Activities in target housing and child-occupied facilities. I am pleased to inform you that, pursuant to 40 CFR Part 745, Subpart L, your lead-based paint activities firm is certified. Your certificate is enclosed.

This certification **expires on September 26, 2021 and is valid in All EPA Administered States, Tribes, and Territories**. However, if a State in which you are certified obtains program authorization during the term of this certification, the scope of your certification will be diminished to exclude the affected area.

Your EPA firm certification is subject to the following restrictions:

- 1) Individual states and Indian tribes, whether authorized or not, are not required to accept EPA certification and may accept or reject it under its own authority. Please be aware that your EPA certification does not relieve you of any obligations you may have to any State or Indian tribe regarding lead-based paint activities.
- 2) EPA certification is specific and limited as described above. If you wish to obtain certification in other lead-based paint disciplines, you must apply separately.
- 3) In advertising the EPA certification, firms must indicate clearly that the firm is certified only for purposes of Section 402 of TSCA. Failure to accurately state EPA certification conditions could result in EPA suspending or withdrawing certification.
- 4) EPA may conduct audits and/or inspections to ensure continued compliance with regulatory standards, and may revoke or suspend its certification if subsequent alterations or deviations result with the firm no longer meeting the standards found at 40 CFR Part 745, Subpart L.

If you have questions about the lead-based paint activities rule or need assistance, please contact the Regional Lead Coordinator, Vickie Pane, of the EPA Region 2 staff at 732-321-6671. If you have any questions about your firm certification, please contact the National Lead Information Center at 1-800-424-LEAD and refer to **Application ID number A596628**. Congratulations, and thank you for your interest in being a certified abatement firm.

Sincerely,

A handwritten signature in black ink that reads "Michelle Price".

Michelle Price, Chief
Lead, Heavy Metals, and Inorganics Branch

Enclosures

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2021
Issued April 01, 2020

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. FAYEZ ABOUZAKI
SCHNEIDER LABORATORIES GLOBAL, INC
2512 WEST CARY STREET
RICHMOND, VA 23220-5117

NY Lab Id No: 11413

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Metals I

Lead, Total

EPA 200.9 Rev. 2.2



Serial No.: 61370

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

