



Tony Baldwin, Ed.D., Superintendent

175 Bingham Road, Asheville, NC 28806
P 828.255.5921 F 828.255.5923
www.buncombe.k12.nc.us

ADDENDUM #2

APRIL 4, 2016

TRANSMITTED VIA EMAIL: 2 pages

TO: ALL PLAN HOLDERS AND POTENTIAL BIDDERS
FROM: RON VENTURELLA, PURCHASING OFFICER *RV*
SUBJECT: SYNTHETIC TURF FIELD REPLACEMENT
ERWIN & OWEN HIGH SCHOOLS
(RFP# 07-16)

The following changes, revisions, additions, and/or clarifications to the plans and/or specifications are hereby made a part of the original documents. **Be sure to acknowledge this addendum on the proposal sheet.**

Addendum # 2
RFP #07-16

TO ALL PROSPECTIVE BIDDERS

Synthetic Turf Field Replacement
CHA Consulting, Inc. – Project No.: 31080

Bid Date: April 8, 2016, 2:00 p.m. (Local Time)

Bid Submittal: Buncombe County Schools
175 Bingham Road
Asheville, NC 28806

Bid Opening: Buncombe County Schools
175 Bingham Road
Asheville, NC 28806

ADDENDUM NUMBER TWO

This **ADDENDUM**, issued prior to receipt of bids, shall and does hereby become part of the Contract Documents for the referenced Project. All Prime Contractors shall be responsible for ensuring that their Subcontractors are properly aware of

the content of this **ADDENDUM**. All information contained herein shall take precedence over any conflicting information in the original Project Manual and Drawings, dated March 16, 2016.

QUESTIONS FROM BIDDERS:

1. None.

REVISIONS TO PROJECT MANUAL:

1. Section 321813 SYNTHETIC TURF PLAYING FIELD SYSTEM: Revise section per following notation:
 - A. 2.3, A., 2.: Minimum yarn denier shall be 8,000.
 - B. 2.3, B., Pre-approved Infill Synthetic Turf Systems:
 6. Hellas Construction - Velocity

REVISIONS TO DRAWINGS:

1. Erwin High School; Sheet SR-100: Field Site Plan:
 - A. Revise drawing per figure SR-100.01, as attached herein.
2. Erwin High School; Sheet SR-150: Field Utility Plan:
 - A. Revise drawing per figure SR-150.01, as attached herein.

ATTACHMENTS:

1. Construction Drawing Figure SR-100.01
2. Construction Drawing Figure SR-150.01

END OF ADDENDUM #2

SYNTHETIC TURF FIELD REPLACEMENT - ERWIN & OWEN HIGH SCHOOLS (RFP# 07-16)

1
APPROXIMATE LOCATION EX. 8" HDPE
PER RECORD DRAWINGS (DATED
MARCH 12, 2007) – POTHOLE
EXCAVATE FOR PIPE LOCATION,
INSTALL NYLOPLAST INLINE DRAIN
ADAPTER
(TYPICAL – 4 LOCATIONS EACH SIDE)

4
SR-100

4
SR-100

FIELD VERIFY CROSSBAR
AT 10' ABOVE FG OF
PLAYING SURFACE
2198.08

1

4
SR-100

Drawing Copyright © 2016

CHIA

811 West Hargett Street
Raleigh, NC 27603
919.436.2280 • www.chacompanies.com


ADDENDUM NUMBER TWO SYNTHETIC TURF FIELD REPLACEMENT

CLYDE A. ERWIN HIGH SCHOOL
60 LEES CREEK ROAD
ASHEVILLE, NC 28806

PROJECT NO.
31080

DATE: 04/04/16

FIG: SR-100.01

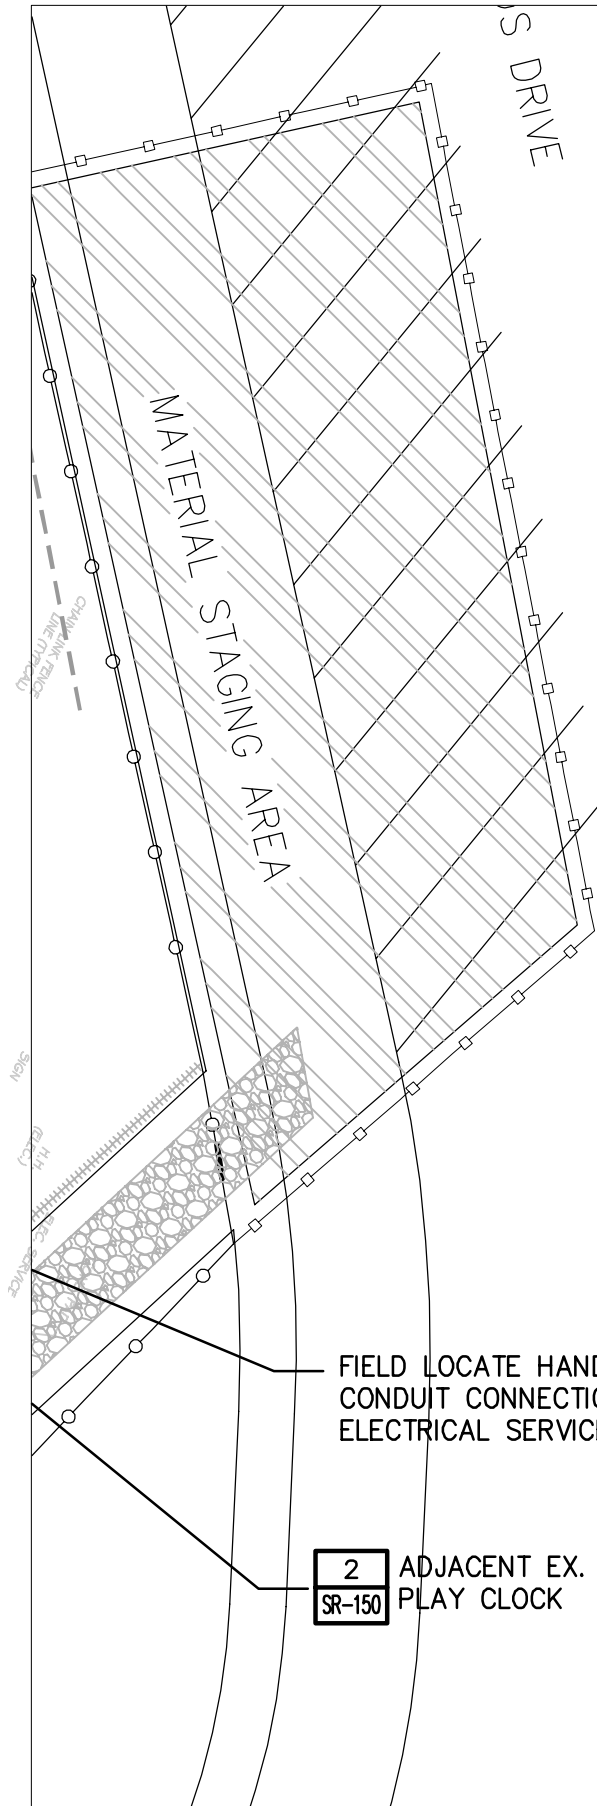

ELECTRICAL NOTES:

1. PROVIDE (3) 20A/1P CIRCUIT BREAKERS IN THE EXISTING PANEL AT NORTHEAST CORNER OF FIELD.
2. PROVIDE DUPLEX GFI RECEPTACLE IN EACH COMBOX HALF-BOX AT HOME SIDE 30-YARD LINE AND PLAY CLOCK.
3. PROVIDE A DOUBLE DUPLEX GFI RECEPTACLE IN EACH COMBOX AT MIDFIELD ON EACH SIDE.
4. WIRE HOME SIDE RECEPTACLES TO ONE (1) CIRCUIT.
5. WIRE VISITOR SIDE RECEPTACLES TO ONE (1) CIRCUIT.
6. WIRE PLAY CLOCK RECEPTACLES TO ONE (1) CIRCUIT.
7. PROVIDE (2) #8 AND (1) #8G FOR EACH OF THE 3 CIRCUITS

1

FIELD LOCATE HAND HOLE FOR
CONDUIT CONNECTION TO EXISTING
ELECTRICAL SERVICE

2 ADJACENT EX.
SR-150 PLAY CLOCK

Drawing Copyright © 2016



811 West Hargett Street
Raleigh, NC 27603
919.436.2280 · www.chacompanies.com

**ADDENDUM NUMBER TWO
SYNTHETIC TURF FIELD REPLACEMENT**

CLYDE A. ERWIN HIGH SCHOOL
60 LEES CREEK ROAD
ASHEVILLE, NC 28806

PROJECT NO.
31080

DATE: 04/04/16

FIG: SR-150.01