

Collins Architectural Group, p.s.
950 12th Avenue, Suite 200
Longview, WA 98632

Addendum No. 2

Page No. 1 of 2

Date: May 3RD, 2019

**Project: Kelso School District No. 458
Kelso High School Boiler Replacements
Kelso, WA**

Notice to Contractor:

The following changes in the Contract Documents, including the Drawings and Specifications, constitute this Addendum. All changes included in Addenda shall become a part of the Contract Documents for this Project. Any changes herein offset only the specific Drawings or Notes on Drawings or words or paragraphs in Specifications referenced to and the balance of the Drawings shall remain in full force.

ARCHITECTURAL SPECIFICATION:


<u>ITEM</u>	<u>SHEET NO./ SECTION NO.</u>	<u>DESCRIPTION</u>
2.0	MT0.1	On the drawing index, DELETE reference to E2.1. The reference to E3.1 should read "Partial Plans Electrical."
2.1	M1.1	REVISE boiler equipment schedule per attached.
2.2	M3.1	See attached Sheet M3.1 with revisions clouded.
2.2	M3.1	Plan 3/M3.1 – Room 383; REVISE to 1/M3.1
2.3	M3.1	Plan 2/M3.1 – Room 368; REVISE boiler B/3 to KN-6, ROTATE boiler B/4 as required to obtain recommended clearance at front of boiler.
2.4	M3.1	Plan 3/M3.1 – Room 432; ROTATE boiler B/7 as required to obtain recommended clearance at front of boiler. MODIFY concrete housekeeping pad as required.
2.5	M3.1	Plan 4/M3.1 – Room 330; REVISE boiler B-16 to KN-6. ROTATE boiler B-15 as required to obtain recommended clearance at front of boiler. MODIFY concrete housekeeping pad as required.
2.6	M3.1	Plan 5/M3.1 – Room 213; REVISE boiler B-2 to KN-6. ROTATE boiler B-1 as required to obtain recommended clearance at front of boiler. MODIFY concrete housekeeping pad as required.

5/3/19	ADDENDUM 2
MARK	DATE
	DESCRIPTION


COLLINS
ARCHITECTURAL GROUP, P.S.
950 12th AVE., SUITE 200
LONGVIEW, WA 98632
PHONE: 360-425-0000
E-MAIL: CRAIG@COLLINSARCHGROUP.COM




**KELSO SCHOOL DISTRICT
KELSO HIGH SCHOOL
BOILER REPLACEMENT**
1904 ALLEN STREET
KELSO, WA 98626

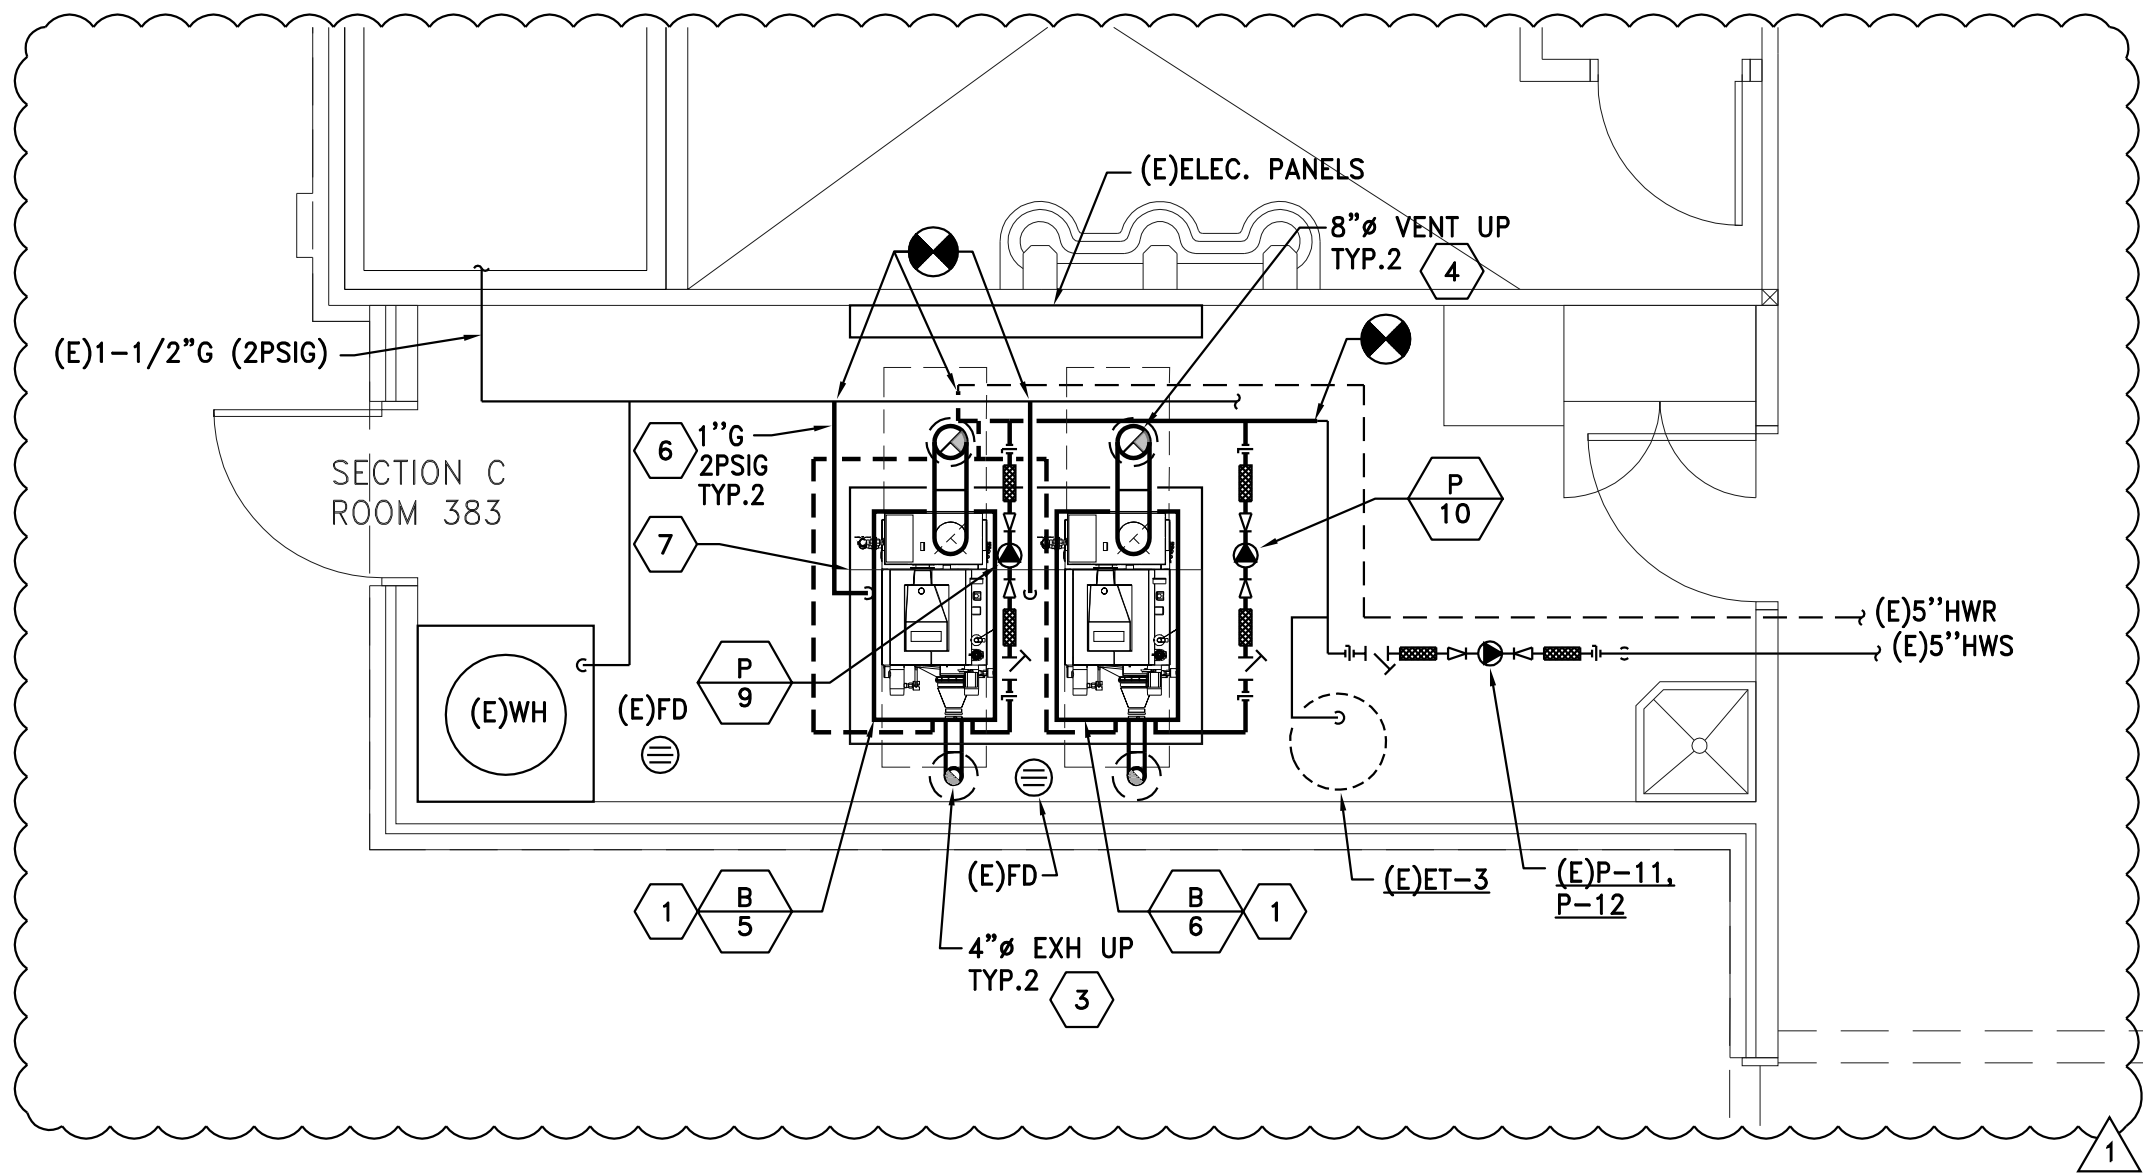

3 ENLARGED HVAC PLAN - SECTOR C - ROOM 383
M3.1 SCALE: 1/4" = 1'-0" 0 2' 4' 8'

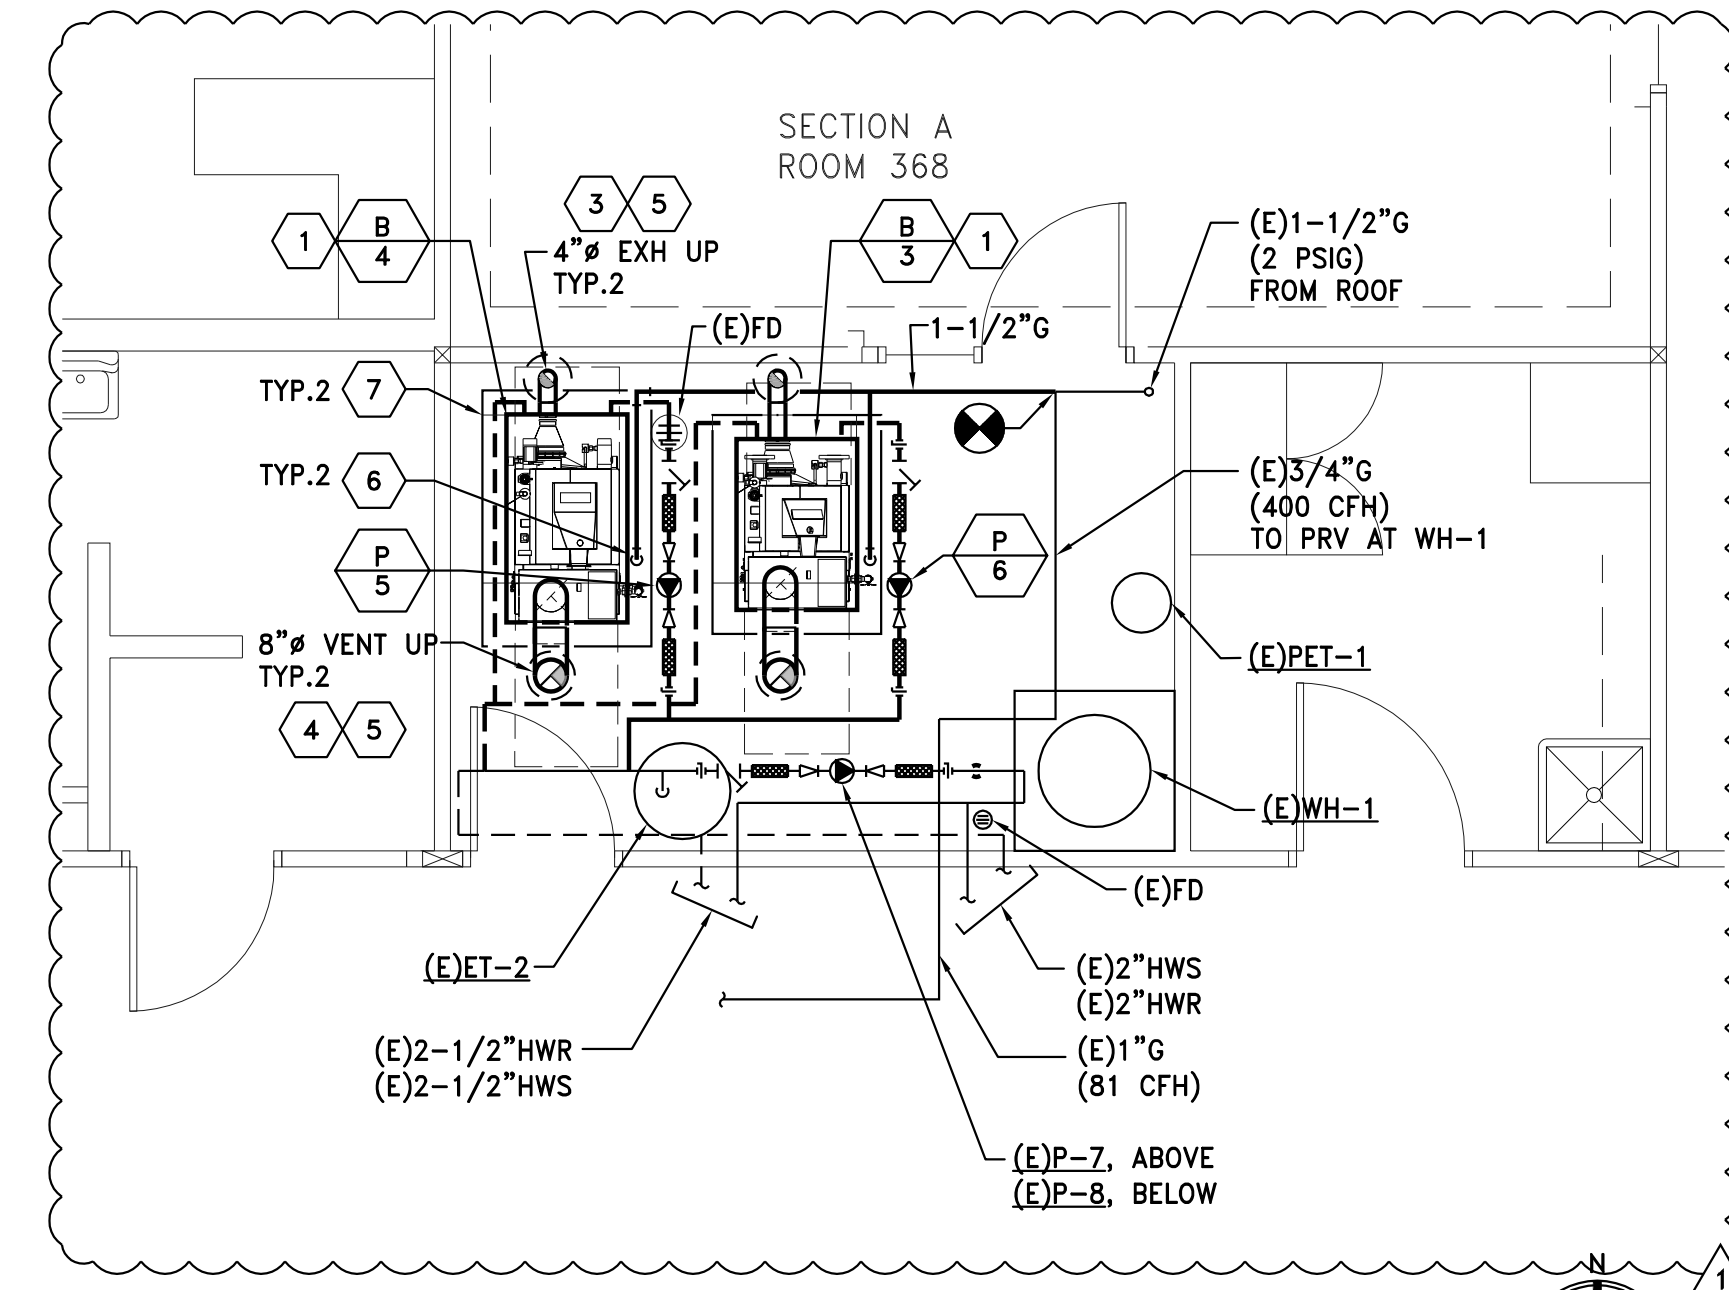


2 ENLARGED HVAC PLAN - SECTOR A - ROOM 368
M3.1 SCALE: 1/4" = 1'-0" 0 2' 4' 8'

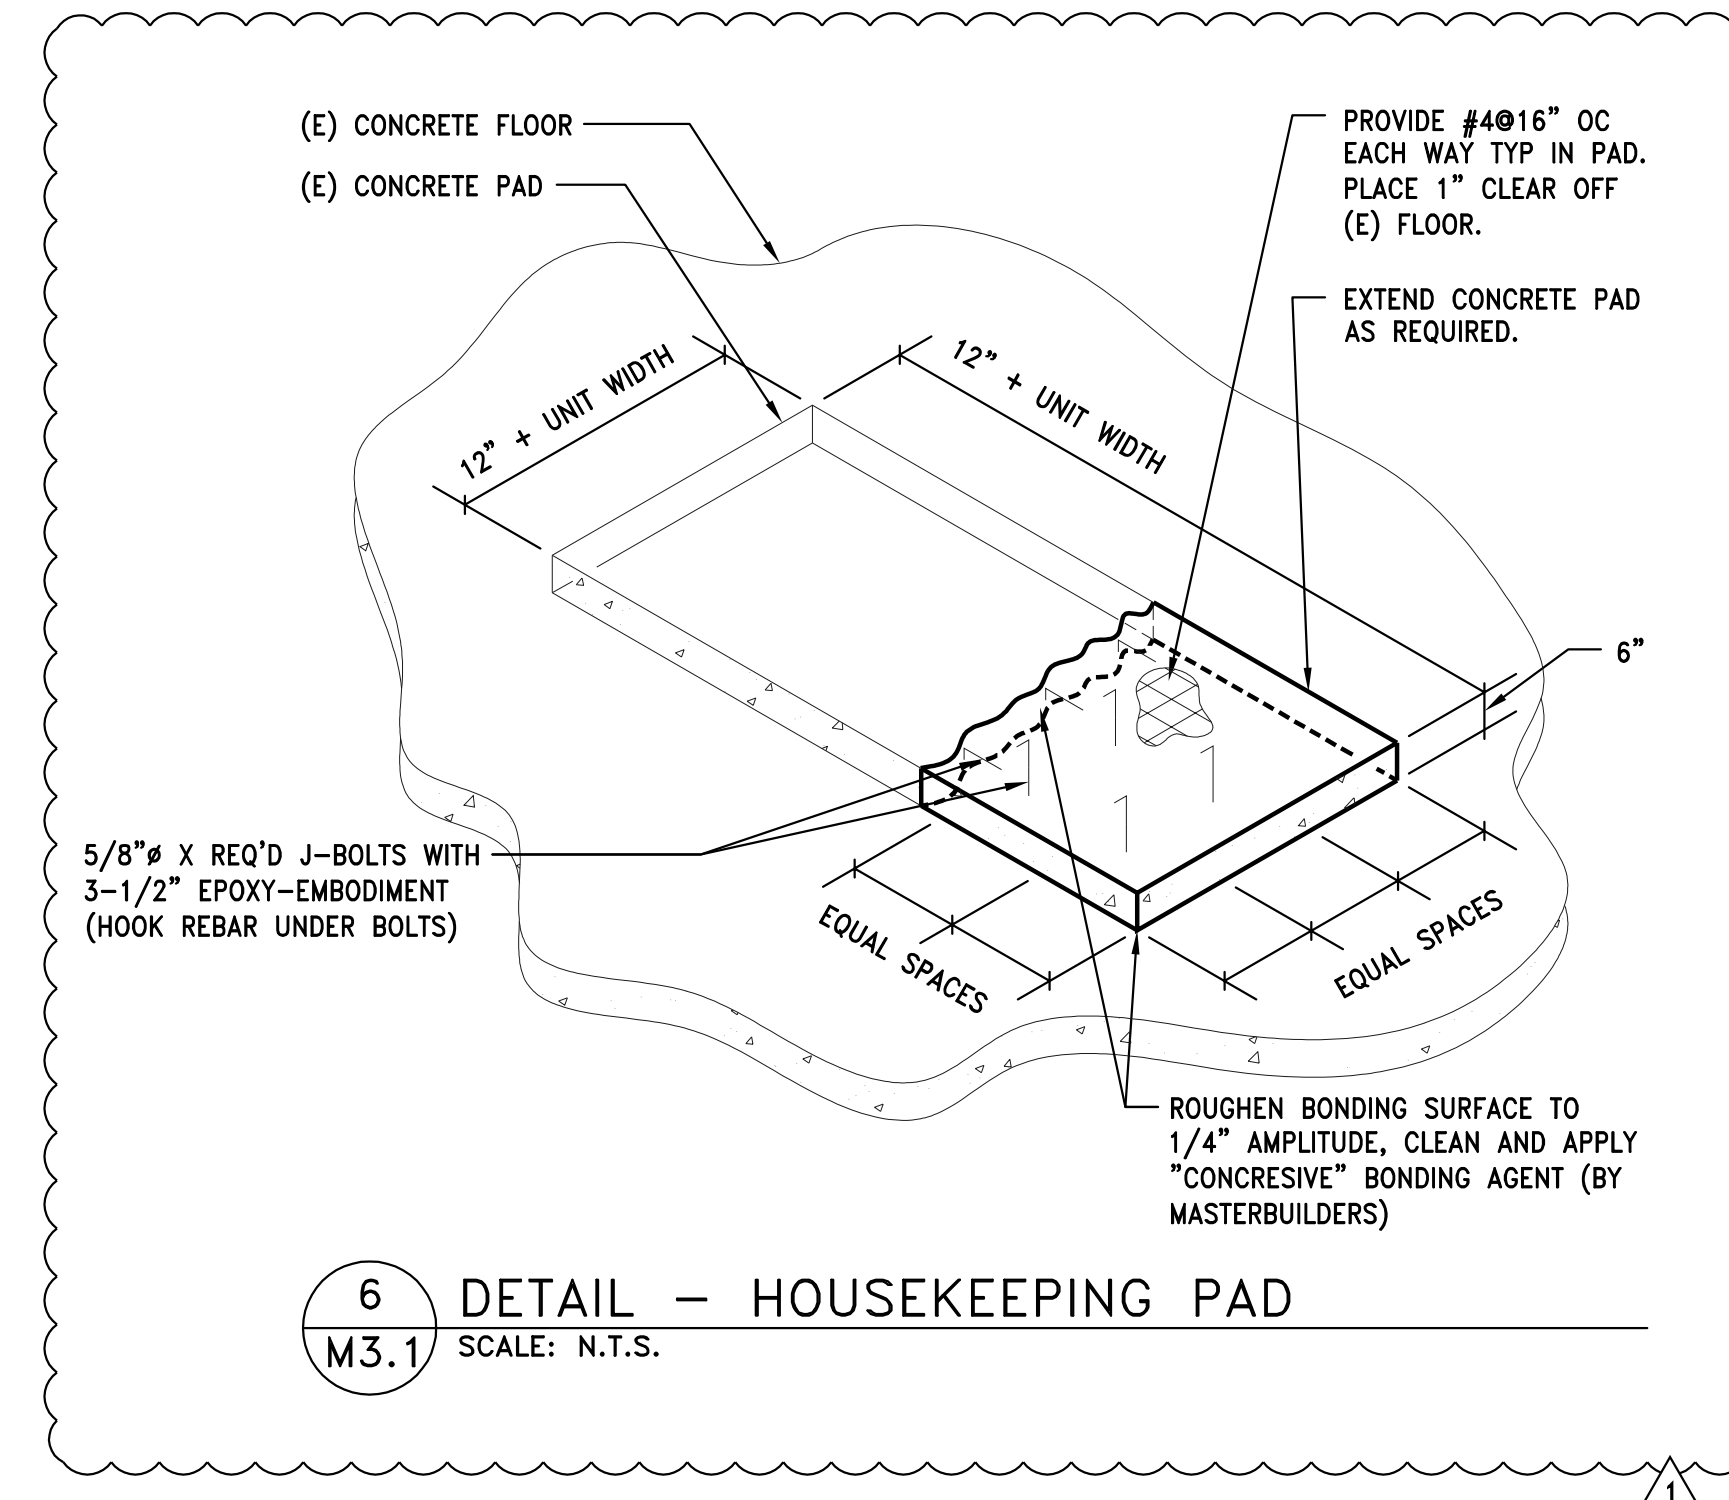


6 DETAIL - HOUSEKEEPING PAD
M3.1 SCALE: N.T.S.


- KEYED NOTES:**
- PROVIDE (N) BOILER. PROVIDE FLUE AND COMBUSTION AIR UP THROUGH ROOF. TERMINATE PER MANUFACTURER'S INSTRUCTIONS. PROVIDE HWS, HWR, G, AND APPURTENANCES PER 5/M2.1 AND 6/M2.1.
 - REINSTALL SALVAGED FIRE SPRINKLER DRY PIPE AND APPURTENANCES.
 - PROVIDE 4" FLUE VENT AND ROUTE THROUGH ROOF TO MANUFACTURER'S ROOF TERMINATION. INSTALL PER MANUFACTURER'S INSTRUCTIONS. MAINTAIN A MINIMUM OF 5 FEET BETWEEN COMBUSTION AIR AND FLUE VENT.
 - PROVIDE 8" COMBUSTION AIR VENT AND ROUTE THROUGH ROOF TO MANUFACTURER'S ROOF TERMINATION. INSTALL PER MANUFACTURER'S INSTRUCTIONS. MAINTAIN A MINIMUM OF 5 FEET BETWEEN COMBUSTION AIR AND FLUE VENT.
 - COORDINATE ROOF PENETRATION WITH CONDENSING UNIT ON ROOF ABOVE. OFFSET VENT AS NECESSARY TO MAINTAIN SERVICE CLEARANCE FOR ROOF EQUIPMENT.
 - PROVIDE 1" G TO EACH BOILER PER MANUFACTURER'S INSTRUCTIONS. PROVIDE SHUT-OFF VALVE. PROVIDE VENTED REGULATOR AND ROUTE TO EXTERIOR.
 - MODIFY EXISTING HOUSEKEEPING PAD AS REQUIRED IN ORDER TO EXTEND A MINIMUM OF 6 INCHES BEYOND BOILER IN EACH DIRECTION. REFER TO DETAIL 6/M3.1.

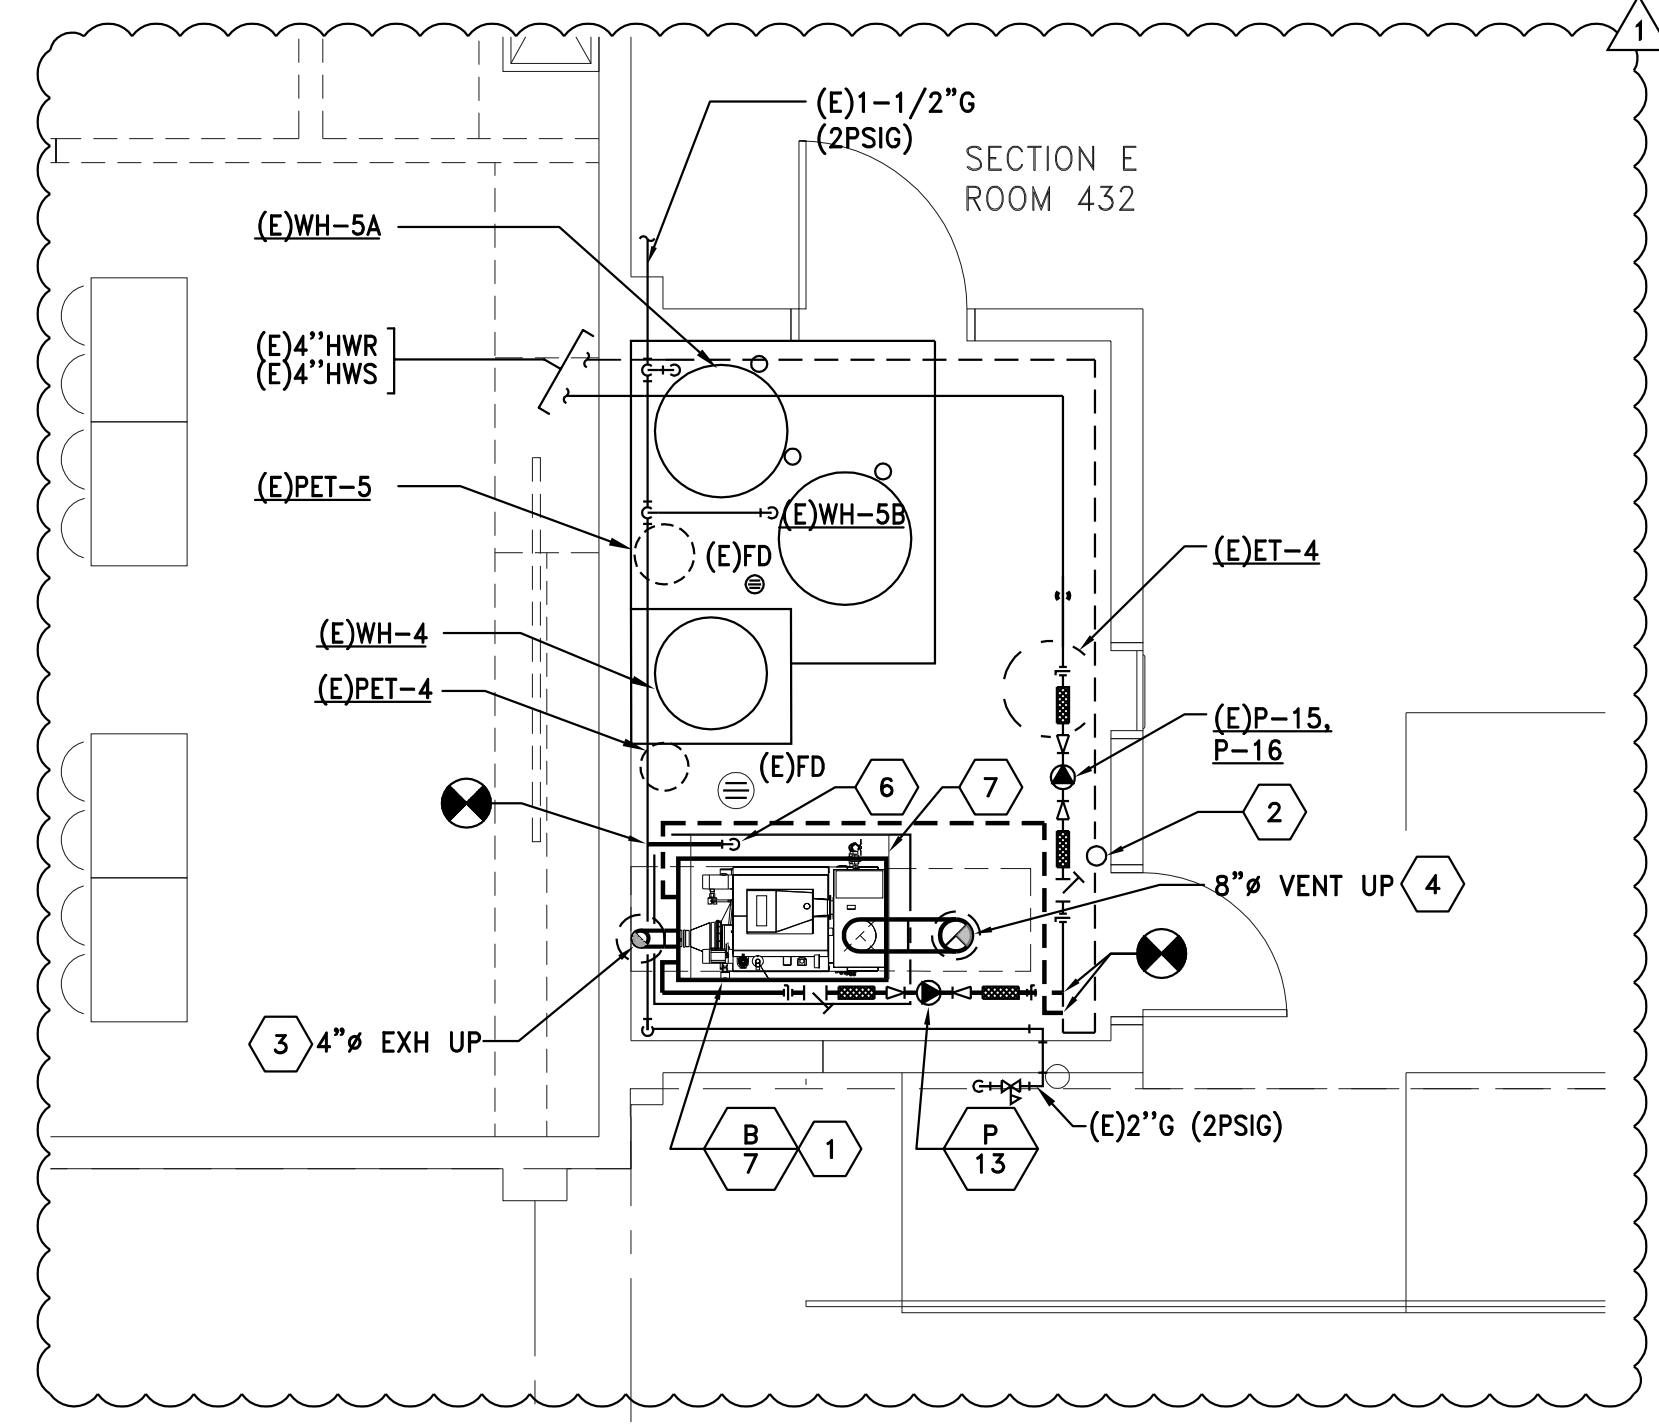


3 ENLARGED HVAC PLAN - SECTOR E - ROOM 432
M3.1 SCALE: 1/4" = 1'-0" 0 2' 4' 8'

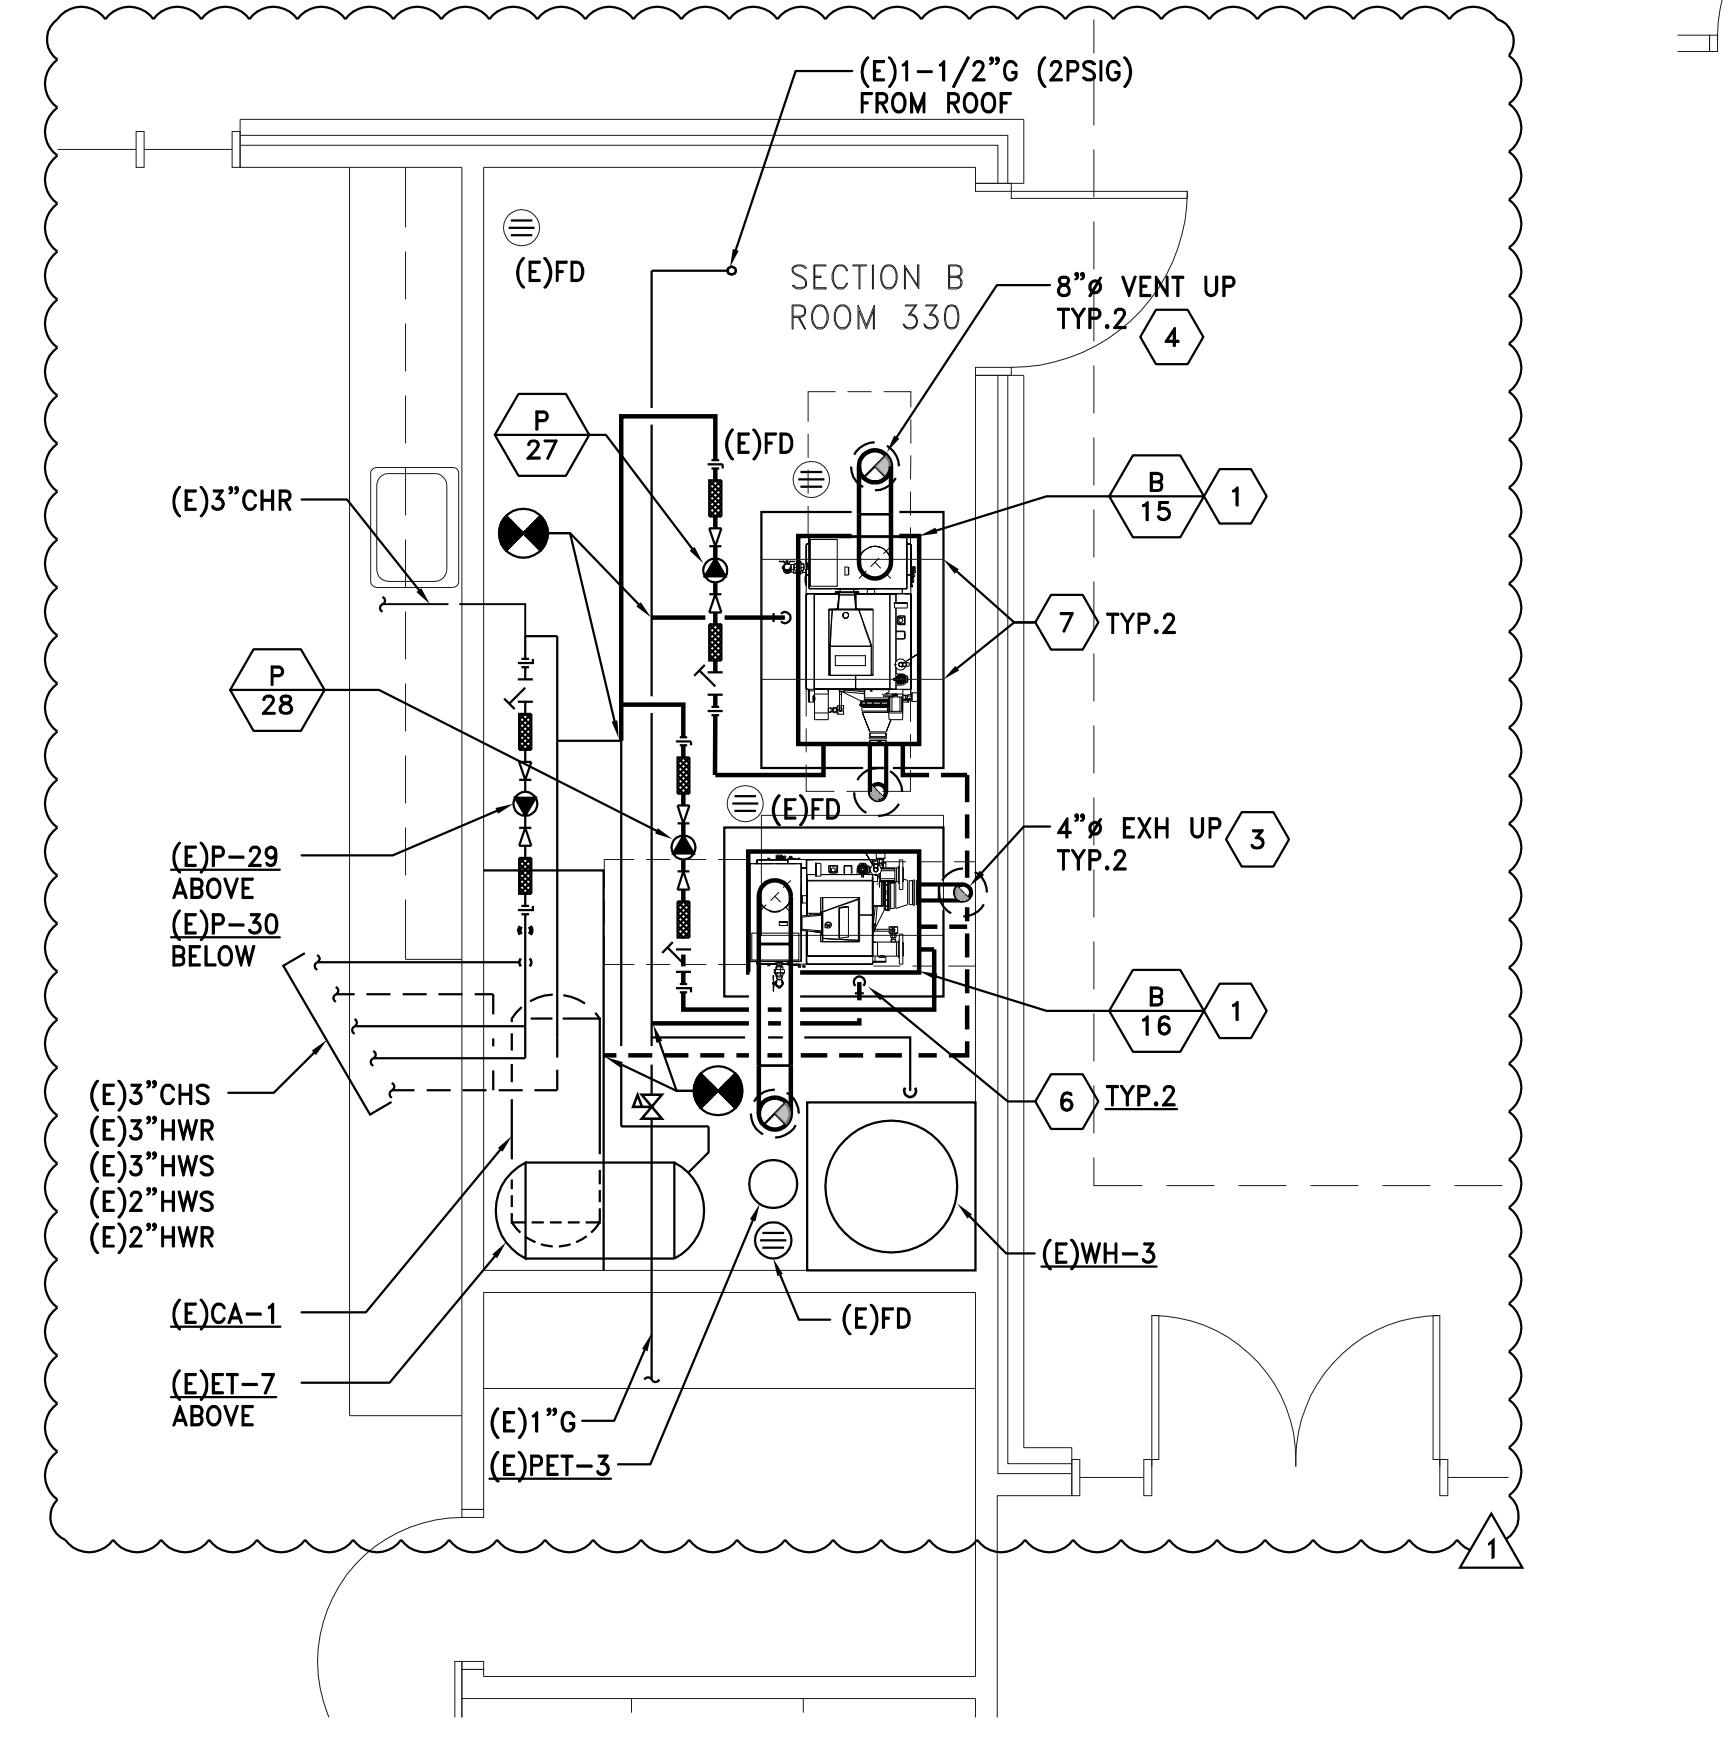

4 ENLARGED HVAC PLAN - SECTOR B - ROOM 330
M3.1 SCALE: 1/4" = 1'-0" 0 2' 4' 8'

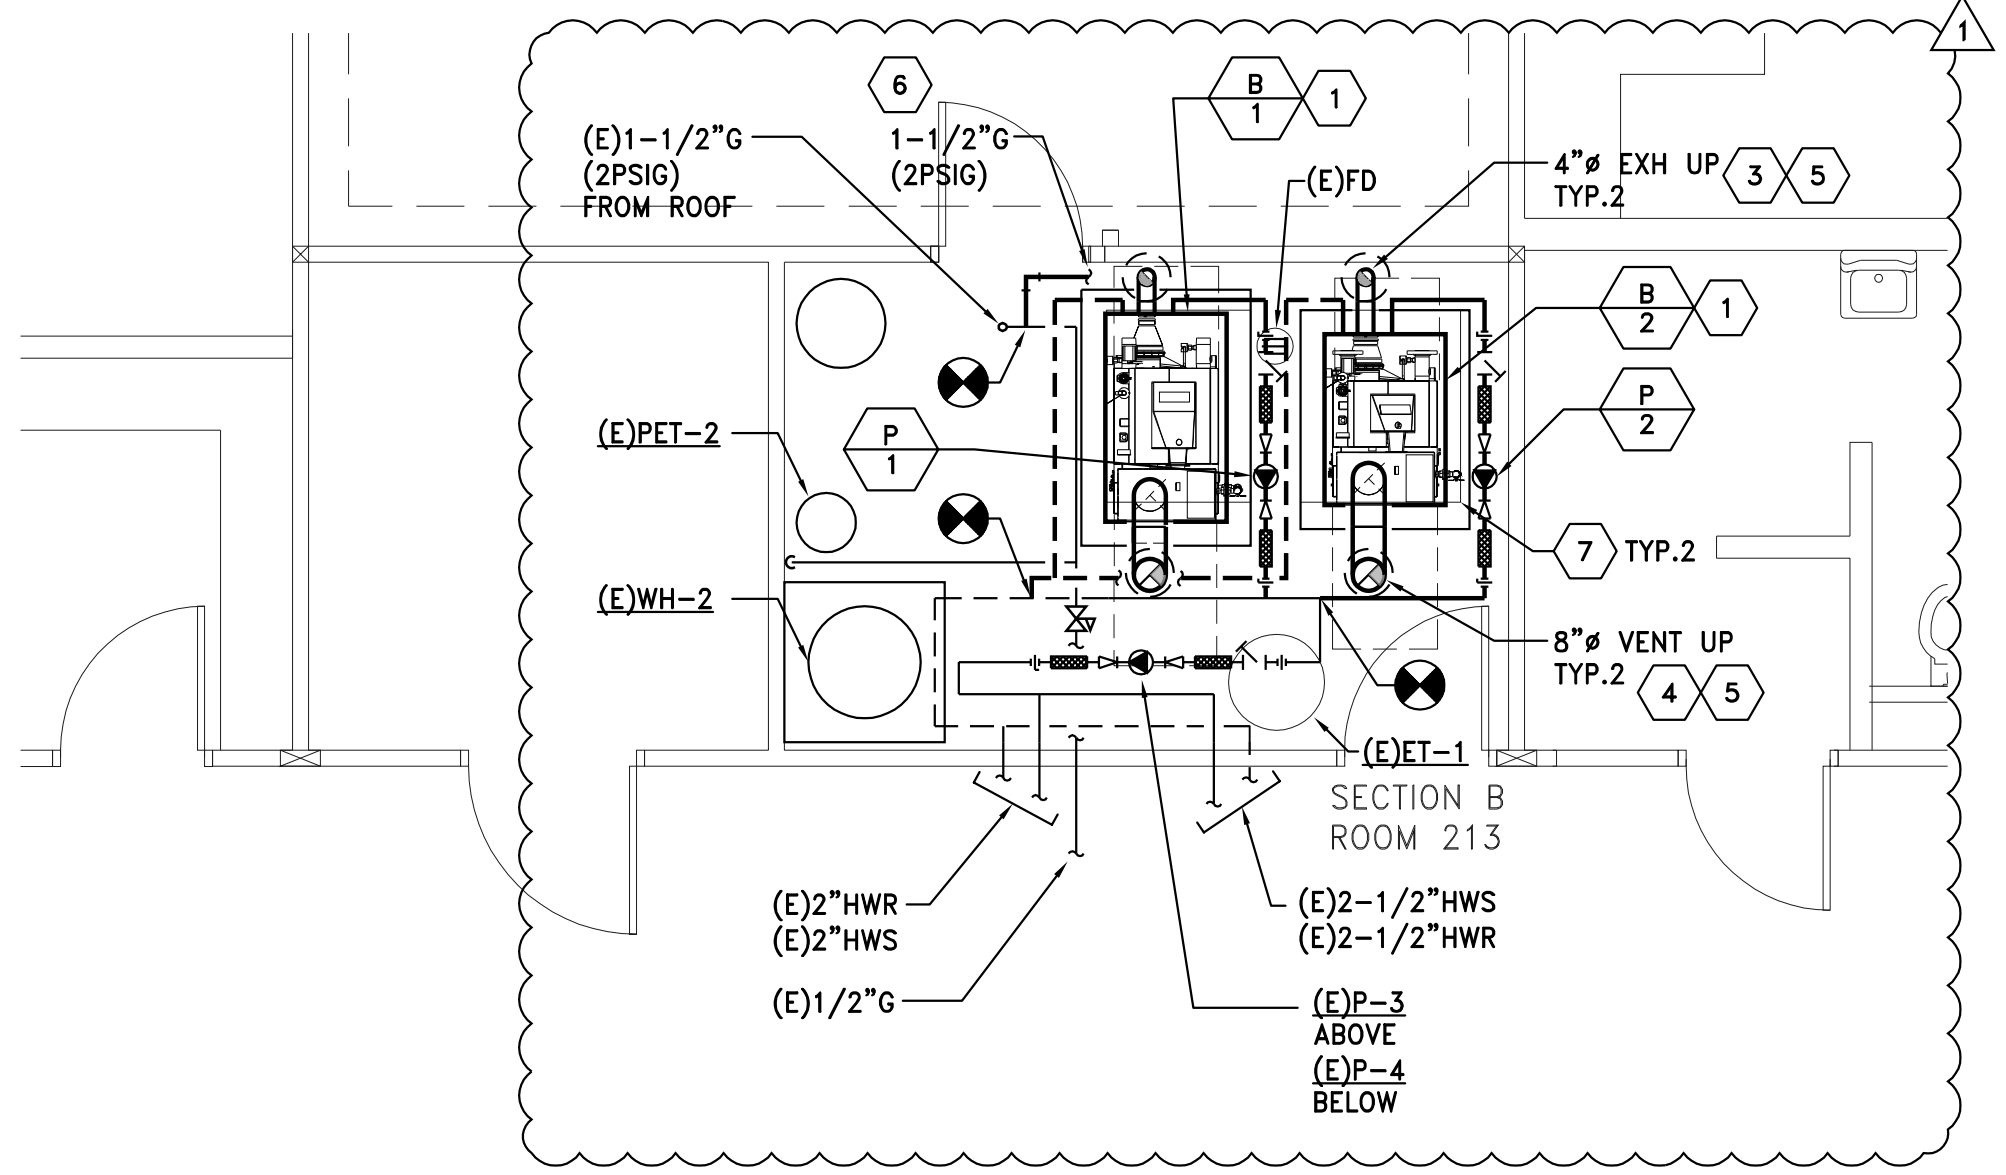

5 ENLARGED HVAC PLAN - SECTOR B - ROOM 213
M3.1 SCALE: 1/4" = 1'-0" 0 2' 4' 8'

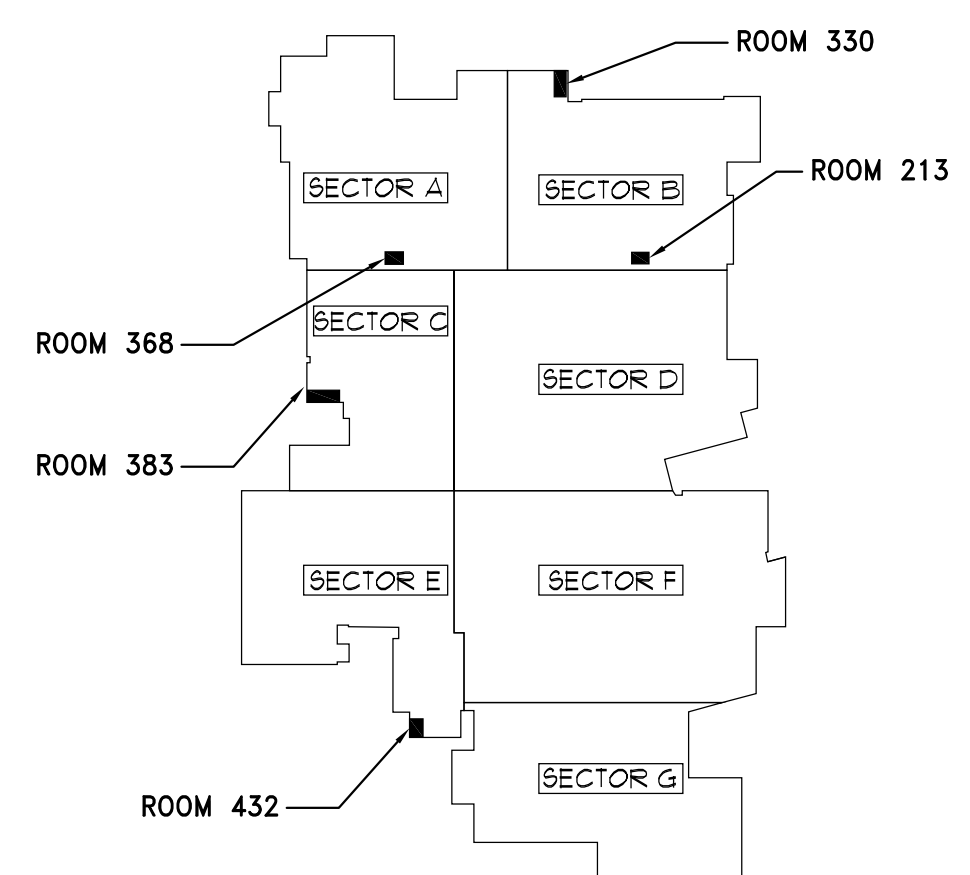

KEY PLAN

**BID SET
04/08/19**

**PARTIAL
HVAC PLANS**

**2018-65
SHEET NO.**

M3.1

6915 SW MACADAM AVE. SUITE 200
PORTLAND, OREGON 97219
PHONE: 503.892.1188
FAX: 503.892.1190
CONTACT...ALLEN CRISANAZ
engineering@mke-inc.com

