


E
D
C
B
A

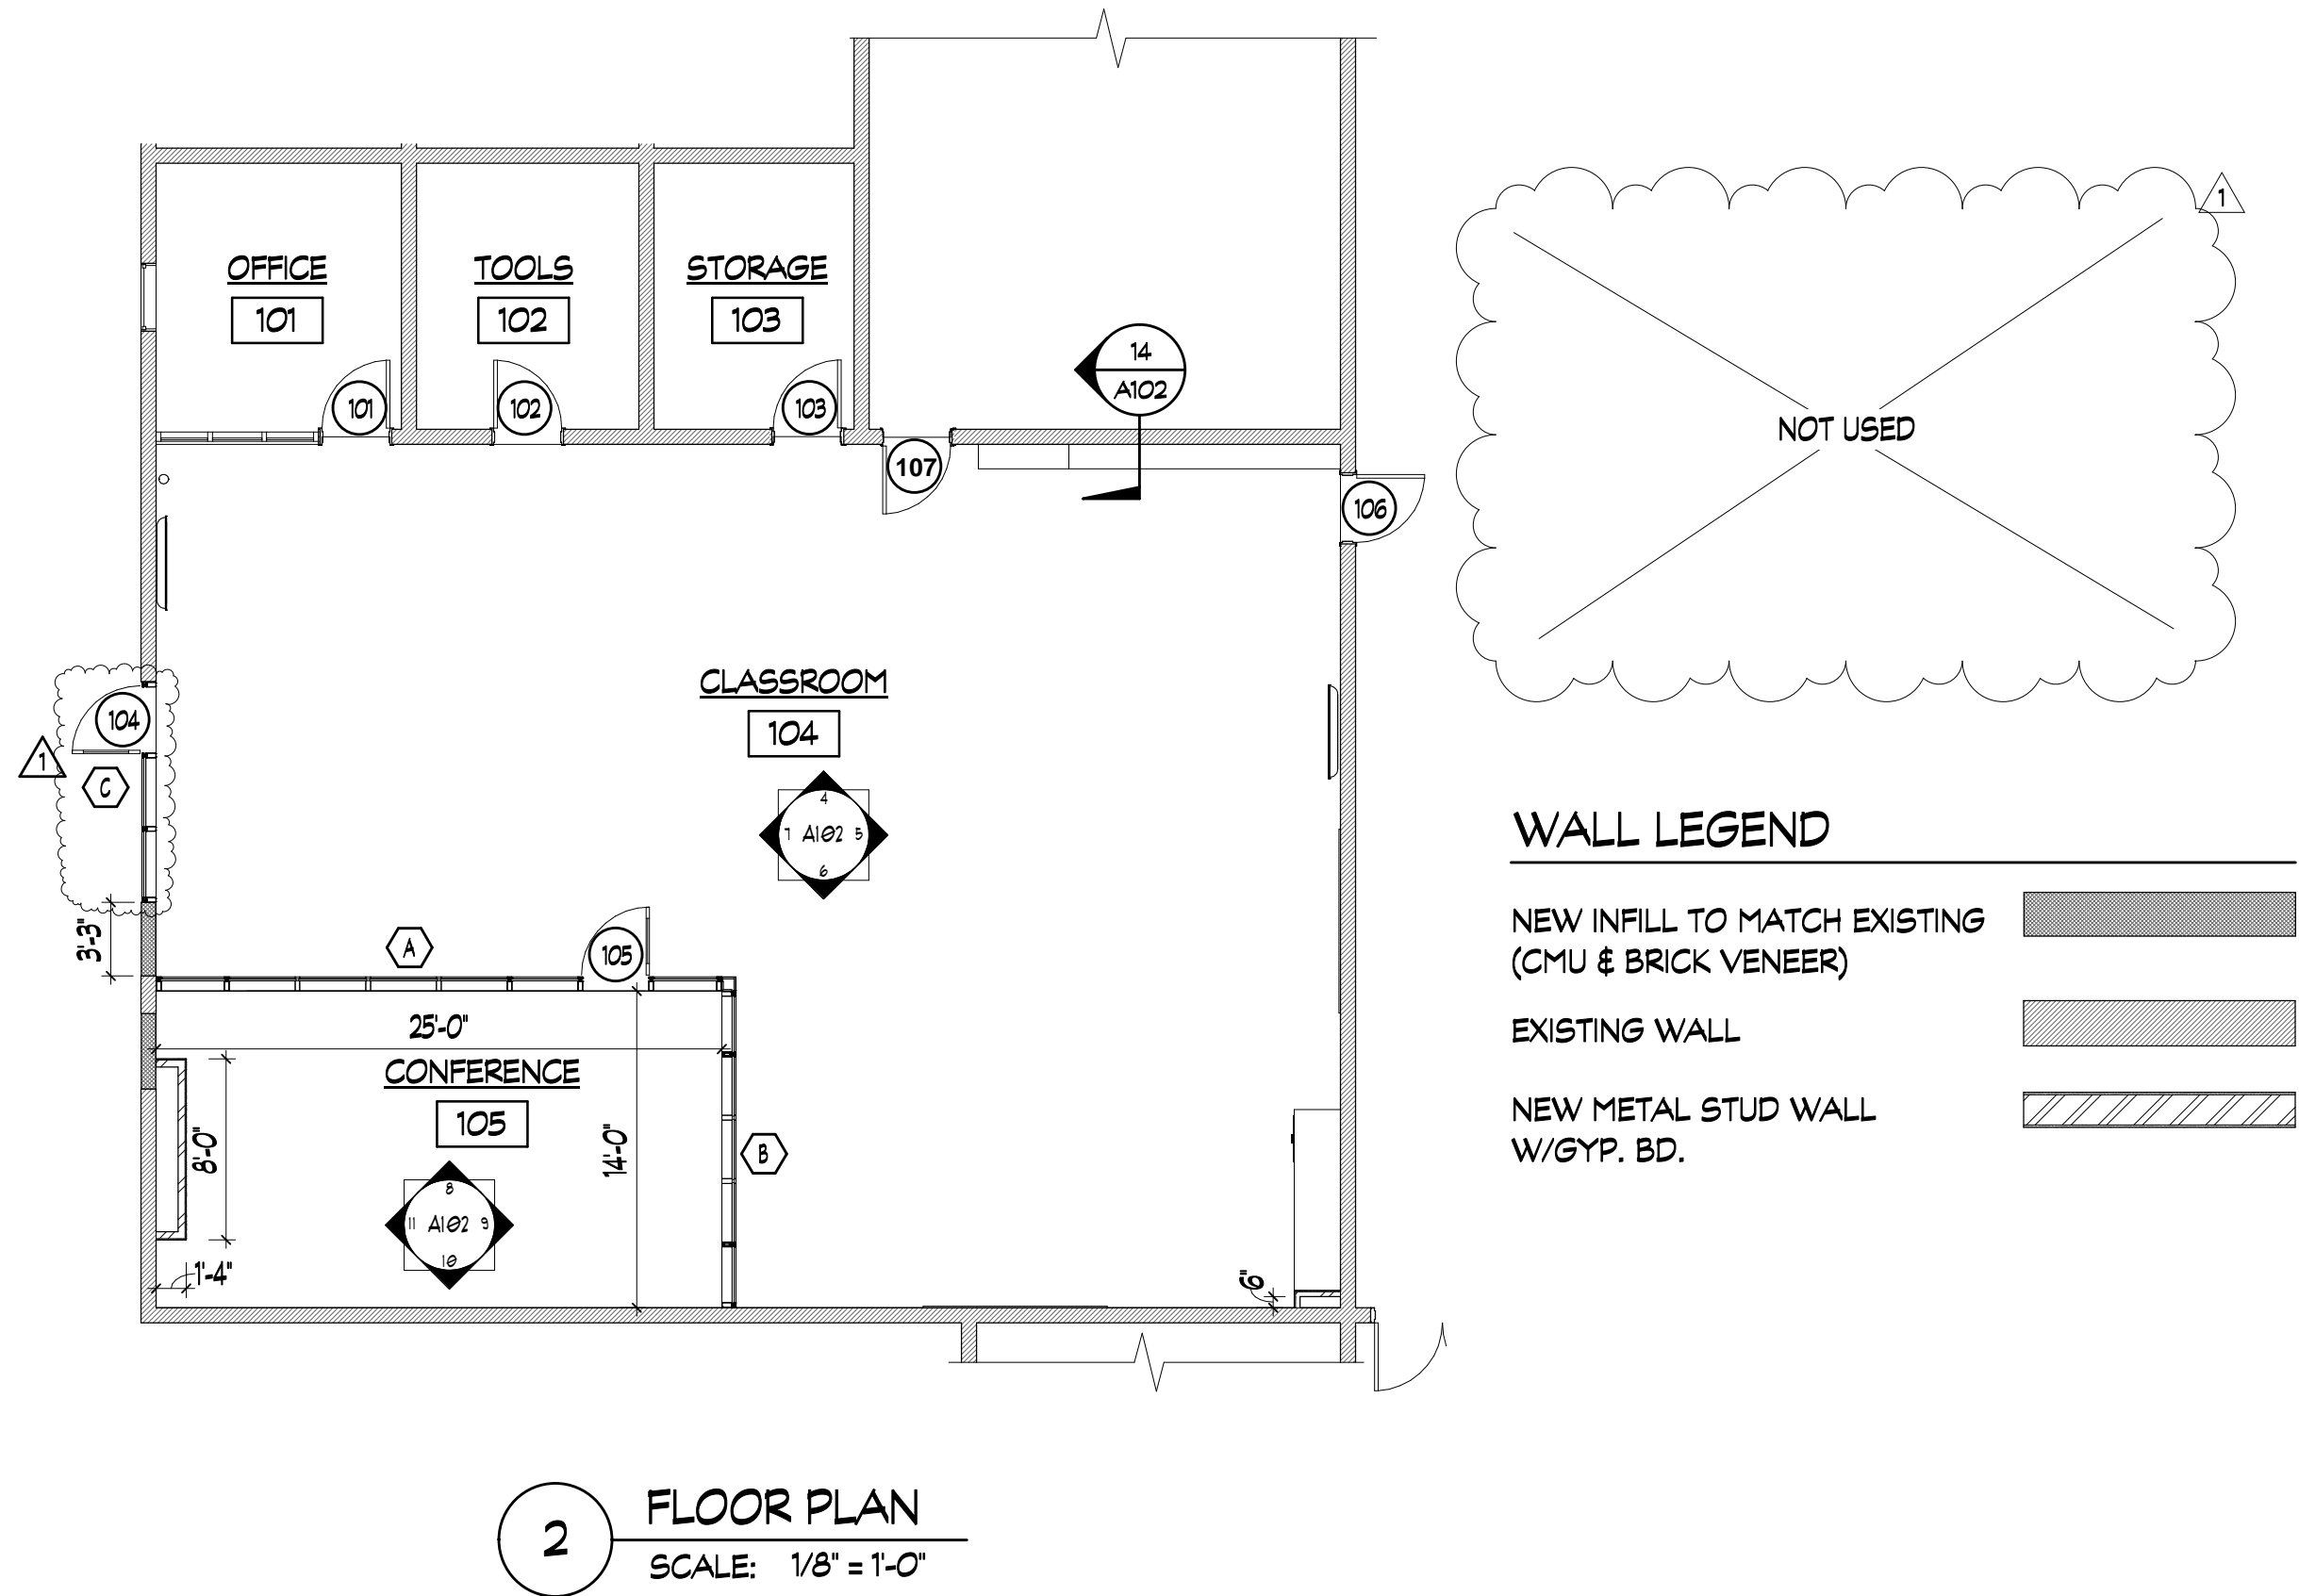


2 FLOOR PLAN
SCALE: 1/8" = 1'-0"

DOOR SCHEDULE															
DR #	DOOR SIZE (W X H)		PAIR	DOOR		DOOR FRAME		PR	GLAZING	DETAILS			F.R.	HDWR	REMARKS
	WIDTH	HEIGHT		TYPE	MAT.	TYPE	MAT.			HEAD	JAMB	SILL			
101	3'-0"	6'-8"		B	SC	EX	EX	-	1	-	-	-	-	3	1, 2
102	3'-0"	6'-8"		B	SC	EX	EX	-	1	-	-	-	-	4	
103	3'-0"	6'-8"		B	SC	EX	EX	-	1	-	-	-	-	4	
106	3'-0"	6'-8"		B	SC	EX	EX	-	1	-	-	-	-	2	
107	3'-0"	6'-8"		C	SC	EX	EX	-	-	-	-	-	-	5	

GENERAL DOOR NOTES

- ALL STAIRWELL DOORS SHALL HAVE TEMPERATURE RISE RATE OF 450 DEG. F.
- ALL FIRE-RATED DOORS MUST HAVE FIRE-RATED FRAMES, HARDWARE, CLOSURES AND OTHER RATED ACCESSORIES INCLUDING GLAZING.
- ALL TOILET DOORS TO RECEIVE SOUND SEALS UNLESS NOTED OTHERWISE.
- ALL GLAZING TO BE TEMPERED OR FIRE-RATED SAFETY GLAZING - NO WIRE GLAZING.
- FILL ALL MASONRY FRAMES WITH GROUT UNLESS NOTED OTHERWISE.
- PROVIDE EXTERIOR THRESHOLD AND WEATHER-STRIPPING AT ALL EXTERIOR DOORS.
- PROVIDE STRUCTURAL STEEL SUPPORT AT ALL LEAD LINED DOOR OPENINGS WHICH ARE 6'-0" OR GREATER.
- FIRE DOOR ASSEMBLIES IN EXIT ENCLOSURES AND EXIT PASSAGEWAYS SHALL HAVE A MAXIMUM TRANSMITTED TEMPERATURE END POINT OF NOT MORE THAN 450 DEG. F. ABOVE AMBIENT AT THE END OF MINUTES OF STANDARD FIRE TEST EXPOSURE.
- FIRE-PROTECTION-RATED GLAZING IN EXCESS OF 100 SQUARE INCHES SHALL BE TEST IN ACCORDANCE WITH NFPA 252 AS COMPONENTS OF THE DOOR ASSEMBLIES AND NOT AS GLASS LIGHTS, AND SHALL HAVE A MAXIMUM TRANSMITTED TEMPERATURE RISE OF 450 DEG. F.

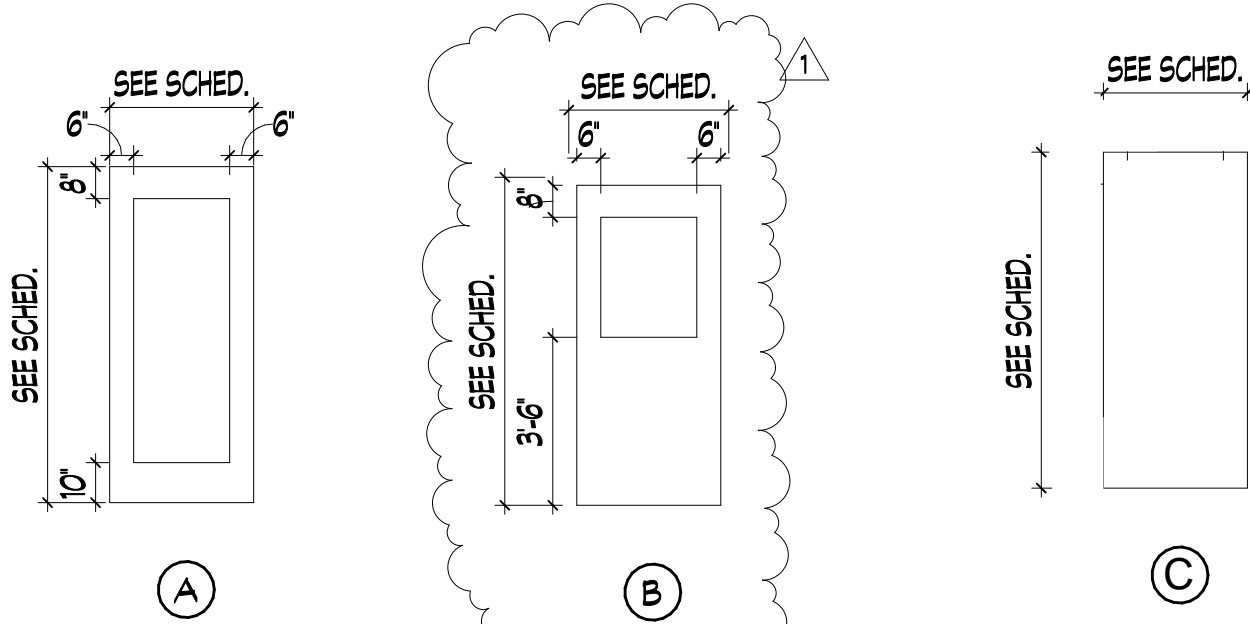

DOOR TYPES
SCALE: 1/4" = 1'-0"

REMARKS:

GLAZING TYPES

- 1/4" TEMPERED GLASS
- INSULATED TEMPERED GLASS
- FIRE-RATED SAFETY GLASS

ABBREVI:

HM - HOLLOW METAL
GHM - GALVANIZED HOLLOW METAL
SC - SOLID CORE

REMARKS:

- Door 102 to have frame modified to fit new strike location. Old Strike to be capped off. Modify door to fit 4 hinge locations in existing frame
- Door 102 to have 4 EA Hinges
- Existing HM framed are in masonry walls and are filled solid with grout.
- Doors to be Solid Core Oak, Clear Prefinished, Match existing Hinge/Lock

HARDWARE SETS

HARDWARE SET 1: DOOR 104

1 EA CONTINUOUS HINGE	224HD TWP	AL	IVE
1 EA PANIC HARDWARE	LXR-98EO	830	VON
1 EA RIM CYLINDER	20-057-ICX	626	SCH
1 EA MORTISE CYLINDER	20-059	626	SCH
1 EA FSIC CORE	23-030	626	SCH
1 EA SURFACE CLOSER	4040XP EDA	689	LCN
2 EA KICK PLATE	8400	630	IVE
2 EA FLOOR STOP	FS18S	BLK	IVE
1 EA SET SEALS	5020	BLK	NSP
1 EA DOOR SWEEP	C607A	AL	NSP
1 EA THRESHOLD	425	AL	NSP

HARDWARE SET 2: DOOR 106 (EACH DOOR TO HAVE)

3 EA HINGE	5BB1 4.5 X 4.5	652	IVE
1 EA CLASSROOM LOCK	L9490T-06A	626	SCH
1 EA FSIC CORE	23-030	626	SCH
1 EA SURFACE CLOSER	4040XP HCUSH	689	LCN
1 EA KICK PLATE	8400	630	IVE

HARDWARE SET 3: DOOR 101

3 EA HINGE - 4EA - door 10	5BB1 4.5X4.5	652	IVE
1 EA CLASSROOM LOCK	L9070T06A	626	SCH
1 EA FSIC CORE	23-030	626	SCH
1 EA WALL STOP	WS407CVX	630	IVE

HARDWARE SET 4: DOOR 102, 103

3 EA HINGE	5BB1 4.5X4.5	652	IVE
1 EA STOREROOM LOCK	L9490T-06A	626	SCH
1 EA FSIC CORE	23-030	626	SCH
1 EA SURFACE CLOSER	4040XP HCUSH	689	LCN
1 EA KICK PLATE	8400	630	IVE

HARDWARE SET 5: Door 107

3 EA HINGE	5BB1 4.5X4.5	652	IVE
1 EA Classroom Lock	L9070T064	626	SCH
1 EA FSIC CORE	23-030	626	SCH
1 EA SURFACE CLOSER	4040XP HCUSH	689	LCN
1 EA KICK PLATE	8400	630	IVE

dickinson
ARCHITECTS
Architecture/Interior Design/Planning
771 Broad Street Suite 200
Augusta, Georgia 30901
(706) 722-7488
mail@dickinsonarchitects.com
www.dickinsonarchitects.com

Member of the
American Institute of
Architects

PROJECT TITLE:
**ALLENDALE -
FAIRFAX
HIGH
SCHOOL -
CAREER
CENTER**

REVISIONS			
REV #	DATE	APRVD BY	REVISION
	11/02/18	NDII	ISSUE FOR PERMIT
	01/21/19	NDII	ISSUE FOR BID
1	01/22/19	NDII	ADDENDUM #1


STATE OF SOUTH CAROLINA
NICHOLAS C. DICKINSON, II
AUGUSTA, GA
#0052
REGISTERED ARCHITECT
1-21-19

SOUTH CAROLINA
DICKINSON ARCHITECTS, P.C.
ED. CAGNON
CERTIFICATE OF AUTHORIZATION

DA PROJECT NUMBER & NAME:
1743

DRAWING TITLE:
**DOOR &
WINDOW
SCHEDULE,
TYPES, &
DETAILS.**

A701

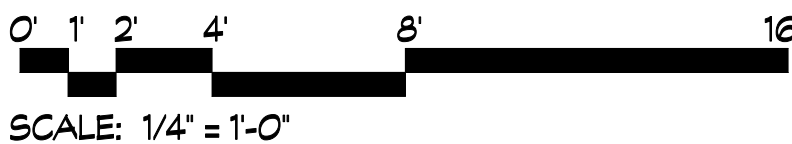

SCALE: 1/4" = 1'-0"